


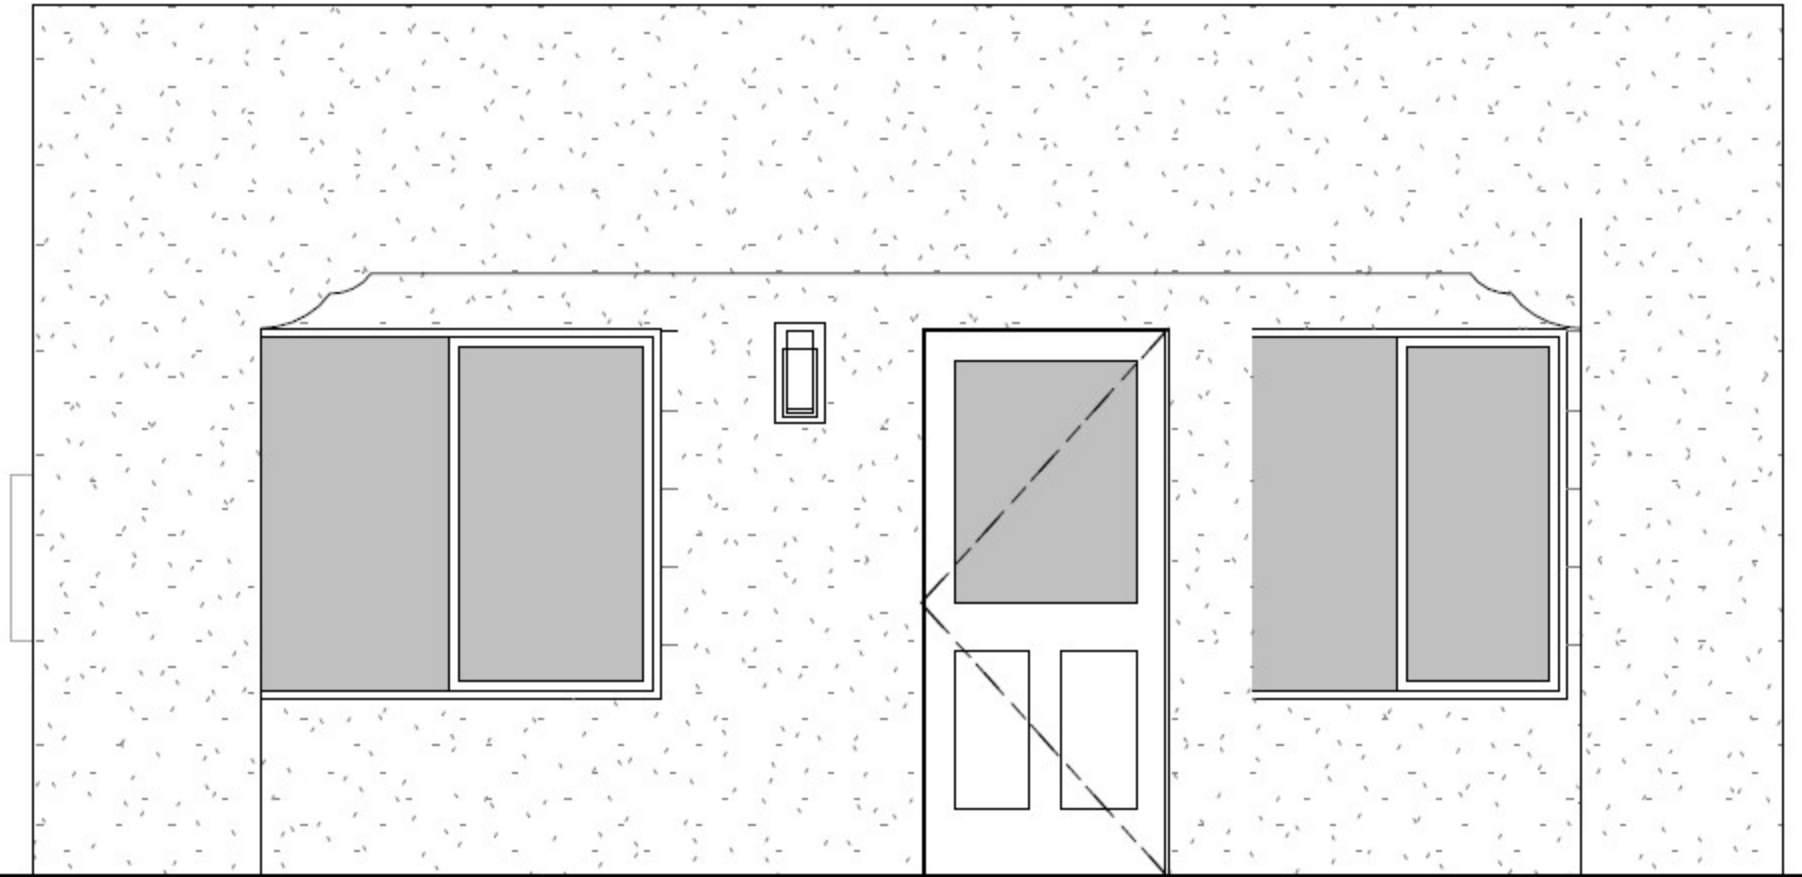

1

FRONT ELEVATION - MODERN

A6-101 A6-202

SCALE: 1/4" = 1'-0"

PROTOTYPE ACCESSORY DWELLING UNIT

PLAN 6: 2 CAR GARAGE CONVERSION


CITY OF COACHELLA, CA

STREET ADDRESS (TO BE PROVIDED BY OWNER)

ABBREVIATIONS

ABV	ABOVE	FD	FLOOR DRAIN	PLYWD	PLYWOOD
ACOUS	ACOUSTICAL	FE	FIRE EXTINGUISHER	PR	PAIR
ACT	ACOUSTICAL CEILING TILE	FEC	FIRE EXTINGUISHER PANEL	PT	PAINT
AD	AREA DRAIN	FG	FINISH GROUP	PTD	PAINTED
ADJ	ADJUSTABLE	FH	FIRE HYDRANT	R	RISER
AFF	ABOVE FINISH FLOOR	FHC	FIRE HOSE CABINET	RAD	RADIUS
ALT	ALTERNATE	FIN	FINISH	RCP	REFLECTED CEILING PLAN
ALUM	ALUMINUM	FLR	FLOOR	RD	ROOF DRAIN
APPROX	APPROXIMATE	FLUOR	FLOURESCENT	RE	REFER
ARCH	ARCHITECT	FT	FOOT OR FEET	REF	REFRIGERATOR
B.O.	BOTTOM OF	FUR	FURRING	REIN	REINFORCED
BALC	BALCONY	GAL	GALLON	REQD	REQUIRED
BD	BOARD	GALV	GALVANIZED	RESIL	RESILIENT
BET	BETWEEN	GB	GRAB BAR	RM	ROOM
BLDG	BUILDING	GC	GENERAL CONTRACTOR	RO	ROUGH OPENING
BLKG	BLOCKING	RTU	ROOF TOP UNIT (MECH)	S	SOUTH
BLW	BELOW	GL	GLASS	SAFB	SOUND ATTENUATION
BM	BEAM	GND	GROUND	SC	SCULPPER
BOT	BOTTOM	GWB	GYP SUM BOARD	SCD	SCHEDULE
BRKT	BRACKET	GYP	GYP SUM	SEAL	SEALANT
BULKHD	BULKHEAD	H.W.H.	HOT WATER HEATER	SECT	SECTION
BUR	BUILT UP ROOF	HDWD	HARDWOOD	SEAL	SEALANT
C.G.	CORNER GUARD	HDWR	HARDWARE	SH	SHEET
CAB	CABINET	HM	HOLLOW METAL	SHIT	SHEET
CAIK	CAULKING	HORIZ	HORIZONTAL	SH	SHEET
CEM	CEMENT	HR	HOUR	SIM	SIMILAR
CER	CERAMIC	HT	HEIGHT	SPEC	SPECIFICATION
CJ	CONTROL JOINT	ID	INNER DIAMETER	SQ	SQUIRE
CLG	CEILING	INCAN	INCANDESCENT	SS	STAINLESS STEEL
CLDS	CLOSED	INSUL	INSULATION	STD	STANDARD
CLR	CLEAR	INT	INTERIOR	STL	STEEL
CO	CASED OPENING	JAN	JANITOR	STOR	STORAGE
COL	COLUMN	JST	JOIST	STRUCT	STRUCTURAL
CONC	CONCRETE	JT	JOINT	SUSP	SUSPENDED
CONT	CONTINUOUS	LAM	LAMINATE	SYM	SYMMETRICAL
CPT	CARPET	LAV	LAVATORY	T	TREAD
CT	CERAMIC TILE	LB(S)	POUNDS	T&G	TONGUE & GROOVE
CTR	CENTER	LDG	LANDING	TEL	TELEPHONE
DBL	DOUBLE	LGHT	LIGHT	TER	TERRAZZO
DET	DETAIL	MAX	MAXIMUM	THK	THICK
DIA	DIAMETER	MECH	MECHANICAL	THR	THRESHOLD
DIM	DIMENSION	MEMB	MEMBRANE	TO	TOP OF
DN	DOWN	MFR	MANUFACTURER	TYP	TYPICAL
DR	DOOR	MIN	MINIMUM	UC	UNDERCUT
DS	DOWN SPOUT	MISC	MISCELLANEOUS	UNFIN	UNFINISHED
DW	DISHWASHER	MSC	MASONRY OPENING	UNO	UNLESS NOTED OTHERWISE
DWG	DRAWING	MTD	MOUNTED	UON	UNLESS OTHERWISE NOTED
E	EAST	N	NORTH	UTIL	UTILITY
EA	EACH	NT	NOT IN CONTRACT	VCT	VINYL COMPOSITION TILE
EFIS	EXTERIOR INSULATION & FINISH SYSTEM	NIC	NOT IN CONTRACT	NOM	NOMINAL
ELEC	ELECTRIC	NTS	NOT TO SCALE	VERT	VERTICAL
ELEV	ELEVATION	O.P.	OVERFLOW PIPE	VIF	VERIFY IN FIELD
EMER	EMERGENCY	OVERALL	OVERALL	VTR	VENT TERMINATION PIPE
ENCL	ENCLOSURE	OA	ON CENTER	WVC	VINYL WALL COVERING
EOS	EDGE OF SLAB	OC	ON CENTER	W	WEST
EQ	EQUAL	OD	OUTSIDE DIAMETER	W/	WITH
EQUIP	EQUIPMENT	OFF	OFFICE	W/O	WITHOUT
ETR	EXISTING TO REMAIN	OH	OPPOSITE HAND	WC	WATERCLOSET
EW	EACH WAY	OPG	OPENING	WIN	WINDOW
EXP. JT.	EXPANSION JOINT	OPP	OPPOSITE	WP	WATERPROOF
EXT	EXISTING	PART	PARTITION	WS	WETSTACK
F.O.	FACE OF	PERM	PERIMETER	WSCT	WAINSCOT
FA	FIRE ALARM	PG	PAINT GRADE	WT	WEIGHT
FAP	FIRE ANNUNCIATOR PANEL	PLAM	PLASTIC LAMINATE		
		PLAS	PLASTER		

SYMBOLS

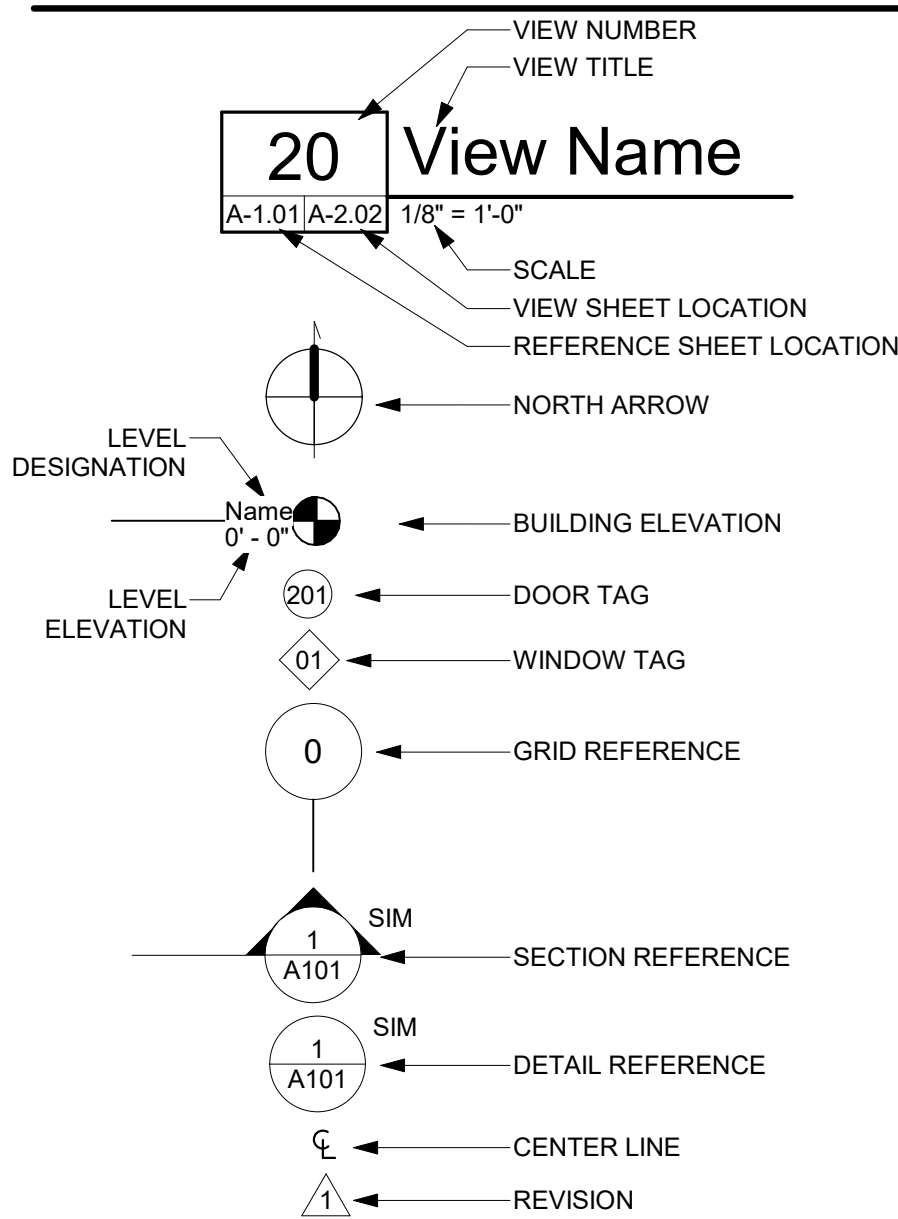

GENERAL NOTES

1. APPLICABLE CODES AND STANDARDS:
 - 1.1. 2022 CALIFORNIA BUILDING CODE AND ITS APPENDICES AND STANDARDS.
 - 1.2. 2022 CALIFORNIA PLUMBING CODE AND ITS APPENDICES AND STANDARDS.
 - 1.3. 2022 CALIFORNIA MECHANICAL CODE AND ITS APPENDICES AND STANDARDS.
 - 1.4. 2022 CALIFORNIA FIRE CODE AND ITS APPENDICES AND STANDARDS.
 - 1.5. 2022 CALIFORNIA ELECTRICAL CODE AND ITS APPENDICES AND STANDARDS.
 - 1.6. 2022 CALIFORNIA GREEN BUILDING ENERGY EFFICIENCY STANDARDS.
 - 1.7. 2022 CALIFORNIA GREEN BUILDING STANDARDS CODE AND ITS APPENDICES AND STANDARDS.
2. 2022 CALIFORNIA RESIDENTIAL CODE AND ITS APPENDICES AND STANDARDS
3. CURRENT CITY OF COACHELLA, CA MUNICIPAL CODE.
4. ALL WORK DESCRIBED IN THE DRAWINGS SHALL BE VERIFIED FOR DIMENSION, GRADE, EXTENT AND COMPATIBILITY WITH EXISTING SITE CONDITIONS. ANY DISCREPANCIES AND UNEXPECTED CONDITIONS THAT AFFECT OR CHANGE THE WORK DESCRIBED IN THE CONTRACT DOCUMENTS SHALL BE BROUGHT TO THE ARCHITECT'S ATTENTION IMMEDIATELY. DO NOT PROCEED WITH THE WORK IN THE AREA OF DISCREPANCIES UNTIL ALL SUCH DISCREPANCIES ARE RESOLVED. IF THE CONTRACTOR CHOOSES TO DO SO, HE/SHE SHALL BE PROCEEDING AT HIS/HER OWN RISK.
5. DIMENSIONS SHOWN SHALL TAKE PRECEDENCE OVER DRAWING SCALE OR PROPORTION. LARGER SCALE DRAWINGS SHALL TAKE PRECEDENCE OVER SMALLER SCALE DRAWINGS.
6. IN THE EVENT OF THE UNFORESEEN ENCOUNTER OF MATERIALS SUSPECTED TO BE OF AN ARCHAEOLOGICAL OR PALEONTOLOGICAL NATURE, ALL GRADING AND EXCAVATION SHALL CEASE IN THE IMMEDIATE AREA AND THE THE CONTRACTOR SHALL NOTIFY THE OWNER. THE FIND SHALL BE LEFT UNTouched UNTIL AN EVALUATION BY A QUALIFIED ARCHAEOLOGIST OR PALEONTOLOGIST IS MADE.
7. CONTRACTOR IS TO BE RESPONSIBLE FOR BEING FAMILIAR WITH THESE DOCUMENTS INCLUDING ALL CONTRACT REQUIREMENTS.
8. GRADING PLANS, DRAINAGE IMPROVEMENTS, ROAD AND ACCESS REQUIREMENTS AND ENVIRONMENTAL HEALTH CONSIDERATIONS SHALL COMPLY WITH ALL LOCAL ORDINANCES.
9. THE FOLLOWING ITEMS SHODRAWINGS ARE OWNER PROVIDED, OWNER INSTALLED. UTILITIES PROVIDED FOR THESE ITEMS WILL BE PROVIDED BY THE CONTRACTOR. CONTRACTOR TO COORDINATE INSTALLATION WITH OWNER.
10. TV/DVD SYSTEMS
11. ICE MACHINE
12. VENDING MACHINE
13. REFRIGERATOR
14. MICROWAVE
15. OSHA PERMITS REQUIRED FOR VERTICAL CUTS 5' OR OVER.
16. CONTRACTOR TO PROVIDE COMPLETE DETAILS OF ENGINEERED TEMPORARY SHORING OR SLOT CUTTING PROCEDURES ON PLANS. CALL FOR INSPECTION BEFORE EXCAVATION BEGINS.
17. CONTRACTOR TO REVIEW CALIFORNIA GREEN CODE REQUIREMENTS FOR CONTRACTOR REQUIREMENTS
18. A SEPARATE OFFICER, ACCESS EASEMENT/AGREEMENT, AND/OR RECIPROCAL ACCESS EASEMENT/AGREEMENT MAY BE REQUIRED TO INSURE THAT THE PROPOSED PRIVATE ACCESS ROADWAY WILL REMAIN OPEN TO THROUGH TRAFFIC AND EMERGENCY VEHICLES PRIOR TO FINAL OF BUILDING PERMIT.
19. OWNER TO PROVIDE LOCATION OF THE NEAREST FIRE HYDRANT. FIRE HYDRANT LOCAION SHALL MEET THE REQUIREMENTS IN THE CPC.
20. IF THE MAIN RESIDENCE HAS TWO EXISTING WATER CLOSETS, WITH THE INCLUSION OF THE ADDITIONAL WATER CLOSET IN THE ADU, THE EXISTING SEWER LATERAL SIZE IS TO BE VARIFIED TO BE 4 INCHES PER CPC TABLE 703.2.

SPECIAL INSTRUCTIONS

OWNER SHALL SUPPLY INFORMATIN ON THE FOUNDATION TYPE OF THE EXISTING BUILDING. IF THE FOUNDATION TYPE OF THE EXISTING BUILDING MATCHES THE PROPOSED FOUNDATION OF AN ADU, A SOILS REPORT WILL NOT BE REQUIRED. HOWEVER, IF A DIFFERENT FOUNDATION TYPE IS PROPOSED A SOILS REPORT WILL BE REQUIRED.

DEFERRED SUBMITTALS

1. ROOF TRUSS CALCULATIONS
2. FIRE SPRINKLER (YES / NO) (SEPARATE PLAN CHECK / PERMIT)
3. SOLAR PV (-KW) (SEPARATE PLAN CHECK / PERMIT)

PROJECT DIRECTORY

CLIENT:

ADDRESS:

PHONE:

FAX:

CONTACT:

EMAIL:

ARCHITECT (MODIFICATION TO PROTOTYPE):

RRM DESIGN GROUP

ADDRESS:

PHONE:

FAX:

CONTACT:

EMAIL:

LANDSCAPE ARCHITECT (IF APPLICABLE):

ADDRESS:

PHONE:

FAX:

CONTACT:

EMAIL:

CIVIL ENGINEER (IF APPLICABLE):

ADDRESS:

PHONE:

FAX:

CONTACT:

EMAIL:

AGENCIES AND UTILITIES

COMMUNITY DEVELOPMENT DEPARTMENT

CITY OF COACHELLA PLANNING

ADDRESS:

PHONE:

FAX:

WATER SERVICE:

ADDRESS:

PHONE:

FAX:

GAS SERVICE:

ADDRESS:

PHONE:

FAX:

TELEPHONE SERVICE:

ADDRESS:

PHONE:

FAX:

ELECTRICAL SERVICE:

ADDRESS:

PHONE:

FAX:

SEWER SERVICE:

ADDRESS:

PHONE:

FAX:

GARBAGE SERVICE:

ADDRESS:

PHONE:

FAX:

PROTOTYPE PLANS PREPARED BY

ARCHITECT (PROTOTYPE):

RRM DESIGN GROUP

ADDRESS:

PHONE:

FAX:

CONTACT:

EMAIL:

STRUCTURAL ENGINEER:

RRM DESIGN GROUP

ADDRESS:

PHONE:

FAX:

CONTACT:

EMAIL:

SHEET INDEX

G-006

TITLE SHEET - PLAN 6

G-102

GENERAL NOTES

T24-600

CERTIFICATE OF COMPLIANCE

T24-601

CERTIFICATE OF COMPLIANCE

AS-100

ARCHITECTURAL SITE PLAN SHEET - EXAMPLE & INSTRUCTIONS

A6-101

FLOOR PLAN & RCP - PLAN 6

A6-111

MECHANICAL AND ELECTRICAL PLANS AND REFLECTED CEILING PLAN - PLAN 6

A6-201

EXT. ELEVATIONS & SECTIONS - PLAN 6 - MISSION

A6-202

EXT. ELEVATIONS & SECTIONS - PLAN 6 - MODERN

A6-203

EXT. ELEVATIONS & SECTIONS - PLAN 6 - SPANISH

AD-901

ARCHITECTURAL DETAILS - COMMON

AD-902

ARCHITECTURAL DETAILS - COMMON

AD-903

ARCHITECTURAL DETAILS - MISSION REVIVAL

AD-904

ARCHITECTURAL DETAILS - DESERT MODERN

AD-905

ARCHITECTURAL DETAILS - SPANISH COLONIAL

AD-906

ARCHITECTURAL DETAILS - SPANISH COLONIAL

Grand total: 16

PROJECT SCOPE

CONVERSION OF 2-CAR GARAGE INTO 1 BEDROOM / 1 BATH ADU.

SITE INFORMATION

OWNER TO PROVIDE THE FOLLOWING INFORMATION:

LEGAL DESCRIPTION:

APN #:

ZONING INFORMATION

CITY OF COACHELLA TO PROVIDE THE FOLLOWING INFORMATION:

ZONING:

OVERLAY:

ALLOWABLE BUILDING HEIGHT:

LOT SIZE:

EXISTING BLDG SPRINKLERED:

IF YES, PROPOSED ADU MUST ALSO BE SPRINKLERED.

HABITABLE SQUARE FOOTAGE

EXISTING HABITABLE SQUARE FOOTAGE:

PROPOSED HABITABLE SQUARE FOOTAGE:

FAR (FLOOR AREA LIMIT)

EXISTING FAR:

MAX ALLOWABLE FAR:

PROPOSED FAR:

LOT COVERAGE

INCLUDING ALL AREAS UNDER SOLID ROOF, INCLUDING EAVES.

EXISTING LOT COVERAGE:

ALLOWABLE LOT COVERAGE:

PROPOSED LOT COVERAGE:

LOT SLOPE:

SETBACKS:

FRONT:

REAR:

SIDE:

PARKING REQ

EXISTING COVERED SPACES:

EXISTING UNCOVERED SPACES:

REQUIRED PARKING:

COVERED:

UNCOVERED:

PROPOSED TOTAL SPACES:

COVERED:

UNCOVERED:

ADU BUILDING INFORMATION

CITY OF COACHELLA TO PROVIDE THE FOLLOWING INFORMATION:

OCCUPANCY GROUP:

CONSTRUCTION TYPE:

CONDITINED AREA:

PLAN 6-EXISTING FOOTPRINT OF GARAGE, AS SHOWN IN VIEW 1/A6-101

672 SF

PROJECT CHECKLIST

*FOR PLANNING STAFF ONLY

INITIAL WHEN SECTION HAS BEEN REVIEWED.

STAFF INITIALS:

EXTERIOR WALL MATERIAL

NEW INFILL SIDING SHALL MATCH EXISTING PRINCIPAL DWELLING

WINDOW MATERIAL

COLOR AND STYLE TO MATCH EXISTING HOME

☐ VINYL

☐ FIBERGLASS

☐ WOOD

☐ ALUMINUM CLAD WOOD

ROOF MATERIAL

COLOR AND STYLE TO MATCH EXISTING HOME

☐ COMPOSITION SHINGLES

☐ STANDING SEAM METAL ROOF

WASTE WATER

☐ SEWER

ONSITE PARKING REQUIRED

☐ NONE

EXCEPTION USED:

☐ THE ADU IS LOCATED WITHIN 1/2 MILE OF PUBLIC TRANSIT.

☐ THE ADU IS LOCATED WITHIN A ARCHITECTURALLY AND HISTORICALLY SIGNIFICANT STRUCTURE.

☐ OFF STREET PARKING PERMITS ARE REQUIRED BUT NOT OFFERED TO THE OCCUPANT OF THE ADU.

☐ WHEN THERE IS A CAR SHARE VEHICLE LOCATED WITHIN ONE BLOCK OF THE ADU.

☐ ONE PARKING SPACE

VERY HIGH FIRE SEVERITY ZONE

☐ NO

☐ YES

IF THE PROPERTY THAT WILL CONTAIN THE

FLOOR PLAN NOTES

- WEATHER BARRIERS**
 - NOT FEWER THAN ONE-LAYER WATER-RESISTIVE BARRIER SHALL BE APPLIED OVER STUDS OR SHEATHING OF ALL EXTERIOR WALLS CONTINUOUS FROM TOP OF WALLS AND TERMINATED AT PENETRATIONS AND BUILDING APPENDAGES WITH FLASHING. MINIMUM NO. 15 FELT COMPLYING WITH ASTM D226, TYPE 1.
 - PROVIDE (2) LAYERS OF GRADE 4 PAPER OR EQUAL WHEN PLASTER IS INSTALLED OVER WOOD BASED SHEATHING. (2022 CRC R703.7.3)
- DOMESTIC RANGE** VENTILATION DUCTS SHALL HAVE SMOOTH INTERIOR SURFACES. (2022 CMC 504.3)
- CLOTHES DRYER** MOISTURE EXHAUST DUCTS SHALL TERMINATE OUTSIDE THE BUILDING AND HAVE A BACK-DRAFT DAMPER. EXHAUST DUCT IS LIMITED TO 14'-0" W/ TWO ELBOWS. THIS SHALL BE REDUCED 2'-0" FOR EVERY ELBOW IN EXCESS OF TWO. MIN. DIA. 4". SMOOTH, METAL DUCT. (2022 CMC 504.4)
- ALL MANUFACTURED EQUIPMENT** SHALL BE INSTALLED AS PER MANUFACTURER'S SPECIFICATION AND DIMENSIONS VERIFIED WITH INSTALLATION REQUIREMENTS. ALL MANUFACTURERS INSTALLATION INSTRUCTIONS SHOULD BE ON SITE AND SHALL BE SEISMICALLY ANCHORED FOR INSPECTIONS.
- SHOWERS AND TUB-SHOWER COMBINATIONS:** CONTROL VALVES MUST BE PRESSURE BALANCED OR THERMOSTATIC MIXING VALVES. (2022 CPC 417.0.)
- WET-ROOM GLAZING:** PROVIDE TEMPERED GLAZING IN DOORS AND ENCLOSURES FOR SHOWERS, BATHTUBS, SAUNAS, STEAM ROOMS, HOT TUBS & SIMILAR USES WHERE THE BOTTOM EXPOSED EDGE IS LESS THAN 60-INCHES ABOVE A STANDING SURFACE. (2022 CRC R308.4.5)
- HEATING AND AIR-CONDITIONING SYSTEM DESIGN** SHALL CONFORM TO CALGREEN SEC. 4.507, ENVIRONMENTAL COMFORT.
- WATER CLOSETS.**
 - CLEARANCES: 24" MIN. FRONT, 30" MIN. COMPARTMENT WIDTH.
 - PROVIDE A MIN 3 SF WINDOW, 1/2 OF WHICH SHALL BE OPENABLE OR AN EXHAUST FAN 50 CFM FOR INTERMITTENT OR 20 CFM FOR CONTINUOUS. DIRECT VENT TO OUTSIDE WITH BACKDRAFT DAMPER. (2022 CRC R303.3)
 - NEW WATER CLOSETS AND ASSOCIATED FLUSHOMETER VALVES, IF ANY SHALL USE NO MORE THAN 1.28 GALLONS PER FLUSH AND SHALL MEET PERFORMANCE STANDARDS ESTABLISHED BY THE AMERICAN SOCIETY OF MECHANICAL ENGINEERS STANDARD A112.19.2, H & S CODE, SECTION 17921.3(B).
- BATH ACCESSORIES:** PROVIDE MINIMUM 1 TOILET PAPER HOLDER AND 1 TOWEL BAR PER BATHROOM. PROVIDE NECESSARY BLOCKING FOR TOILET PAPER HOLDER AND TOWEL BARS.
- ATTIC ACCESS:**
 - WHERE REQUIRED, PROVIDE 30" MIN. HEADROOM IN THE ATTIC SPACE (2022 CRC R807.1)
 - BUILDINGS WITH COMBUSTIBLE CEILING OR ROOF CONSTRUCTION SHALL HAVE AN ATTIC ACCESS OPENING TO ATTIC AREAS THAT EXCEED 30 SQUARE FEET AND HAVE A VERTICAL HEIGHT OF 30-INCHES OR GREATER. THE VERTICAL HEIGHT SHALL BE MEASURED FROM TOP OF THE CEILING FRAMING MEMBERS TO THE UNDERSIDE OF THE ROOF FRAMING MEMBERS.
 - THE ROUGH-FRAMED OPENING SHALL NOT BE LESS THAN 22" X 30" AND SHALL BE LOCATED NOT OVER 20 FEET FROM THE EQUIPMENT. (2022 CRC R807.1)
 - IN ATTIC, PROVIDE LIGHT AND SWITCH, AND ALL NECESSARY ELECTRICAL. PROVIDE UNOBSTRUCTED PASSAGEWAY 24" WIDE OF SOLID CONTINUOUS FLOORING FROM ACCESS TO EQUIPMENT AND IT'S CONTROLS. ALSO PROVIDE UNOBSTRUCTED WORK SPACE IN FRONT OF EQUIPMENT 30" DEPTH MINIMUM. PROVIDE COMBUSTION AIR AND CONDENSATE LINE TO OUTSIDE OR AN APPROVED DRAIN FOR OPTIONAL AIR CONDITIONING.
 - PROVIDE A 120V RECEPTACLE AND A LIGHT NEAR THE EQUIPMENT WITH LIGHT SWITCH LOCATED AT THE ATTIC ACCESS.
- BATHTUB AND SHOWER FLOORS AND WALLS ABOVE BATHTUBS WITH INSTALLED SHOWER HEADS AND IN SHOWER COMPARTMENTS SHALL BE FINISHED WITH A NONABSORBENT FINISH. SUCH WALL FINISHES SHALL EXTEND TO A HEIGHT OF NOT LESS THAN 6 FEET ABOVE THE FLOOR PER 2022 CRC, SECTION R307.2.

SITE NOTES

- CALL BEFORE YOU DIG!** CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING.
- UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY WITHIN 10-FEET OF ANY BUILDING FOUNDATION WITH A SLOPE OF 5% AWAY FROM ANY BUILDING OR STRUCTURE. ALL EXTERIOR HARDSCAPE WITHIN 10-FEET OF A BUILDING FOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE AWAY FROM ANY BUILDING OR STRUCTURE. DRAINAGE SWALES SHALL BE A 1.5% MINIMUM SLOPE. ALL GRADED SLOPES SHALL HAVE A MAXIMUM SLOPE OF 3H TO 1V (33%), UNLESS SHOWN OTHERWISE ON THE PLANS.
- LOT GRADING SHALL CONFORM AT THE PROPERTY LINES AND SHALL NOT SLOPE TOWARD PROPERTY LINES IN A MANNER WHICH WOULD CAUSE STORM WATER TO FLOW ONTO NEIGHBORING PROPERTY. HISTORIC DRAINAGE PATTERNS SHALL NOT BE ALTERED IN A MANNER TO CAUSE DRAINAGE PROBLEMS TO NEIGHBORING PROPERTY.
- NEW RAINWATER DOWNSPOUTS SHALL BE DISCONNECTED AND DIRECT RUNOFF TO A LANDSCAPED AREA, DOWNSPOUTS MAY BE CONNECTED TO A POP-UP DRAINAGE EMITTER IN THE LANDSCAPED AREA OR MAY DRAIN TO SPLASH BLOCKS OR COBBLESTONES THAT DIRECT WATER AWAY FROM THE BUILDING.
- CONTRACTOR TO FIELD VERIFY EXISTING DRAINAGE. IF THE EXISTING DRAINAGE SYSTEM IS DAMAGED DURING EXCAVATION, CONTRACTOR SHALL REPAIR AND/OR REROUTE DRAINAGE SYSTEM AND CONNECT TO EXISTING DRAINAGE FACILITY AS NECESSARY.
- EXISTING PUBLIC IMPROVEMENTS THAT ARE DAMAGED BY THE PROJECT CONSTRUCTION SHALL BE REPAIRED OR REPLACED. EXISTING DAMAGED PUBLIC IMPROVEMENTS WITHIN THE PROJECT LIMITS SHALL BE REPAIRED OR REPLACED EVEN IF THE DAMAGE OCCURRED PRIOR TO THE START OF CONSTRUCTION.
- EROSION AND SEDIMENT CONTROL FACILITIES SHALL BE INSTALLED PRIOR TO OCTOBER 1 AND SHALL BE MAINTAINED DAILY UNTIL APRIL 30. THESE FACILITIES SHALL CONTROL AND CONTAIN EROSION-CAUSED SILT DEPOSITS AND PROVIDE FOR THE SAFE DISCHARGE OF SILT-FREE STORM WATERS INTO EXISTING STORM DRAIN FACILITIES. EROSION AND SEDIMENT CONTROL SUPPLIES MUST BE KEPT ON-SITE DURING THE DRY SEASON AND EMPLOYED, AS NECESSARY PRIOR TO AND DURING RAIN EVENTS.
- SEASONALLY APPROPRIATE BEST MANAGEMENT PRACTICES FOR THE FOLLOWING SITE MANAGEMENT CATEGORIES MUST BE IMPLEMENTED YEAR-ROUND: 1) EROSION CONTROL; 2) RUN-ON AND RUN-OFF CONTROL; 3) SEDIMENT CONTROL; 4) GOOD SITE MANAGEMENT; AND 5) NON- STORMWATER MANAGEMENT.
- AN ENCROACHMENT PERMIT WILL BE REQUIRED FOR ANY CONSTRUCTION ACTIVITY WITHIN A PUBLIC STREET RIGHT OF WAY THAT HAS BEEN ACCEPTED BY THE CITY.

ELECTRICAL NOTES

- CONFORM WITH CURRENT CEC, NFPA, MFR'S, AND LOCAL REQUIREMENTS.
- ELECTRICAL SYSTEMS SHALL BE PROVIDED PER NEC ARTICLE 250-81.
- ALL MATERIALS TO BE U.L. LABELED.
- METER: "SQUARE D", 120 VOLT/7 240 VOLT, 1 AND 3 WIRE GROUND OR EQUAL.
- ELECTRICAL SUB PANEL: FLUSH MOUNT, 30" CLEARANCE, 100 AMP.
- CONDUCTORS: TW, THW, COPPER, MINIMUM 14 AT LIGHTING, 12 AT OTHER CIRCUITS.
- ALL LUMINAIRES SHALL COMPLY WITH 2022 CENC SECTION 150.0 (K) AND TABLE 150.0-A AS REFERENCED IN ENERGY NOTES, LUMINAIRE REQUIREMENTS SHEET G-101.
- ALL ELECTRICAL OUTLETS INSTALLED IN BATHROOMS, GARAGES, ASSESSMENTS, CRAWL SPACES, OUTDOORS, KITCHEN COUNTERTOPS, AND AT WET BAR SINKS SHALL HAVE GROUND-FAULT CIRCUIT-INTERRUPTER PROTECTION IN COMPLIANCE WITH NEC ART. 210-8, CONSISTING OF 125 VOLT, SINGLE-PHASE, 15- AND 20- AMPERE RECEPTACLES.
- ALL BATHROOM RECEPTACLE OUTLETS SHALL BE SUPPLIED BY A MINIMUM OF ONE 120-VOLT, 20-AMPERE BRANCH CIRCUIT. SUCH CIRCUITS SHALL HAVE NO OTHER OUTLETS. THIS DEDICATED CIRCUIT MAY SERVE MORE THAN ONE BATHROOM. (2022 CEC 210.11(C))
- THERMOSTAT SHALL BE A PROGRAMMABLE TYPE, HONEYWELL TH8320 OR EQUAL.
- CEILING-SUSPENDED (PADDLE) FANS SHALL BE SUPPORTED INDEPENDENTLY OF AN OUTLET BOX OR BY LISTED OUTLET BOX OR OUTLET BOX SYSTEMS IDENTIFIED FOR THE USE AND INSTALLED IN ACCORDANCE WITH 2022 CEC 314.27(C) (2022 CEC 422.18).
- ALL LUMINAIRES, LAMP HOLDERS, AND RETROFIT KITS SHALL BE LISTED (2022 CEC 410.8)
- ALL 120-VOLT, SINGLE PHASE 15- AND 20-AMPERE BRANCH CIRCUITS SUPPLYING OUTLETS INSTALLED IN DWELLING UNIT KITCHENS, FAMILY ROOMS, LIVING ROOMS, DINING ROOMS, PARLORS, LIBRARIES, DEN'S, BEDROOMS, SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS OR SIMILAR ROOMS OR AREAS SHALL BE PROTECTED BY A LISTED ARC-FAULT CIRCUIT INTERRUPTER, COMBINATION-TYPE, INSTALLED TO PROVIDE PROTECTION OF THE BRANCH CIRCUIT. (2022 CEC 210-12(A)).
- ALL NON-LOCKING TYPE 125-VOLT, 15 AND 20 AMPERE RECEPTACLES IN A DWELLING UNIT SHALL BE LISTED TAMPER-RESISTANT RECEPTACLES. EXCEPTIONS: (1) RECEPTACLES MORE THAN 5'6" ABOVE THE FLOOR, (2) RECEPTACLES PART OF A LUMINAIRE OR APPLIANCE, (3) A SINGLE RECEPTACLE OR A DUPLEX RECEPTACLE FOR TWO APPLIANCES THAT ARE NOT EASILY MOVED AND LOCATED WITHIN DEDICATED SPACE AND ARE CHORD-AND-PLUG CONNECTED AS PER CEC 400.10, AND (4) NON-GROUNDING RECEPTACLES USED FOR RECIPEMNETS AS PERMITTED IN CEC 408.4(D)(2)(A).
- HIGH EFFICACY LUMINAIRES OTHER THAN OUTDOOR HD LIGHTING CONTAIN ONLY ONLY HIGH EFFICACY LAMPS AS OUTLINED IN TABLE 150.0-C OF THE RESIDENTIAL ENERGY CODE AND NOT CONTAIN A MEDIUM SCREW BASE SOCKET.
- HALLAST FOR LAMPS 13 WATTS OR GREATER SHALL BE ELECTRONIC AND HAVE AN OUTPUT FREQUENCY NO LESS THAN 20 kHz.
- SMOKE DETECTORS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING AND PROVIDED WITH A BATTERY BACK-UP. ALL SMOKE DETECTORS SHALL BE INTERCONNECTED. ALL SMOKE DETECTORS SHALL MAINTAIN A MINIMUM 3 FOOT CLEARANCE TO HVAC SUPPLY OR RETURN AIR REGISTERS.
- CARBON MONOXIDE ALARMS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING AND PROVIDED WITH A BATTERY BACK-UP. ALL CARBON MONOXIDE ALARMS SHALL BE INTERCONNECTED.
- EXHAUST FANS WILL BE CONTROLLED BY A HUMIDISTAT PER THE GREEN BUILDING STANDARDS CODE SECTION 4.506. EXHAUST FANS MUST BE SWITCHED SEPARATELY FROM LIGHTS (2022 Cenc 150.0(k)(2G)).
- IN ADDITION TO THE NUMBER OF BRANCH CIRCUITS REQUIRED BY OTHER PARTS OF THE CODE, TWO OR MORE 20-AMPERE SMALL-APPLIANCE BRANCH CIRCUITS SHALL BE PROVIDED FOR ALL RECEPTACLE OUTLETS IN THE KITCHEN, PANTRY, BREAKFAST ROOM, DINING ROOM, OR SIMILAR AREA PER 2022 CEC, ARTICLE 210.11 (C)(1). THE CIRCUITS SHALL HAVE NO OTHER OUTLETS PER 2022 CEC, ARTICLE 210.52(B).
- IN ADDITION TO THE NUMBER OF BRANCH CIRCUITS REQUIRED BY OTHER PARTS OF THE CODE, AT LEAST ONE ADDITIONAL 20-AMPERE BRANCH CIRCUIT SHALL BE PROVIDED TO SUPPLY THE LAUNDRY AREA AND ONE OUTLET(S) REQUIRED BY 2022 CEC, ARTICLE 210.52 (F). THIS CIRCUIT SHALL HAVE NO OTHER OUTLETS PER 2022 CEC, ARTICLE 201.11(C)(2).

ENERGY NOTES

- THE BUILDER MUST PROVIDE NEW HOMEOWNERS WITH A LUMINAIRE SCHEDULE THAT INCLUDES A LIST OF INSTALLED LAMPS AND LUMINAIRES.

LUMINAIRE REQUIREMENTS (2022 Cenc 150.0(k)(1).

- LUMINAIRE EFFICACY.** ALL INSTALLED LUMINAIRES SHALL MEET THE REQUIREMENTS IN TABLE 150.0-A.
EXCEPT: INTEGRATED DEVICE LIGHTING, LIGHTING INTEGRAL TO EXHAUST FANS, KITCHEN RANGE HOODS, BATH VANITY MIRRORS AND RANGE OR OPENERS, NAVIGATION LIGHTING, SUCH AS NIGHT LIGHTS, STEP LIGHTS, AND PATH LIGHTS LESS THAN 5 WATTS, CABINET LIGHTING, LIGHTING INTERNAL TO DRAWERS, CABINETS AND LINEN CLOSETS WITH AN EFFICACY OF 48 LUMENS PER WATT OR GREATER.
- THE FOLLOWING ARE HIGH-EFFICACY LIGHT SOURCES PER TABLE 150.0-A:**
THE FOLLOWING LIGHT SOURCES, OTHER THAN THOSE INSTALLED IN CEILING RECESSED DOWNLIGHT LUMINAIRES, ARE NOT REQUIRED TO COMPLY WITH REFERENCE JOINT APPENDIX JA8:
 - LED LIGHT SOURCES INSTALLED OUTDOORS.
 - INSEPARABLE SOLID STATE LIGHTING (SSL) LUMINAIRES CONTAINING COLORED LIGHT SOURCES THAT ARE INSTALLED TO PROVIDE DECORATIVE LIGHTING.
 - PIN-BASED LINEAR FLUORESCENT OR COMPACT FLUORESCENT LIGHT SOURCES USING ELECTRONIC BALLASTS.
 - HIGH INTENSITY DISCHARGE (HID) LIGHT SOURCES INCLUDING PULSE START METAL HALIDE AND HIGH PRESSURE SODIUM LIGHT SOURCES.
 - LUMINAIRES WITH HARDWIRED HIGH FREQUENCY GENERATOR AND INDUCTION LAMP.
 - CEILING FAN LIGHT KITS SUBJECT TO FEDERAL APPLIANCE REGULATIONS.

- THE FOLLOWING LIGHT SOURCES ARE ONLY CONSIDERED TO BE HIGH EFFICACY IF THEY ARE CERTIFIED TO THE COMMISSION AS HIGH EFFICACY LIGHT SOURCES IN ACCORDANCE WITH REFERENCE JOINT APPENDIX JA8 AND MARKED AS REQUIRED BY JA8.
- ALL LIGHT SOURCES INSTALLED IN CEILING RECESSED DOWNLIGHT LUMINAIRES, NOTE THAT CEILING RECESSED DOWNLIGHT LUMINAIRES SHALL NOT HAVE SCREW BASES REGARDLESS OF LAMP TYPE AS DESCRIBED IN SECTION 150.0(K)(1C).
 - ANY LIGHT SOURCE NOT OTHERWISE LISTED.
- SCREW-BASED LUMINAIRES.** SCREW-BASED LUMINAIRES SHALL CONTAIN LAMPS THAT COMPLY WITH REFERENCE JOINT APPENDIX JA8.
 - RECESSED DOWNLIGHT LUMINAIRES IN CEILINGS.** LUMINAIRES RECESSED INTO CEILINGS SHALL MEET ALL OF THE FOLLOWING REQUIREMENTS:
 - SHALL NOT CONTAIN SCREW BASE LAMP SOCKETS; AND
 - HAVE A LABEL THAT CERTIFIES THE LUMINAIRE IS AIRTIGHT WITH AIR LEAKAGE LESS THAN 2.0 CFM AT 75 PASCALS WHEN TESTED IN ACCORDANCE WITH ASTM E283. AN EXHAUST FAN HOUSING WITH INTEGRAL LIGHT SHALL NOT BE REQUIRED TO BE CERTIFIED AIRTIGHT; AND
 - BE SEALED WITH A GASKET OR CAULK BETWEEN THE LUMINAIRE HOUSING AND CEILING, AND HAVE ALL AIR LEAK PATHS BETWEEN CONDITIONED AND UNCONDITIONED SPACES SEALED WITH A GASKET OR CAULK, OR BE INSTALLED PER MANUFACTURER'S INSTRUCTIONS TO MAINTAIN AIRTIGHTNESS BETWEEN THE LUMINAIRE HOUSING AND CEILING; AND
 - MEET THE CLEARANCE AND INSTALLATION REQUIREMENTS OF CALIFORNIA ELECTRICAL CODE SECTION 410.116 FOR RECESSED LUMINAIRES.
EXCEPT: RECESSED LUMINAIRES MARKED FOR USE IN FIRE-RATED INSTALLATIONS EXTRUDED INTO CEILING SPACE AND RECESSED LUMINAIRES INSTALLED IN NONINSULATED CEILINGS.

ENERGY NOTES CONTINUED

- LIGHT SOURCES IN ENCLOSED OR RECESSED LUMINAIRES.** LAMPS AND OTHER SEPARATE LIGHT SOURCES THAT ARE NOT COMPLIANT WITH THE JAB ELEVATED TEMPERATURE REQUIREMENTS, INCLUDING MARKING REQUIREMENTS, SHALL NOT BE INSTALLED IN ENCLOSED OR RECESSED LUMINAIRES.
- BLANK ELECTRICAL BOXES.** THE NUMBER OF ELECTRICAL BOXES THAT ARE MORE THAN 5 FEET ABOVE THE FINISHED FLOOR AND DO NOT CONTAIN A LUMINAIRE OR OTHER DEVICE SHALL BE NO GREATER THAN THE NUMBER OF BEDROOMS. THESE ELECTRICAL BOXES MUST BE SERVED BY A DIMMER, VACANCY SENSOR CONTROL, LOW VOLTAGE WIRING OR FAN SPEED CONTROL.
- INDOOR LIGHTING CONTROLS** (2022 Cenc 150.0(k)(2).
 - LIGHTING SHALL HAVE READILY ACCESSIBLE WALL-MOUNTED CONTROLS THAT ALLOW THE LIGHTING TO BE MANUALLY TURNED ON AND OFF.
EXCEPT: CEILING FANS MAY PROVIDE CONTROL OF INTEGRATED LIGHTING VIA A REMOTE CONTROL.
 - NO CONTROLS SHALL BYPASS A DIMMER, OCCUPANT SENSOR OR VACANCY SENSOR FUNCTION WHERE THAT DIMMER OR SENSOR HAS BEEN INSTALLED TO COMPLY WITH SECTION 150.0(K).
 - LIGHTING CONTROLS SHALL COMPLY WITH THE APPLICABLE REQUIREMENTS OF SECTION 110.9.
 - AN ENERGY MANAGEMENT CONTROL SYSTEM (EMCS) OR A MULTISCENE PROGRAMMABLE CONTROL MAY BE USED TO COMPLY WITH DIMMING, OCCUPANCY AND LIGHTING CONTROL REQUIREMENTS IN SECTION 150.0(K)(2) IF IT PROVIDES THE FUNCTIONALITY OF THE SPECIFIED CONTROLS IN ACCORDANCE WITH SECTION 110.9, AND THE PHYSICAL CONTROLS SPECIFIED IN SECTION 150.0(K)2A.
 - AUTOMATIC-OFF CONTROLS.**
 - IN BATHROOMS, GARAGES, LAUNDRY ROOMS, UTILITY ROOMS AND WALK-IN CLOSETS, AT LEAST ONE INSTALLED LUMINAIRE SHALL BE CONTROLLED BY AN OCCUPANCY OR VACANCY SENSOR PROVIDING AUTOMATIC-OFF FUNCTIONALITY.
 - FOR LIGHTING INTERNAL TO DRAWERS AND CABINETS WITH OPAQUE FRONTS OR DOORS, CONTROLS THAT TURN THE LIGHT OFF WHEN THE DRAWER OR DOOR IS CLOSED SHALL BE PROVIDED.
 - DIMMING CONTROLS.** LIGHTING IN HABITABLE SPACES, INCLUDING BUT NOT LIMITED TO LIVING ROOMS, DINING ROOMS, KITCHENS AND BEDROOMS, SHALL HAVE READILY ACCESSIBLE WALL-MOUNTED DIMMING CONTROLS THAT ALLOW THE LIGHTING TO BE MANUALLY ADJUSTED UP AND DOWN, FORWARD PHASE CUT DIMMERS CONTROLLING LED LIGHT SOURCES IN THESE SPACES SHALL COMPLY WITH NEMA SSL 7A.
EXCEPT: CEILING FANS MAY PROVIDE CONTROL OF INTEGRATED LIGHTING VIA A REMOTE CONTROL. LUMINAIRES CONNECTED TO A CIRCUIT WITH CONTROLLED LIGHTING POWER LESS THAN 20 WATTS OR CONTROLLED BY AN OCCUPANCY OR VACANCY SENSOR PROVIDING AUTOMATIC-OFF FUNCTIONALITY, NAVIGATION LIGHTING SUCH AS NIGHT LIGHTS, STEP LIGHTS, AND PATH LIGHTS LESS THAN 5 WATTS, AND LIGHTING INTERNAL TO DRAWERS AND CABINETS WITH OPAQUE FRONTS OR DOORS OR WITH AUTOMATIC-OFF CONTROLS.
 - INDEPENDENT CONTROLS.** INTEGRATED LIGHTING OF EXHAUST FANS SHALL BE CONTROLLED INDEPENDENTLY FROM THE FANS. THE FOLLOWING SHALL BE CONTROLLED SEPARATELY FROM CEILING-INSTALLED LIGHTING SUCH THAT ONE CAN BE TURNED ON WITHOUT TURNING ON THE OTHER:
 - UNDERCABINET LIGHTING, UNDERSHELF LIGHTING, INTERIOR LIGHTING OF DISPLAY CABINETS, AND SWITCHED OUTLETS.
- RESIDENTIAL OUTDOOR LIGHTING** (2022 Cenc 150.0(k)(3). IN ADDITION TO MEETING THE REQUIREMENTS OF SECTION 150.0(K)1A, LUMINAIRES PROVIDING RESIDENTIAL OUTDOOR LIGHTING SHALL MEET THE FOLLOWING REQUIREMENTS, AS APPLICABLE:
 - FOR SINGLE-FAMILY RESIDENTIAL BUILDINGS, OUTDOOR LIGHTING PERMANENTLY MOUNTED TO A RESIDENTIAL BUILDING OR TO OTHER BUILDINGS ON THE SAME LOT SHALL MEET THE REQUIREMENT IN ITEM I AND THE REQUIREMENTS IN EITHER ITEM I OR ITEM II:
 - CONTROLLED BY A MANUAL ON AND OFF CONTROL SWITCH THAT PERMITS THE AUTOMATIC ACTIONS OF ITEMS II OR III BELOW, AND
 - CONTROLLED BY A PHOTOCELL AND EITHER A MOTION SENSOR OR AN AUTOMATIC TIME SWITCH CONTROL, OR
 - CONTROLLED BY AN ASTRONOMICAL TIME CLOCK CONTROL.
 - NOTE: CONTROLS THAT OVERRIDE TO ON SHALL NOT BE ALLOWED UNLESS THE OVERRIDE AUTOMATICALLY RETURNS THE AUTOMATIC CONTROL TO ITS NORMAL OPERATION WITHIN 6 HOURS. AN ENERGY MANAGEMENT CONTROL SYSTEM THAT PROVIDES THE SPECIFIED LIGHTING CONTROL FUNCTIONALITY AND COMPLIES WITH ALL REQUIREMENTS APPLICABLE TO THE SPECIFIED CONTROLS MAY BE USED TO MEET THESE REQUIREMENTS.

- ALL JOINTS, PENETRATIONS AND OTHER OPENINGS IN THE BUILDING ENVELOPE THAT ARE POTENTIAL SOURCES OF AIR LEAKAGE SHALL BE CAULKED, GASKETED, WEATHER-STRIPPED OR OTHERWISE SEALED TO LIMIT INFILTRATION AND EXFILTRATION (2022 Cenc 110.7).
- ATTIC ACCESS DOORS SHALL HAVE PERMANENTLY ATTACHED INSULATION USING ADHESIVE OR MECHANICAL FASTENERS. THE ATTIC ACCESS SHALL BE GASKETED TO PREVENT AIR LEAKAGE (2022 Cenc 150.0(a)(2)

PLUMBING NOTES

- CONFORM WITH CURRENT CPC AND LOCAL REQUIREMENTS.
- DOMESTIC WATER (WITHIN BUILDING): COPPER OR PEX PIPE OR APPROVED EQUAL.
- AIR CHAMBERS: 12" LONG CAPPED NIPPLE AT END OF EACH BRANCH TO EACH FIXTURE.
- IELECTRIC UNIONS "F.P.C.O." REQUIREMENT AT ALL DISSIMILAR MATERIAL CONNECTIONS.
- WHEN "OPTIONAL" SOFT-WATER LOOP INTALLED, PROVIDE WITH 2 GATE VALVES.
- WATER SERVICE PIPE SHALL BE PER CIVIL PLANS OR AS REQUIRED BY THE JURISDICTION.
- WATER METER: PER WATER DISTRICT (REFER SIZE W/ FIRE SPRINKLER PLANS IF APPLICABLE).
- SHOWER HEADS AND FAUCETS: FLOW RATES PER 2022 CGBSC SECTION 4.303.
- WATER HEATER** (REFER TO BUILDING ENERGY ANALYSIS REPORT):
 - ALL DOMESTIC HOT WATER PIPING SHALL BE INSULATED. (2022 CPC 609.12)
 - PIPES UP TO 2 INCHES IN DIAMETER: INSULATION WALL THICKNESS NOT LESS THAN DIAMETER OF PIPE. (2022 CPC 609.12.2)
 - PIPES GREATER THAN 2 INCHES IN DIAMETER: INSULATION WALL THICKNESS NOT LESS THAN 2 INCHES. (2022 CPC 609.12.2)
 - EXCEPTIONS:**
 - PIPING THAT PENETRATES FRAMING MEMBERS SHALL NOT BE REQUIRED TO HAVE PIPE INSULATION FOR THE DISTANCE OF THE FRAMING PENETRATION. (2022 CPC 609.12.2)
 - HOT WATER PIPING BETWEEN THE FIXTURE CONTROL VALVE OR SUPPLY STOP AND THE FIXTURE OR APPLIANCE SHALL NOT BE REQUIRED TO BE INSULATED. (2022 CPC 609.12.2)
- IN BATHROOMS, GARAGES, LAUNDRY ROOMS, UTILITY ROOMS AND WALK-IN CLOSETS, AT LEAST ONE INSTALLED LUMINAIRE SHALL BE CONTROLLED BY AN OCCUPANCY OR VACANCY SENSOR PROVIDING AUTOMATIC-OFF FUNCTIONALITY.
- FOR LIGHTING INTERNAL TO DRAWERS AND CABINETS WITH OPAQUE FRONTS OR DOORS, CONTROLS THAT TURN THE LIGHT OFF WHEN THE DRAWER OR DOOR IS CLOSED SHALL BE PROVIDED.
- DIMMING CONTROLS.** LIGHTING IN HABITABLE SPACES, INCLUDING BUT NOT LIMITED TO LIVING ROOMS, DINING ROOMS, KITCHENS AND BEDROOMS, SHALL HAVE READILY ACCESSIBLE WALL-MOUNTED DIMMING CONTROLS THAT ALLOW THE LIGHTING TO BE MANUALLY ADJUSTED UP AND DOWN, FORWARD PHASE CUT DIMMERS CONTROLLING LED LIGHT SOURCES IN THESE SPACES SHALL COMPLY WITH NEMA SSL 7A.
EXCEPT: CEILING FANS MAY PROVIDE CONTROL OF INTEGRATED LIGHTING VIA A REMOTE CONTROL. LUMINAIRES CONNECTED TO A CIRCUIT WITH CONTROLLED LIGHTING POWER LESS THAN 20 WATTS OR CONTROLLED BY AN OCCUPANCY OR VACANCY SENSOR PROVIDING AUTOMATIC-OFF FUNCTIONALITY, NAVIGATION LIGHTING SUCH AS NIGHT LIGHTS, STEP LIGHTS, AND PATH LIGHTS LESS THAN 5 WATTS, AND LIGHTING INTERNAL TO DRAWERS AND CABINETS WITH OPAQUE FRONTS OR DOORS OR WITH AUTOMATIC-OFF CONTROLS.
- INDEPENDENT CONTROLS.** INTEGRATED LIGHTING OF EXHAUST FANS SHALL BE CONTROLLED INDEPENDENTLY FROM THE FANS. THE FOLLOWING SHALL BE CONTROLLED SEPARATELY FROM CEILING-INSTALLED LIGHTING SUCH THAT ONE CAN BE TURNED ON WITHOUT TURNING ON THE OTHER:
 - UNDERCABINET LIGHTING, UNDERSHELF LIGHTING, INTERIOR LIGHTING OF DISPLAY CABINETS, AND SWITCHED OUTLETS.
- RESIDENTIAL OUTDOOR LIGHTING** (2022 Cenc 150.0(k)(3). IN ADDITION TO MEETING THE REQUIREMENTS OF SECTION 150.0(K)1A, LUMINAIRES PROVIDING RESIDENTIAL OUTDOOR LIGHTING SHALL MEET THE FOLLOWING REQUIREMENTS, AS APPLICABLE:
 - FOR SINGLE-FAMILY RESIDENTIAL BUILDINGS, OUTDOOR LIGHTING PERMANENTLY MOUNTED TO A RESIDENTIAL BUILDING OR TO OTHER BUILDINGS ON THE SAME LOT SHALL MEET THE REQUIREMENT IN ITEM I AND THE REQUIREMENTS IN EITHER ITEM I OR ITEM II:
 - CONTROLLED BY A MANUAL ON AND OFF CONTROL SWITCH THAT PERMITS THE AUTOMATIC ACTIONS OF ITEMS II OR III BELOW, AND
 - CONTROLLED BY A PHOTOCELL AND EITHER A MOTION SENSOR OR AN AUTOMATIC TIME SWITCH CONTROL, OR
 - CONTROLLED BY AN ASTRONOMICAL TIME CLOCK CONTROL.
 - NOTE: CONTROLS THAT OVERRIDE TO ON SHALL NOT BE ALLOWED UNLESS THE OVERRIDE AUTOMATICALLY RETURNS THE AUTOMATIC CONTROL TO ITS NORMAL OPERATION WITHIN 6 HOURS. AN ENERGY MANAGEMENT CONTROL SYSTEM THAT PROVIDES THE SPECIFIED LIGHTING CONTROL FUNCTIONALITY AND COMPLIES WITH ALL REQUIREMENTS APPLICABLE TO THE SPECIFIED CONTROLS MAY BE USED TO MEET THESE REQUIREMENTS.

- ALL JOINTS, PENETRATIONS AND OTHER OPENINGS IN THE BUILDING ENVELOPE THAT ARE POTENTIAL SOURCES OF AIR LEAKAGE SHALL BE CAULKED, GASKETED, WEATHER-STRIPPED OR OTHERWISE SEALED TO LIMIT INFILTRATION AND EXFILTRATION (2022 Cenc 110.7).
- ATTIC ACCESS DOORS SHALL HAVE PERMANENTLY ATTACHED INSULATION USING ADHESIVE OR MECHANICAL FASTENERS. THE ATTIC ACCESS SHALL BE GASKETED TO PREVENT AIR LEAKAGE (2022 Cenc 150.0(a)(2)

GENERAL NOTES

- APPLICABLE CODES AND STANDARDS:
 - 2022 CALIFORNIA BUILDING CODE AND ITS APPENDICES AND STANDARDS.
 - 2022 CALIFORNIA PLUMBING CODE AND ITS APPENDICES AND STANDARDS.
 - 2022 CALIFORNIA MECHANICAL CODE AND ITS APPENDICES AND STANDARDS.
 - 2022 CALIFORNIA FIRE CODE AND ITS APPENDICES AND STANDARDS.
 - 2022 CALIFORNIA ELECTRICAL CODE AND ITS APPENDICES AND STANDARDS.
 - 2022 CALIFORNIA BUILDING ENERGY EFFICIENCY STANDARDS.
 - 2022 CALIFORNIA GREEN BUILDING STANDARDS CODE AND ITS APPENDICES AND STANDARDS.
 - 2022 CALIFORNIA RESIDENTIAL CODE AND ITS APPENDICES AND STANDARDS
 - CURRENT CITY OF COACHELLA, CA MUNICIPAL CODE.
 - ALL WORK DESCRIBED IN THE DRAWINGS SHALL BE VERIFIED FOR DIMENSION, GRADE, EXTENT AND COMPATIBILITY WITH EXISTING SITE CONDITIONS. ANY DISCREPANCIES AND UNEXPECTED CONDITIONS THAT AFFECT OR CHANGE THE WORK DESCRIBED IN THE CONTRACT DOCUMENTS SHALL BE BROUGHT TO THE ARCHITECT'S ATTENTION IMMEDIATELY. DO NOT PROCEED WITH THE WORK IN THE AREA OF DISCREPANCIES UNTIL ALL SUCH DISCREPANCIES ARE RESOLVED. IF THE CONTRACTOR CHOOSES TO DO SO, HE/SHE SHALL BE PROCEEDING AT HIS/HER OWN RISK.
 - DIMENSIONS SHOWN SHALL TAKE PRECEDENCE OVER DRAWING SCALE OR PROPORTION. LARGER SCALE DRAWINGS SHALL TAKE PRECEDENCE OVER SMALLER SCALE DRAWINGS.
 - IN THE EVENT OF THE UNFORESEEN ENCOUNTER OF MATERIALS SUSPECTED TO BE OF AN ARCHAEOLOGICAL OR PALEONTOLOGICAL NATURE, ALL GRADING AND EXCAVATION SHALL CEASE IN THE IMMEDIATE AREA AND THE THE CONTRACTOR SHALL NOTIFY THE OWNER. THE FIND SHALL BE LEFT UNTOUCHED UNTIL AN EVALUATION BY A QUALIFIED ARCHAEOLOGIST OR PALEONTOLOGIST IS MADE.
 - CONTRACTOR IS TO BE RESPONSIBLE FOR BEING FAMILIAR WITH THESE DOCUMENTS INCLUDING ALL CONTRACT REQUIREMENTS.
 - GRADING PLANS, DRAINAGE IMPROVEMENTS, ROAD AND ACCESS REQUIREMENTS AND ENVIRONMENTAL HEALTH CONSIDERATIONS SHALL COMPLY WITH ALL LOCAL ORDINANCES.
 - THE FOLLOWING ITEMS SHOWDRAWINGS ARE OWNER PROVIDED, OWNER INSTALLED. UTILITIES PROVIDED FOR THESE ITEMS WILL BE PROVIDED BY THE CONTRACTOR. CONTRACTOR TO COORDINATE INSTALLATION WITH OWNER.
 - TV/DVD SYSTEMS
 - ICE MACHINE
 - VENDING MACHINE
 - REFRIGERATOR
 - MICROWAVE
 - OSHA PERMITS REQUIRED FOR VERTICAL CUTS 5' OR OVER.
 - CONTRACTOR TO PROVIDE COMPLETE DETAILS OF ENGINEERED TEMPORARY SHORING OR SLO CUTTING PROCEDURES ON PLANS. CALL FOR INSPECTION BEFORE EXCAVATION BEGINS.
 - CONTRACTOR TO REVIEW CALIFORNIA GREEN CODE REQUIREMENTS FOR CONTRACTOR REQUIREMENTS.
 - A SEPARATE OFFICER, ACCESS EASEMENT/AGREEMENT, AND/OR RECIPROCAL ACCESS EASEMENT/AGREEMENT MAY BE AGREED TO INSURE THAT THE PROPOSED ACCESS ROADWAY WILL REMAIN OPEN TO THROUGH TRAFFIC AND EMERGENCY VEHICLES PRIOR TO FINAL OF BUILDING PERMIT.
 - OWNER TO PROVIDE LOCATION OF THE NEAREST FIRE HYDRANT. FIRE HYDRANT LOCAION SHALL MEET THE REQUIREMENTS IN THE CFC.
 - IF THE MAIN RESIDENCE HAS TWO EXISTING WATER CLOSETS, WITH THE INCLUSION OF THE ADDITIONAL WATER CLOSET IN THE ADU, THE EXISTING SEWER LATERAL SIZE IS TO BE VARIATED TO BE 4 INCHES PER CPC TABLE 703.2.

MECHANICAL NOTES

- CONFORM WITH CURRENT ADOPTED CRC, CMC, SMACNA, NFPA AND LOCAL REQUIREMENTS.
- DUCTWORK: SMACNA "LOW VELOCITY DUCT CONSTRUCTION" NFPA DUCTWORK: SMACNA TRANSVERSE DUCT PLENUM AND FITTING JOINTS SHALL BE SEALED WITH PRESSURE SENSITIVE NON-CLOTH TAPE MEETING THE REQUIREMENTS OF UL181, 181A, OR 181B, OR MASTIC TO PREVENT AIR LOSS. DUCTS SHALL BE INSULATED AS REQUIRED BY THE UMC. SEE FLOOR PLAN FOR F.A.U. AND FIREPLACES. DUCTS PENETRATING A WALL OR FLOOR/CEILING DURING GARAGE & DWELLING TO BE MINIMUM 26 GAUGE METAL WITHOUT OPENING IN GARAGE. FIRE DAMPER REQUIRED OTHERWISE.
- GRILLES AND REGISTERS, DIFFUSERS, ETC: SUBJECT TO OWNERS APPROVAL. "GARNES" OR EQUAL FANS; DIRECTLY VENTED TO OUTSIDE. BACK DRAFT DAMPERS ARE REQUIRED (PER TABLE 2-53V, TITLE 24 C.A.C.).
- LAUNDRY DRYER VENT TO EXTERIOR TO BE 14 FEET MAXIMUM, LESS 2 FEET PER 90 DEGREE TURN PER CMC 504.3.2.2. IF VENT IS OVER 14' AN APPROVED POWER ASSISTED DEVICE IS REQUIRED. DRYER EXHAUST DUCT POWER VENTILATORS SHALL BE LISTED AND LABELED IN ACCORDANCE WITH UL 705 AND INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS PER 2022 CMC, SECTION 504.2.2.3. SEE NOTE BELOW.
- BATHROOM EXHAUST FANS (BATHROOM APPLIES TO ROOMS CONTAINING BATHTUB, SHOWER, OR TUB/SHOWER COMBINATION) WHICH EXHAUST DIRECTLY FROM BATHROOMS SHALL COMPLY WITH THE FOLLOWING (2022 CGBSC SEC. 606)
 - FANS SHALL BE ENERGY STAR COMPLIANT AND BE DUCTED TO TERMINATE OUTSIDE THE BUILDING MIN 3" FROM OPENINGS.
 - UNLESS FUNCTIONING AS A COMPONENT OF A WHOLE-HOUSE VENTILATION SYSTEM, FANS MUST BE CONTROLLED BY A HUMIDITY CONTROL.
 - HUMIDITY CONTROLS SHALL BE CAPABLE OF ADJUSTMENT BETWEEN A RELATIVE HUMIDITY RANGE OF ≤ 50 PERCENT TO A MAXIMUM OF 80 PERCENT. A HUMIDITY CONTROL MAY UTILIZE MANUAL OR AUTOMATIC MEANS OF ADJUSTMENT.
 - A HUMIDITY CONTROL MAY BE A SEPARATE COMPONENT TO EXHAUST FAN AND IS NOT REQUIRED TO BE INTEGRAL(I.E. BUILT IN)
- BATHROOM EXHAUST FANS SHALL PROVIDE MINIMUM 50 CFM EXHAUST RATE (2022 CMC TABLE 403.7).
- KITCHEN EXHAUST FANS SHALL PROVIDE MINIMUM 100 CFM EXHAUST RATE (2022 CMC TABLE 403.7)

WINDOWS

- HABITABLE ROOMS SHALL HAVE AN AGGREGATE GLAZING AREA OF NOT LESS THAN 8 PERCENT OF THE FLOOR AREA OF SUCH ROOMS. NATURAL VENTILATION SHALL BE THROUGH WINDOWS, SKYLIGHTS, DOORS, LOUVERS OR OTHER APPROVED OPENINGS TO THE OUTDOOR AIR. SUCH OPENINGS SHALL BE PROVIDED WITH READY ACCESS OR SHALL OTHERWISE BE READILY CONTROLLABLE BY THE BUILDING OCCUPANTS. THE OPENABLE AREA TO THE OUTDOORS SHALL BE NOT LESS THAN 4 PERCENT OF THE FLOOR AREA BEING VENTILATED.
- GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL THAT MEETS ALL OF THE FOLLOWING CONDITIONS SHALL BE CONSIDERED TO BE A HAZARDOUS LOCATION:
 - THE EXPOSED AREA OF AN INDIVIDUAL PANE IS LARGER THAN 9 SQUARE FEET
 - THE BOTTOM EDGE OF THE GLAZING IS LESS THAN 18 INCHES (457 MM) ABOVE THE FLOOR.
 - THE TOP EDGE OF THE GLAZING IS MORE THAN 36 INCHES (914 MM) ABOVE THE FLOOR.
 - ONE OR MORE WALKING SURFACES ARE WITHIN 36 INCHES (914 MM), MEASURED HORIZONTALLY AND IN A STRAIGHT LINE, OF THE GLAZING.



THESE PLANS ARE PROVIDED BY THE CITY OF AGOURA HILLS AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILED AS-BUILT INSPECTIONS. WE WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

PROTOTYPE ADU
2 CAR GARAGE COVERSION
COACHELLA, CA

GENERAL NOTES

PUBLIC SET

DATE
01/11/24
SHEET

G-102

1/19/2024 8:55:08 AM
Autodesk Docs/22939-01_Coachella ADUs_Garage Unit.rvt

BUILDING ENERGY ANALYSIS REPORT

PROJECT:
Coachella ADUs (Plan 6-Conversion)
Coachella, CA

Project Designer:
PRM Design Group
3765 South Figueroa St. Suite 102
San Luis Obispo, CA 93401
(805) 543-1794

Report Prepared by:
Timothy Carstairs, CEA, HERS, GPR
Carstairs Energy Inc.
2238 Bayview Heights Drive, Suite E
Los Osos, CA 93402
805-904-9048



Job Number:
23-082810
Date:
8/28/2023

The EnergyPro computer program has been used to perform the calculations summarized in this compliance report. This program has approval and is authorized by the California Energy Commission for use with both the Residential and Nonresidential 2022 Building Energy Efficiency Standards. This program developed by EnergySoft, LLC - www.energysoft.com.

TABLE OF CONTENTS

1	Cover Page
2	Table of Contents
3	Form CF1R-PRF-01-E Certificate of Compliance
12	Form RMS-1 Residential Measures Summary
13	Form MF1R Mandatory Measures Summary
18	Room Load Summary

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Coachella ADUs (Plan 6-Conversion)
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-08-28T10:22:43-07:00
Input File Name: Coachella ADUs (Plan 6-Conversion).ribd22x

CF1R-PRF-01E
(Page 2 of 9)

COMPLIANCE RESULTS	
01	Building Complies with Computer Performance
02	This building incorporates features that require field testing and/or verification by a certified HERS rater under the supervision of a CEC-approved HERS provider.
03	This building incorporates one or more Special Features shown below

Registration Number: 223-P010107538A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-08-28 11:08:50
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
Report Generated: 2023-08-28 10:23:01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Coachella ADUs (Plan 6-Conversion)
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-08-28T10:22:43-07:00
Input File Name: Coachella ADUs (Plan 6-Conversion).ribd22x

CF1R-PRF-01E
(Page 5 of 9)

OPAQUE SURFACES										
01	02	03	04	05	06	07	08	09	10	
Name	Zone	Construction	Azimuth	Orientation	Gross Area (ft ²)	Window and Door Area (ft ²)	Tilt (deg)	Wall Exceptions	Status	
Front Wall	Living Area	R15 Wall	0	Front	168	56	90	Ex. w/ Sliding	New	
Left Wall	Living Area	R15 Wall	90	Left	168	0	90	Ex. w/ Sliding	New	
Rear Wall	Living Area	R15 Wall	180	Back	168	0	90	Ex. w/ Sliding	New	
Right Wall	Living Area	R15 Wall	270	Right	168	0	90	Ex. w/ Sliding	New	
Roof	Living Area	R-30 Roof Attic	n/a	n/a	441	n/a	n/a		New	

ATTIC							
01	02	03	04	05	06	07	08
Name	Construction	Type	Roof Rise (x in 12)	Roof Reflectance	Roof Emittance	Radiant Barrier	Cool Roof
Attic Living Area	Attic Roof/Living Area	Ventilated	4	0.1	0.85	No	No

FENESTRATION / GLAZING													
01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Type	Surface	Orientation	Azimuth	Width (ft)	Height (ft)	Mult.	Area (ft ²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading
2	Window	Front Wall	Front	0			1	18	0.3	NFRC	0.23	NFRC	Bug Screen
3	Window	Front Wall	Front	0			1	18	0.3	NFRC	0.23	NFRC	Bug Screen

OPAQUE DOORS			
01	02	03	04
Name	Side of Building	Area (ft ²)	U-factor
D2	Front Wall	20	0.2

Registration Number: 223-P010107538A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-08-28 11:08:50
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
Report Generated: 2023-08-28 10:23:01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Coachella ADUs (Plan 6-Conversion)
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-08-28T10:22:43-07:00
Input File Name: Coachella ADUs (Plan 6-Conversion).ribd22x

CF1R-PRF-01E
(Page 3 of 9)

ENERGY USE SUMMARY						
Energy Use	Standard Design Source Energy (EDR1) (kbtu/ft ² -yr)	Standard Design TDV Energy (EDR2) (kTDV/ft ² -yr)	Proposed Design Source Energy (EDR1) (kbtu/ft ² -yr)	Proposed Design TDV Energy (EDR2) (kTDV/ft ² -yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)
Space Heating	0	0.59	0	1.56	0	-0.97
Space Cooling	0	113.38	0	94.46	0	18.92
IAQ Ventilation	0	5.2	0	5.2	0	0
Water Heating	0	159.68	0	159.68	0	0
Self Utilization/Flexibility Credit						
Efficiency Compliance Total	0	278.85	0	260.9	0	17.95
Photovoltaics	0		0			
Battery				0		
Flexibility						
Indoor Lighting	0	7.33	0	7.33		
Appl. & Cooking	0	91.89	0	91.68		
Plug Loads	0	82.93	0	82.93		
Outdoor Lighting	0	5.55		5.55		
TOTAL COMPLIANCE	0	466.55	0	448.39		

Registration Number: 223-P010107538A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-08-28 11:08:50
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
Report Generated: 2023-08-28 10:23:01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Coachella ADUs (Plan 6-Conversion)
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-08-28T10:22:43-07:00
Input File Name: Coachella ADUs (Plan 6-Conversion).ribd22x

CF1R-PRF-01E
(Page 6 of 9)

SLAB FLOORS							
01	02	03	04	05	06	07	08
Name	Zone	Area (ft ²)	Perimeter (ft)	Edge Insul. R-value and Depth	Edge Insul. R-value and Depth	Carpeted Fraction	Heated
Slab	Living Area	441	84	none	0	80%	No

OPAQUE SURFACE CONSTRUCTIONS							
01	02	03	04	05	06	07	08
Construction Name	Surface Type	Construction Type	Framing	Total Cavity R-value	Interior / Exterior Continuous R-value	U-factor	Assembly Layers
R15 Wall	Exterior Walls	Wood Framed Wall	2x4 @ 16 in. O. C.	R-15	None / None	0.095	Inside Finish: Gypsum Board Cavity / Frame: R-15 / 2x4 Exterior Finish: 3 Coat Stucco
Attic Roof/Living Area	Attic Roofs	Wood Framed Ceiling	2x4 @ 24 in. O. C.	R-0	None / 0	0.644	Roofing: Light Roof (Asphalt Shingle) Roof Deck: Wood Siding/sheathing/decking Cavity / Frame: no insul. / 2x4
R-30 Roof Attic	Ceilings (below attic)	Wood Framed Ceiling	2x4 @ 24 in. O. C.	R-30	None / None	0.032	Over Ceiling Joists: R-30.3 Insul. Cavity / Frame: R-9.1 / 2x4 Inside Finish: Gypsum Board

BUILDING ENVELOPE - HERS VERIFICATION				
01	02	03	04	05
Quality Insulation Installation (QII)	High R-value Spray Foam Insulation	Building Envelope Air Leakage	CFM50	CFM50
Not Required	Not Required	N/A	n/a	n/a

Registration Number: 223-P010107538A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-08-28 11:08:50
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
Report Generated: 2023-08-28 10:23:01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Coachella ADUs (Plan 6-Conversion)
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-08-28T10:22:43-07:00
Input File Name: Coachella ADUs (Plan 6-Conversion).ribd22x

CF1R-PRF-01E
(Page 1 of 9)

GENERAL INFORMATION					
01	Project Name	Coachella ADUs (Plan 6-Conversion)			
02	Run Title	Title 24 Analysis			
03	Project Location				
04	City	Coachella	05	Standards Version	2022
06	Zip code		07	Software Version	EnergyPro 9.2
08	Climate Zone	15	09	Front Orientation (deg/ Cardinal)	0
10	Building Type	Single family	11	Number of Dwelling Units	1
12	Project Scope	Newly Constructed Addition	13	Number of Bedrooms	1
14	Addition Cond. Floor Area (ft ²)	441	15	Number of Stories	1
16	Existing Cond. Floor Area (ft ²)	3000	17	Fenestration Average U-factor	0.3
18	Total Cond. Floor Area (ft ²)	3441	19	Glazing Percentage (%)	8.16%
20	ADU Bedroom Count	1	21	ADU Conditioned Floor Area	441
22	Fuel Type	Propane	23	Occupancy U	No

ADDITION ALONE - Project Analysis Parameters					
01	02	03	04	05	06
Existing Area (excl. new addition) (ft2)	Addition Area (excl. existing) (ft2)	Total Area (ft2)	Existing Bedrooms	Addition Bedrooms	Total Bedrooms
1000	441	1441	0	1	1

ADDITION ALONE - ACCESSORY DWELLING UNIT (ADU) PROJECT ANALYSIS PARAMETERS							
01	02	03	04	05	06	07	08
Zone Name	Existing Area (excl. new addition) (ft ²)	ADU Area (excl. existing) (ft ²)	Total Area (ft ²)	Existing Bedrooms	Addition Bedrooms	Total Bedrooms	Attached vs. Detached
Living Area	1000	441	1441	0	1	1	Attached

Registration Number: 223-P010107538A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-08-28 11:08:50
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
Report Generated: 2023-08-28 10:23:01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Coachella ADUs (Plan 6-Conversion)
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-08-28T10:22:43-07:00
Input File Name: Coachella ADUs (Plan 6-Conversion).ribd22x

CF1R-PRF-01E
(Page 4 of 9)

ENERGY USE INTENSITY				
	Standard Design (kbtu/ft ² - yr)	Proposed Design (kbtu/ft ² - yr)	Compliance Margin (kbtu/ft ² - yr)	Margin Percentage
Gross EUI ¹	60.68	59.03	1.65	2.72
Net EUI ²	60.68	59.03	1.65	2.72
Notes 1. Gross EUI is Energy Use Total (not including PV) / Total Building Area. 2. Net EUI is Energy Use Total (including PV) / Total Building Area.				

REQUIRED SPECIAL FEATURES	
The following are features that must be installed as condition for meeting the modeled energy performance for this computer analysis.	
• Variable capacity heat pump compliance option (verification details from VCHP Staff report, Appendix B, and RA3)	

HERS FEATURE SUMMARY	
The following is a summary of the features that must be field-verified by a certified HERS Rater as a condition for meeting the modeled energy performance for this computer analysis. Additional detail is provided in the building tables below. Registered CF2Rs and CF3Rs are required to be completed in the HERS Registry	
• Indoor air quality ventilation • Kitchen range hood • Verified Refrigerant Charge • Airflow in habitable rooms (SC3.1.4.1.7) • Verified heat pump rated heating capacity • Wall-mounted thermostat in zones greater than 150 ft2 (SC3.4.5) • Ductless indoor units located entirely in conditioned space (SC3.1.4.1.8)	

ZONE INFORMATION						
01	02	03	04	05	06	07
Zone Name	Zone Type	HVAC System Name	Zone Floor Area (ft ²)	Avg. Ceiling Height	Water Heating System 1	Status
Living Area	Conditioned	HVAC System1	441	8	DHW Sys 1	New

Registration Number: 223-P010107538A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-08-28 11:08:50
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
Report Generated: 2023-08-28 10:23:01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Coachella ADUs (Plan 6-Conversion)
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-08-28T10:22:43-07:00
Input File Name: Coachella ADUs (Plan 6-Conversion).ribd22x

CF1R-PRF-01E
(Page 7 of 9)

WATER HEATING SYSTEMS								
01	02	03	04	05	06	07	08	09
Name	System Type	Distribution Type	Water Heater Name	Number of Units	Solar Heating System	Compact Distribution	HERS Verification	Water Heater Name (#)
DHW Sys 1	Domestic Hot Water (DHW)	Standard	DHW Heater 1	1	n/a	None	n/a	DHW Heater 1 (1)

WATER HEATERS												
01	02	03	04	05	06	07	08	09	10	11	12	13
Name	Heating Element Type	Tank Type	# of Units	Tank Vol. (gal)	Heating Efficiency Type	Efficiency	Rated Input Type	Input Rating or Pilot	Tank Insulation R-value (Int/Ext)	Standby Loss or Recovery Eff	1st Hr. Rating or Flow Rate	Tank Location
DHW Heater 1	Propane	Small Storage	1	50	EF	0.57	Btu/Hr	75000	0	78	n/a	

WATER HEATING - HERS VERIFICATION						
01	02	03	04	05	06	07
Name	Pipe Insulation	Parallel Piping	Compact Distribution	Compact Distribution Type	Recirculation Control	Shower Drain Water Heat Recovery
DHW Sys 1 - 1/1	Not Required	Not Required	Not Required	None	Not Required	Not Required

SPACE CONDITIONING SYSTEMS								
01	02	03	04	05	06	07	08	09
Name	System Type	Heating Unit Name	Heating Equipment Count	Cooling Unit Name	Cooling Equipment Count	Fan Name	Distribution Name	Required Thermostat Type
HVAC System1	Heat pump heating cooling	Heat Pump System 1	1	Heat Pump System 1	1	n/a	n/a	Setback

Registration Number: 223-P010107538A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-08-28 11:08:50
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
Report Generated: 2023-08-28 10:23:01



THESE PLANS ARE PROVIDED BY THE CITY OF AGOURA HILLS AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

PROTOTYPE ADU
2 CAR GARAGE CONVERSION
COACHELLA, CA

CERTIFICATE OF COMPLIANCE

SITE PLAN




NORTH ARROW

 PROPERTY LINE
 (E) FENCE

 SETBACK
 (E) WALLS/RETAINING WALLS

 EASTMENT

1. REFER TO GENERAL NOTES SHEET G-101 FOR ADDITIONAL REQUIREMENTS
2. REFER TO STRUCTURAL PLANS FOR FURTHER INFORMATION
3. EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL OPEN DIRECTLY INTO A PUBLIC WAY PER 2022 CRC, SECTION 310.1.
4. NOT LESS THAN 30" OF CLEARANCE IN WIDTH, DEPTH, & HEIGHT SHALL BE PROVIDED TO ACCESS EXTERIOR MECHANICAL EQUIPMENT. SHOW LOCATION ON SITE PLAN & LABEL. (2022 CMC SECTION 304.1 & 2022 CPC 504.3).

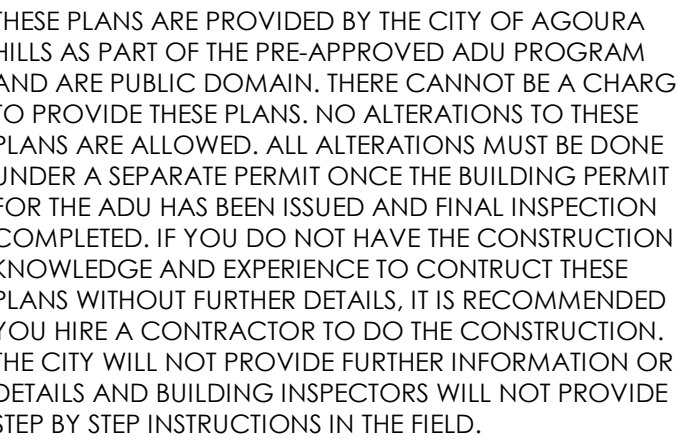

IF (N) ADU IS 5' - 0" OR LESS TO ANY PROPERTY LINE AND/OR ADU IS 10' - 0" OR LESS FROM ANY ADJACENT BUILDING OR STRUCTURE:

☐ NO ☐ YES; IF YES, FIRE RATED WALL & ROOF REQUIRED PER 2022 CBC, CHAPTER 2. SEE DETAILS: 52/A-901 & 32/A-903

ELECTRICAL PANEL: ☐ **OPTION 1 - NEW ELECTRICAL MAIN PANEL WITH 225 AMP MINIMUM BUSBAR RATING**

☐ **OPTION 2 - A NEW ELECTRICAL SUBPANEL CONNECTS TO THE ELECTRICAL MAIN PANEL OF THE PRIMARY HOME WITH A 225 AMP MINIMUM BUSBAR RATING. A SEPARATE ELECTRICAL PERMIT SHALL BE PULLED FOR THE ELECTRICAL MAIN PANEL OF THE PRIMARY HOME, ELECTRICAL LOAD CALCULATIONS IS REQUIRED.**

☐ **FOOTPRINT OF ALL EXISTING AND PROPOSED BUILDINGS**
PLOT THE PROPOSED ADU BUILDING FOOTPRINT ALONG WITH ANY OTHER EXISTING BUILDINGS ONSITE. THIS INCLUDES ALL STRUCTURES / PORCHES / GAZEBOS. IF AN OPTIONAL COVERED PATIO IS SELECTED, PLEASE PLOT THAT AS WELL.

☐ **AREA OF EXISTING BUILDING**
INDICATE THE SQUARE FOOTAGE OF THE EXISTING HOUSE

☐ **FOOTPRINT OF PROPOSED ADU**
REFER TO LEGEND FOR FOOTPRINT AT 10'=1" SCALE

☐ **DRAWING SCALE**
SITE PLAN SHOULD BE DRAWN TO A MEASURABLE SCALE.

☐ **PROPERTY LINES**
SHOW OUTLINE OF PROPERTY USING DASHED LINE IN LEGEND. INDICATE THE BEARING AND DISTANCE OF THE PROPERTY LINE.

☐ **LABEL YARDS**
 LABEL FRONT, REAR, SIDE YARDS, AS WELL AS DRIVEWAYS, PATHWAYS AND ANY
 OTHER HARDSCAPE.

SETBACKS
DIMENSION THE DISTANCE BETWEEN BUILDINGS AND PROPOERTY LINES, AS WELL AS BUILDINGS TO OTHER STRUCTURES. SETBACKS TO SIDE AND REAR PROPERTY SIDE SHALL BE A MINIMUM OF (4' - 0").

☐ **EASEMENTS**
REFER TO LEGEND. MUST INCLUDE ALL APPLICABLE EASEMENTS. PROPOSED STRUCTURE SHALL COMPLY WITH EASEMENT REQUIREMENTS.

☐ **LOCATION OF RAIN WATER LEADERS**
THE ROOF DRAINS SHOULD DRAIN AWAY FROM THE PROPERTY LINES AND INTO THE LANDSCAPE AREA.

LABEL STREETS & SIDEWALKS

☐ **DIMENSION BUILDING SEPARATION**
DIMENSION THE DISTANCE BETWEEN THE PROPOSED ADU AND ANY EXISTING STRUCTURES

☐ **LOT COVERAGE CALCULATION**
TOTAL FOOTPRINT AREA FOR STRUCTURES ON SITE / LOT AREA

☐ **SWIMMING POOLS**
ALL EXISTING SWIMMING POOLS SHALL BE SHOWN ON THE SITE PLAN AND SHALL HAVE 10' MINIMUM SETBACK TO THE NEW ADU STRUCTURE.


PORCHES
THERE SHALL BE NO MORE THAN 30 INCHES MEASURED VERTICALLY TO THE FLOOR OR GRADE BELOW (INCLUDING FLOORS, STAIRS, RAMPS, AND LANDINGS) ANYWHERE MEASURED LESS THAN 36 INCHES HORIZONTALLY TO THE EDGE OF THE PORCH/SLAB/SURFACE OF THE RAIL. INSECT SCREENING SHALL NOT BE CONSIDERED AS A GUARD.

☐ **LOCATION OF EXISTING UTILITIES**
UTILITIES, POLES, SEWER, DRAINS, ELECTRICAL, GAS METERS AND LINES AND ANY PHOTOVOLTAIC.

☐ **LOCATION OF PROPOSED UTILITIES**
PROPOSED UTILITIES SHALL CONFORM TO REQUIREMENTS OF CONTRA COSTA COUNTY SANITARY DISTRICT. SANITARY SEWER FROM ADU TO EXISTING SEWER. SEWER LINE TO THE PROPOSED ADU SHALL BE CONNECTED TO THE MAIN LATERAL AT THE PROPERTY LINE OR BEHIND THE SIDEWALK. LATERAL POINT OF CONNECTION INCLUDING REQUIRED CLEANOUTS. WATER LINE TO ADU. ELECTRIC TO ADU INCLUDING ANY NEW METERS OR SUBPANELS.

NOTE: THIS IS AN EXAMPLE SITE PLAN. EXACT LAYOUT, DIMENSIONS, AND BEARINGS SHALL BE PROVIDED BY OWNER/APPLICANT. (E) EXISTING (N) NEW

(E) STREET NAME

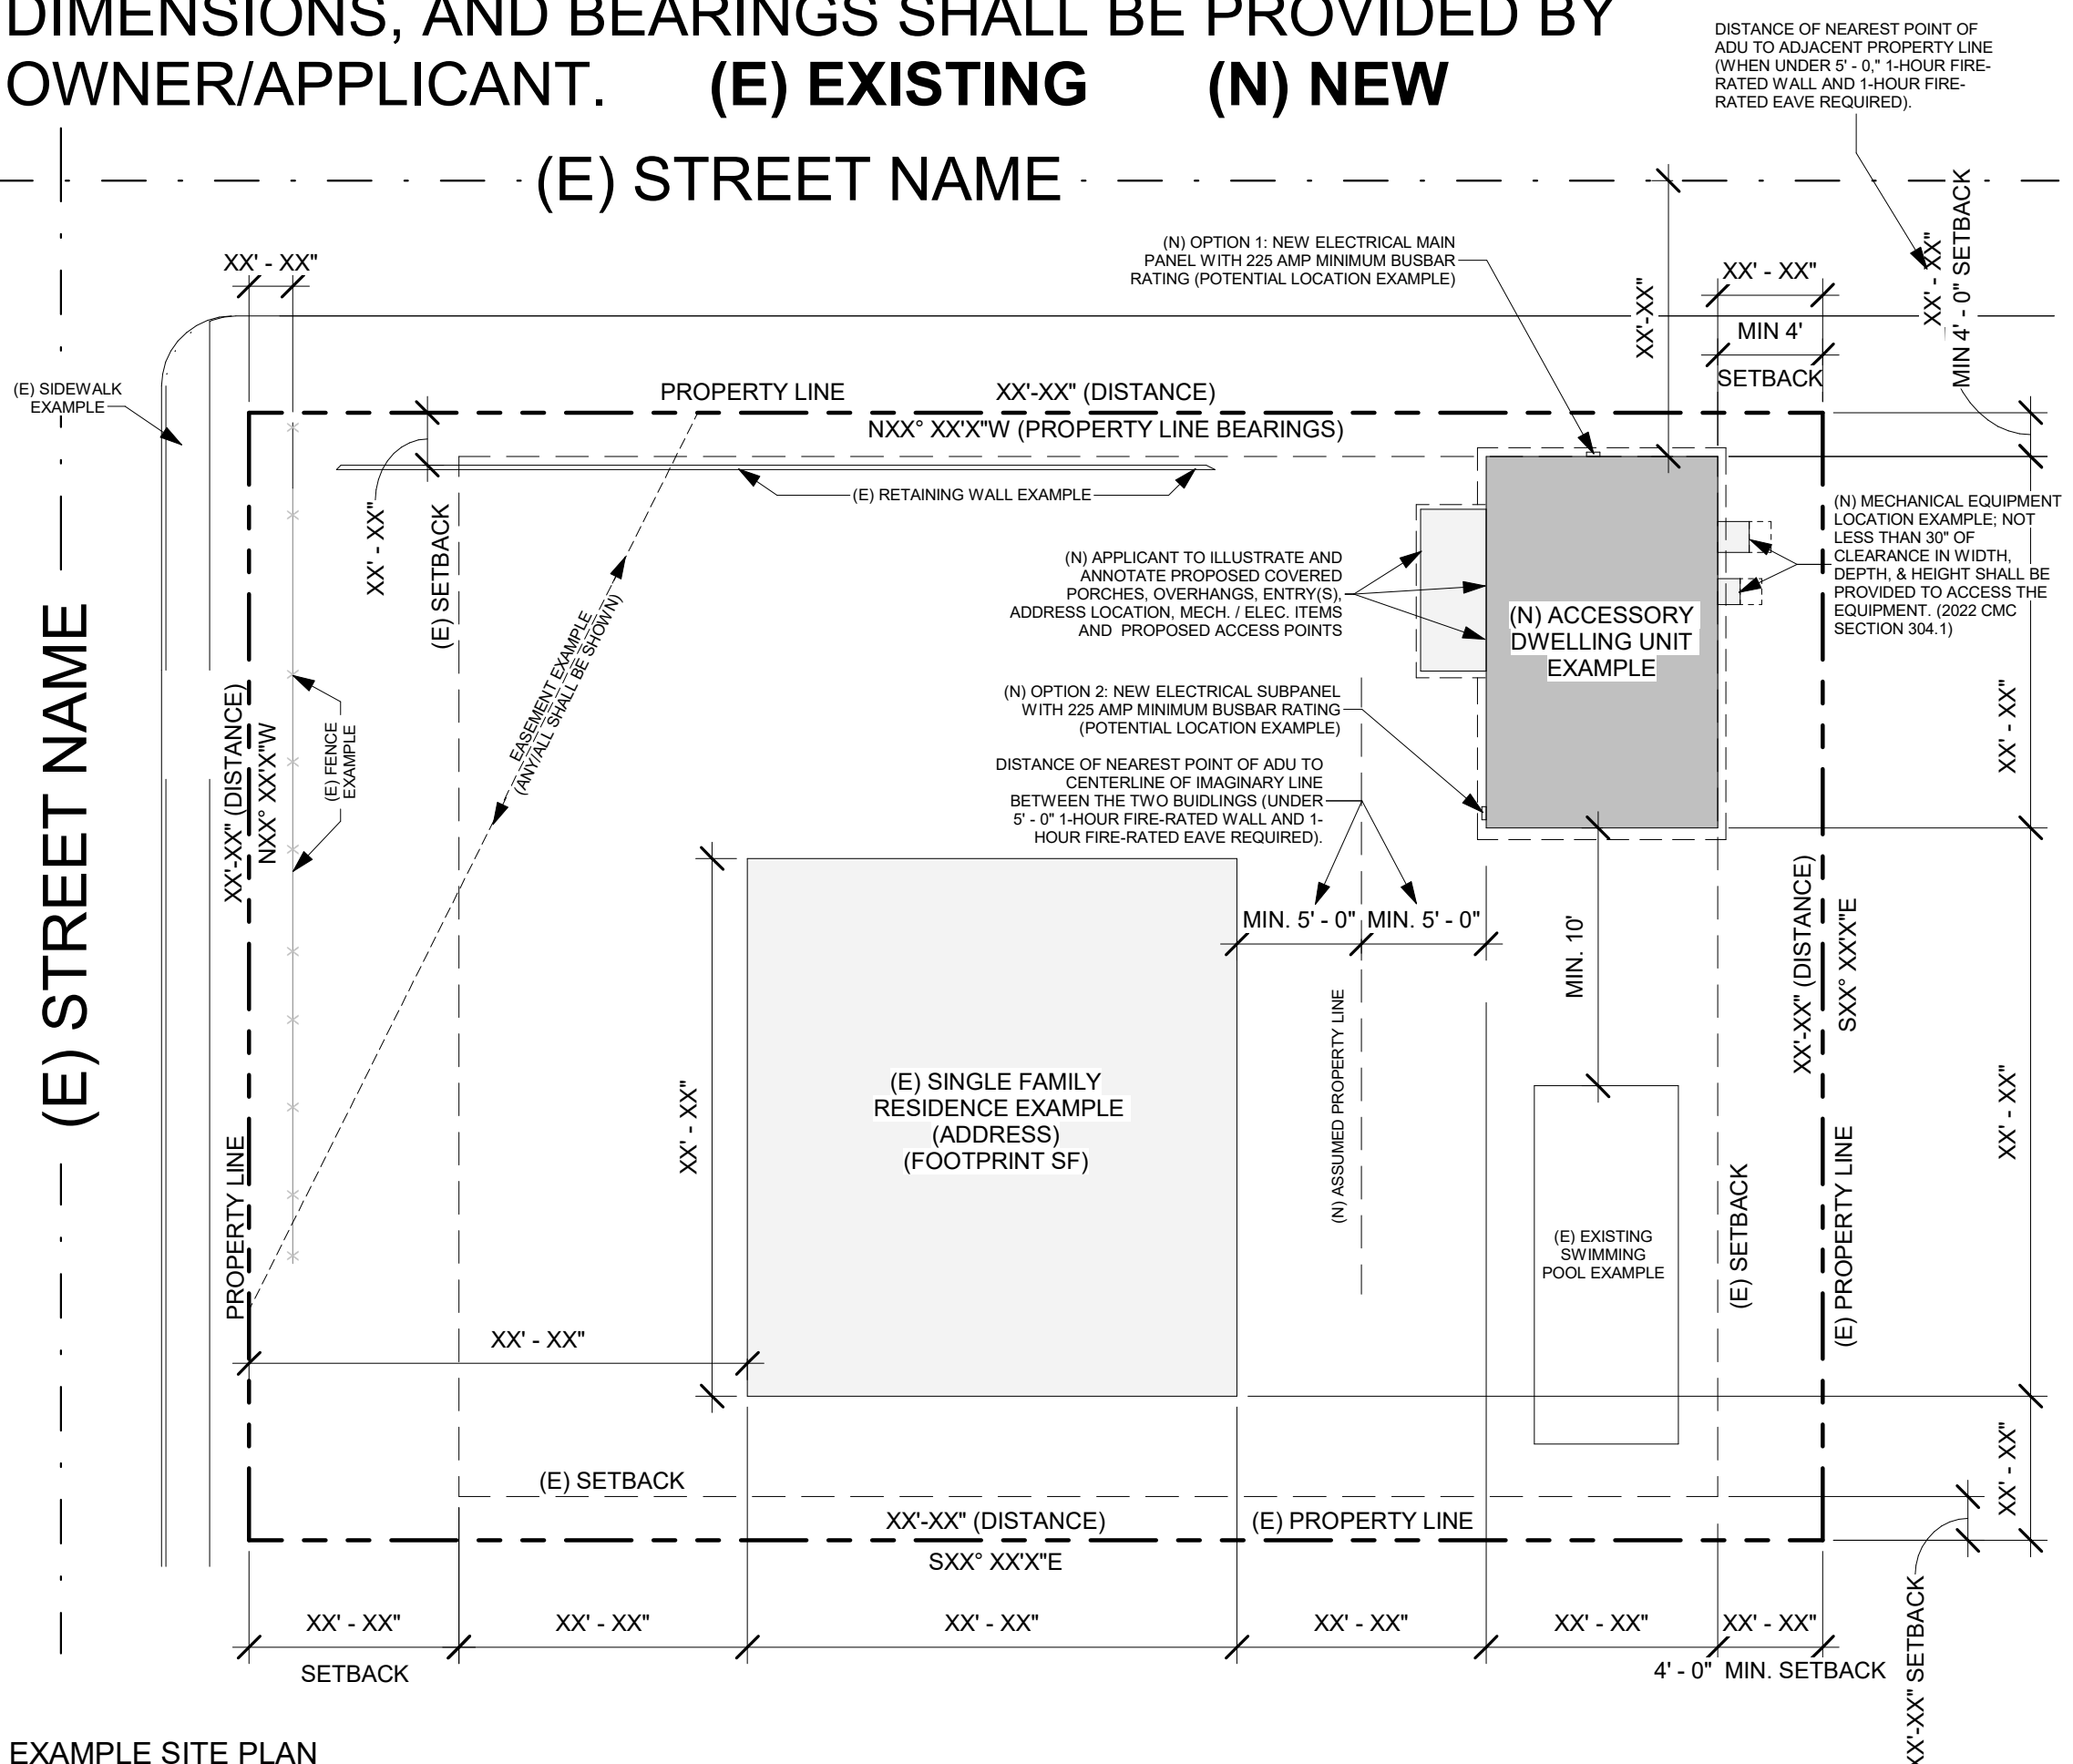


1 EXAMPLE SITE PLAN
1" = 20'-0"

DATE
01/11/24


SHEET

AS-100

PUBLIC SET

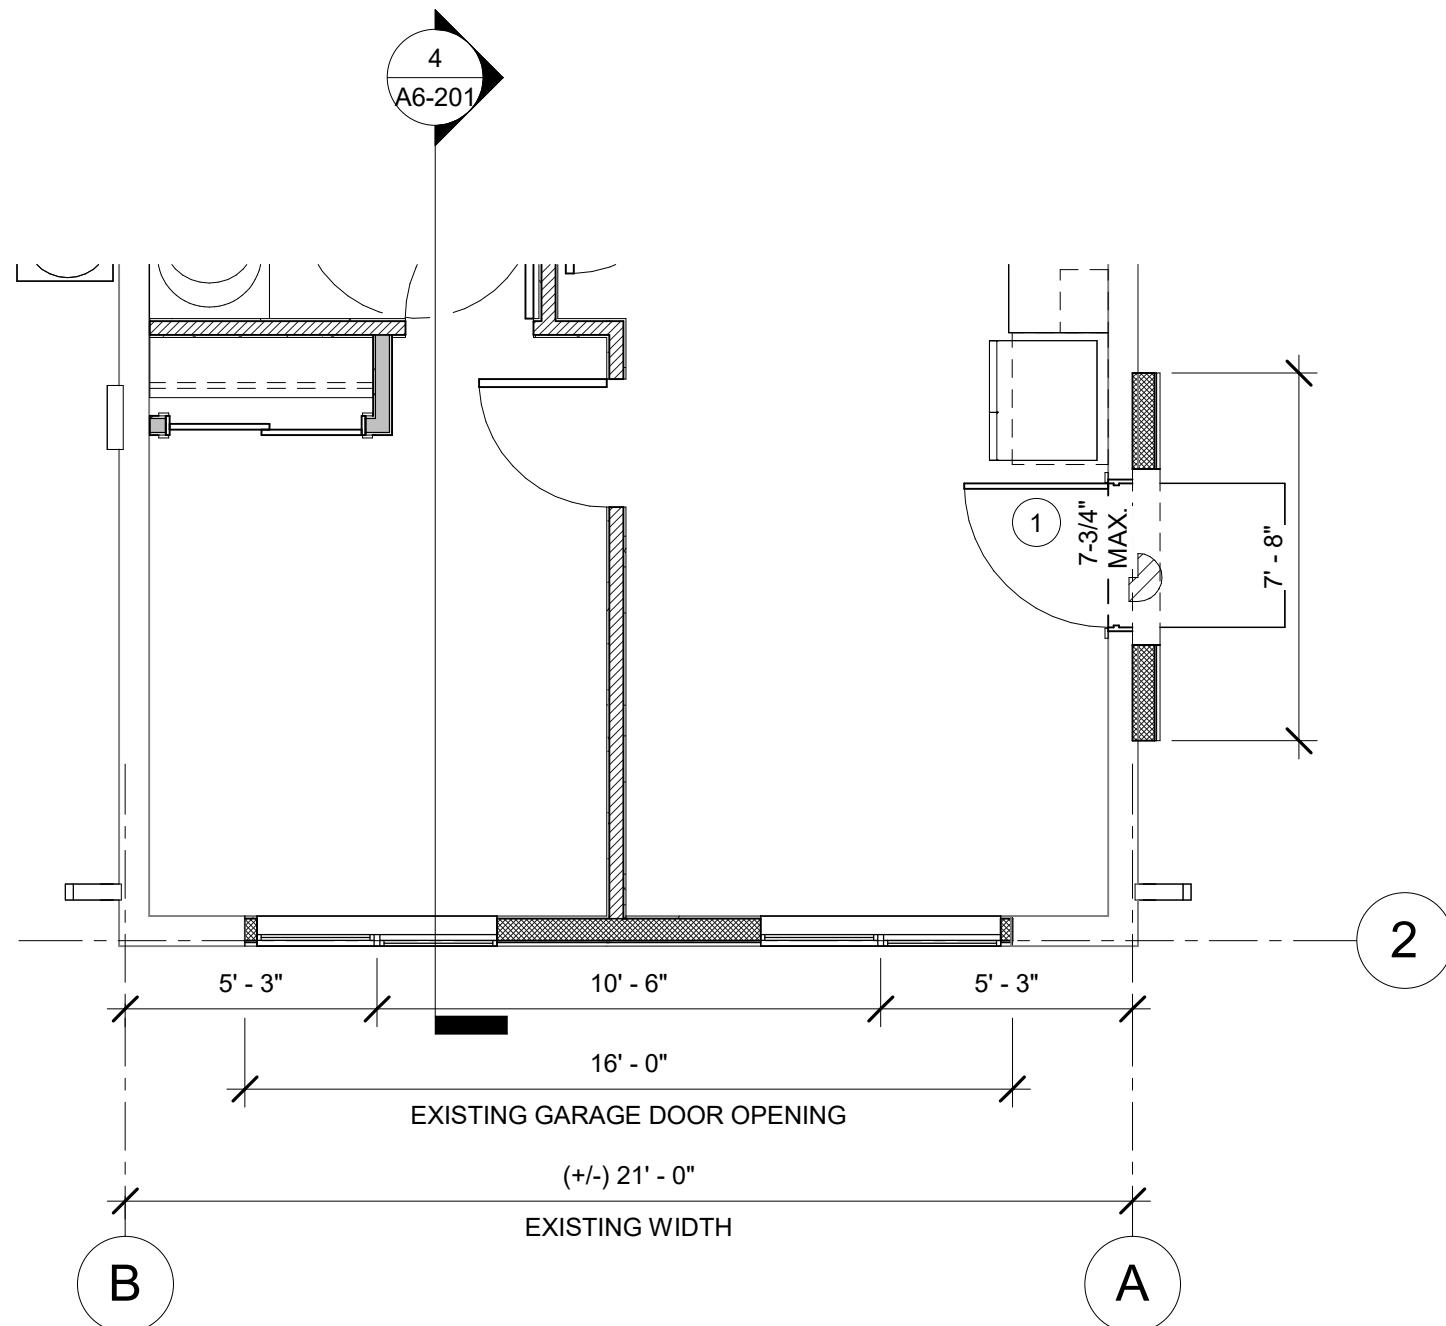


3 PARTIAL FLOOR PLAN - MISSION
A6-201 | A6-101 SCALE: 1/4" = 1'-0"

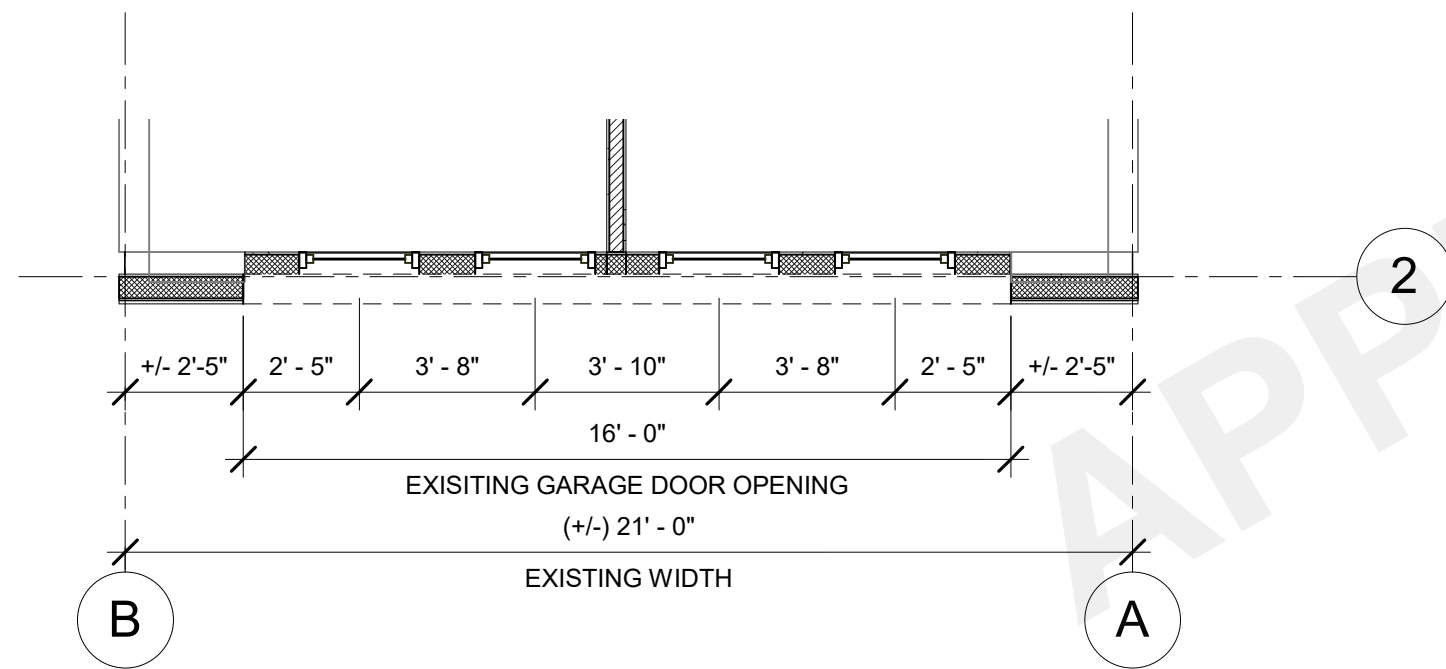

4 PARTIAL FLOOR PLAN - MODERN
A6-201 | A6-101 SCALE: 1/4" = 1'-0"

2 GROUND FLOOR RCP
A6-201 | A6-101 SCALE: 1/4" = 1'-0"

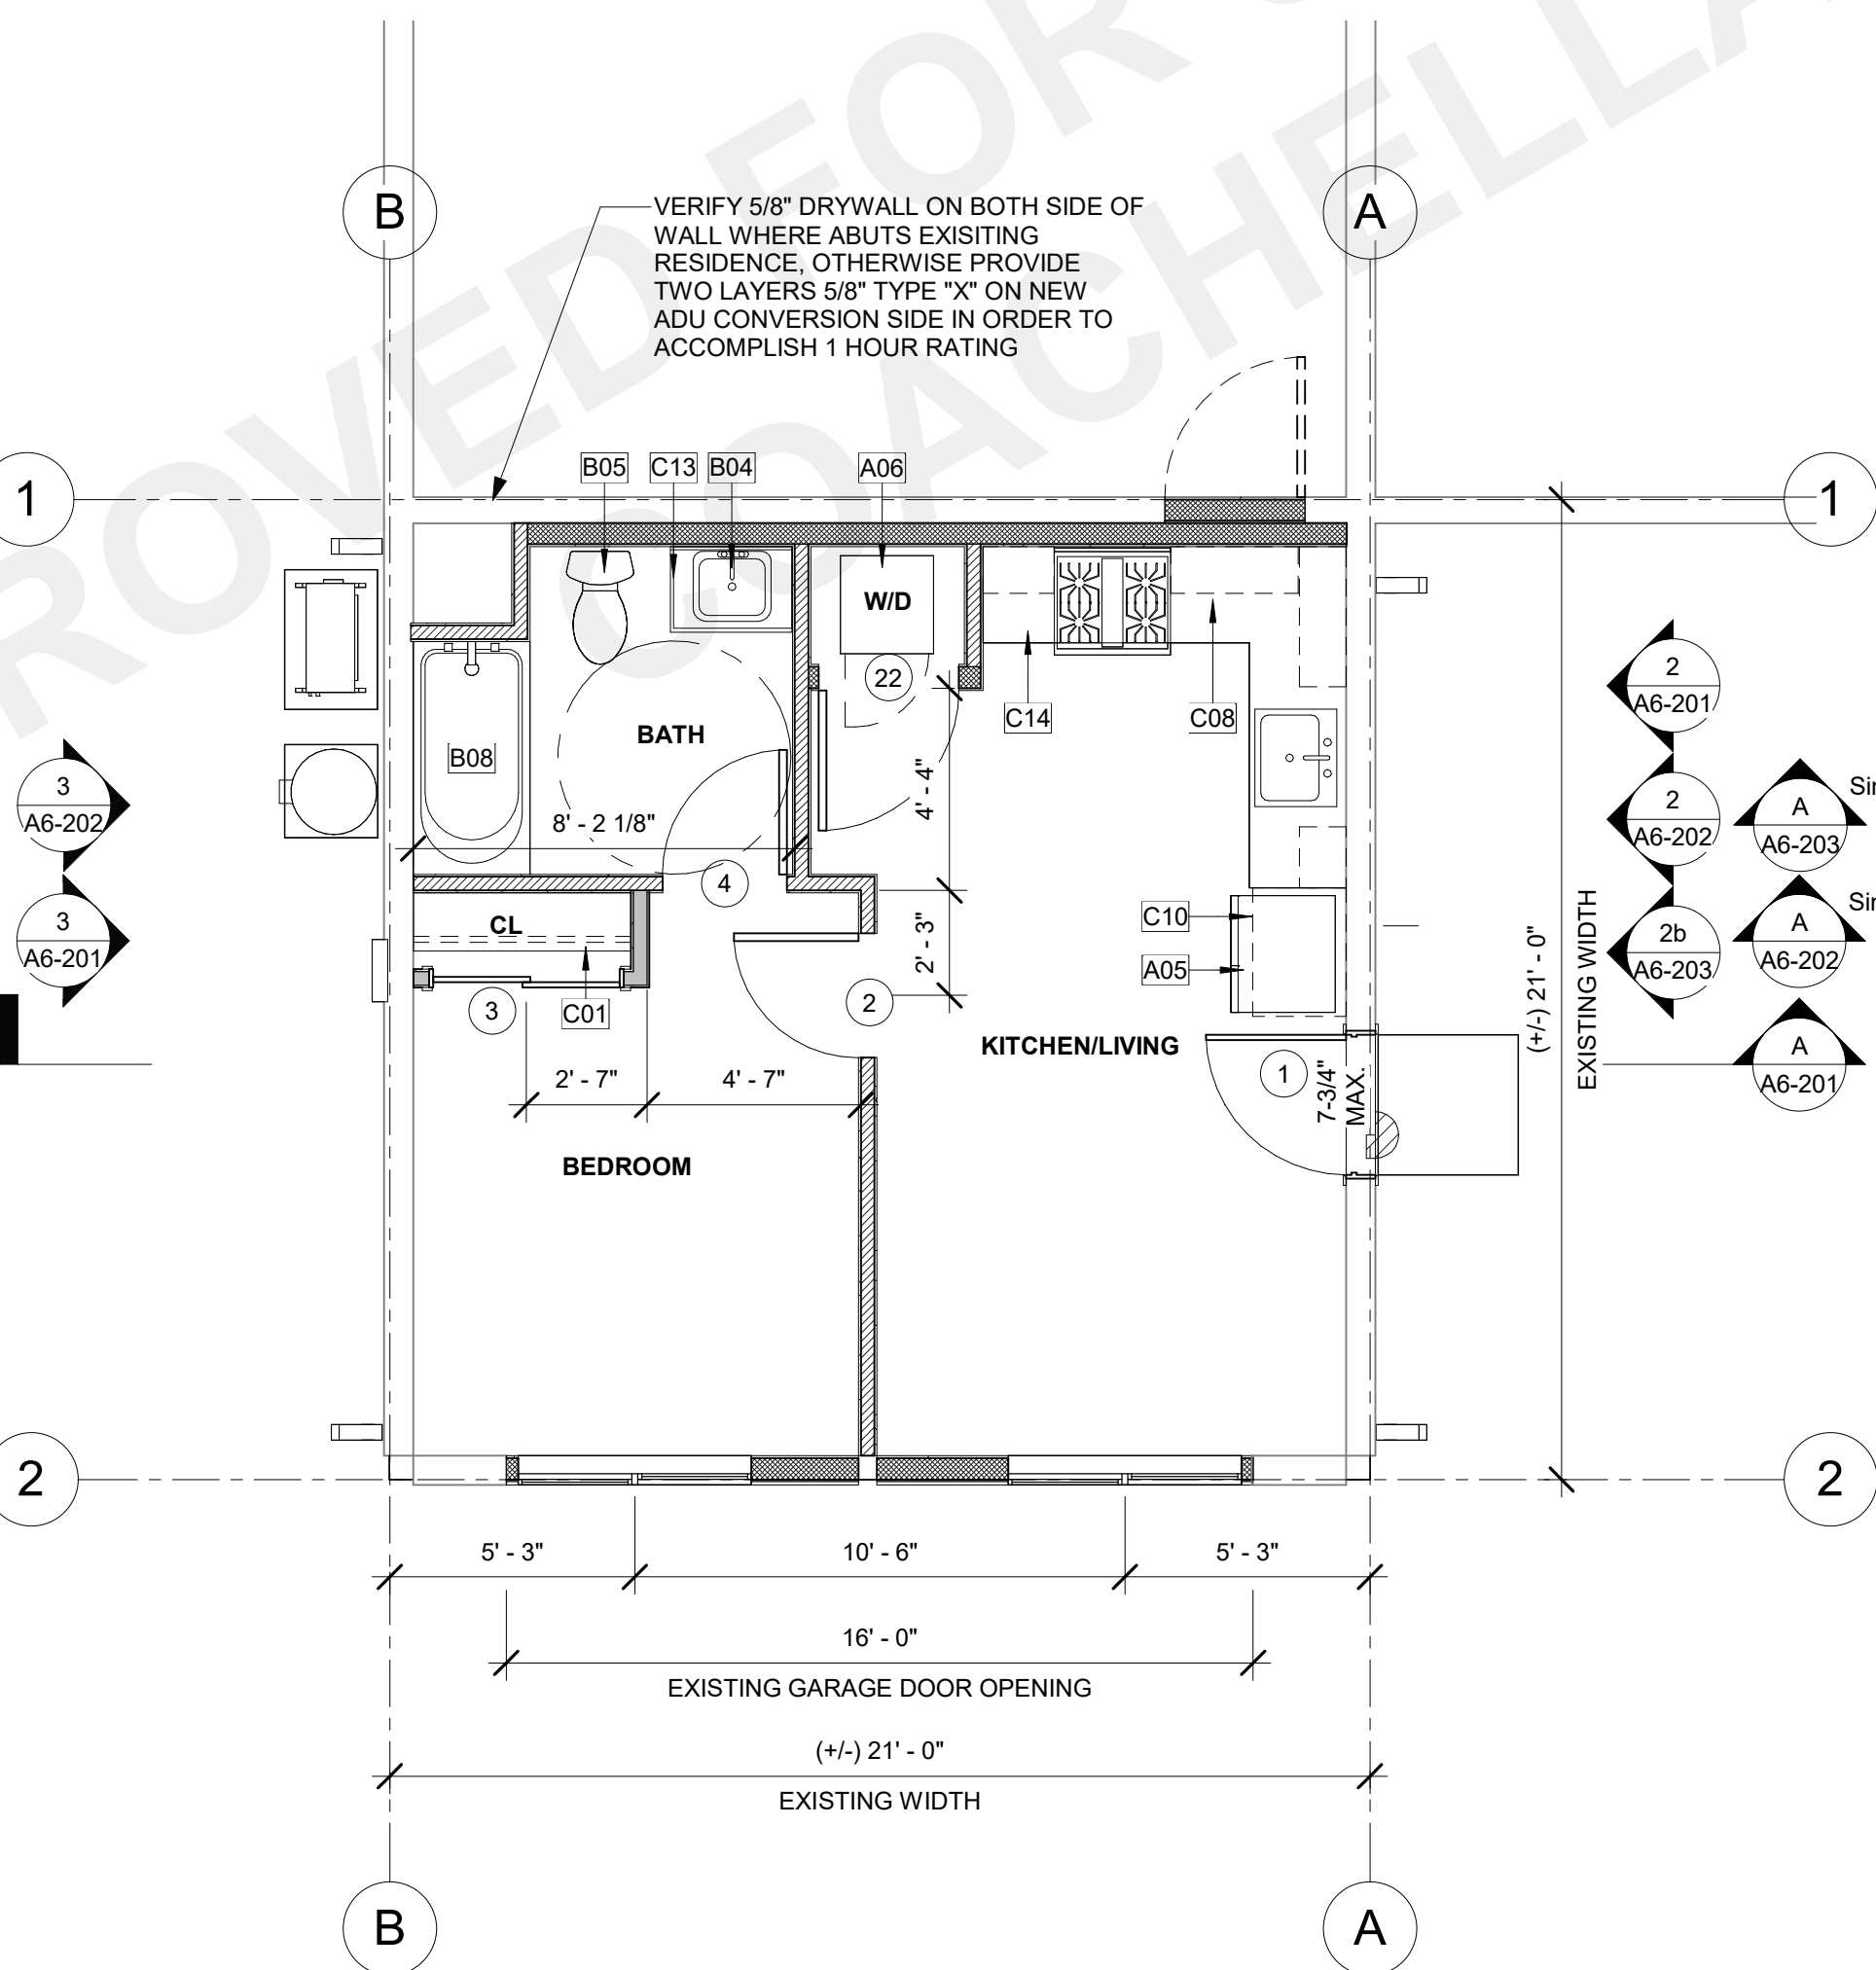

1 FLOOR PLAN - FRONT FACING GARAGE DOOR
A6-201 | A6-101 SCALE: 1/4" = 1'-0"

LEGEND

- EXTERIOR:** 5 1/2" WOOD STUD W/ PLYWOOD SHEATHING AND STUCCO/SIDING PER ELEVATION, ONE LAYER GYPSUM WALL BOARD INTERIOR.
- INTERIOR:** 5 1/2" WOOD STUD W/ONE LAYER GYPSUM WALL BOARD EACH SIDE.
- INTERIOR:** 3 1/2" WOOD STUD W/ONE LAYER GYPSUM WALL BOARD EACH SIDE.

KEYNOTES

- A05 REFRIGERATOR LOCATION. PROVIDE 37" SPACE WITH ROUGH PLUMBING FOR ICE MAKER (RECESS IN WALL).
- A06 STACKED WASHER/DRYER MACHINE LOCATION. PROVIDE WASTE AND WATER IN RECESSED WALL BOX. PROVIDE DRYER VENT. VENT TO OUTSIDE AIR THROUGH EXTERIOR WALL. DRYER VENT 4" MIN DIAMETER TO EXTERIOR WITH SCREENED AND ONE DIRECTIONAL VENT GATE. MAX LENGTH TO NOT EXCEED 14' WITH A MAX OF 2 90-DEGREE BENDS. TERMINATION SHALL BE 3' MINIMUM FROM OPERABLE OPENING IN EXTERIOR WALL.
- B04 LAVATORY SINK. REFER TO WATER EFFICIENCY REQUIREMENTS ON CALGREEN CODE NOTES SHEETS.
- B05 WATER CLOSET. REFER TO WATER EFFICIENCY REQUIREMENTS ON CALGREEN CODE NOTES SHEETS.
- B08 30" x 60" x 72" TUB AND SHOWER COMBINATION. MODEL BY BUILDER. PROVIDE SHOWER ROD.
- C01 SINGLE WOOD SHELF AND POLE.
- C08 12" DEEP UPPER CABINET.
- C10 24" DEEP UPPER CABINET.
- C13 SINK BASE CABINET AND COUNTERTOP.*
- C14 36" A.F.F. COUNTERTOP
- F03 22" X 30" MIN. ATTIC ACCESS.

WINDOW GENERAL NOTES

- REFER TO FLOOR PLANS FOR WINDOW LOCATIONS.
- CONTRACTOR TO VERIFY EXACT ROUGH OPENING SIZES PRIOR TO FABRICATION OF ROUGH OPENINGS.
- REFER TO ENERGY COMPLIANCE REPORTS FOR U-FACTOR, SHGC AND ADDITIONAL WINDOW REQUIREMENTS.
- ALL GLAZING IS DOUBLE PANE UNLESS OTHERWISE NOTED.
- EGRESS WINDOWS SHALL HAVE A CLEAR OPENING WITH A MAX. SILL HEIGHT OF 44" AFF, MIN. NET CLEAR OPENING FOR EMERGENCY ESCAPE SHALL BE 5.7 S.F. EXCEPT: 5 S.F. MIN. AT GROUND FLOOR. MINIMUM NET CLEAR OPENING DIMENSIONS: HEIGHT: 24", WIDTH: 20". [2022 CRC SEC. R310.2]
- WINDOWS TO MATCH EXISTING STYLE AND COLOR OF EXISTING HOME


WINDOW SCHEDULE

NO.	TYPE	SIZE		HEAD HEIGHT	REMARKS
		WIDTH	HEIGHT		

WINDOW REMARKS

- THE MINIMUM NET CLEAR OPENING HEIGHT DIMENSION SHALL BE 24 INCHES. THE MINIMUM NET CLEAR OPENING WIDTH DIMENSION SHALL BE 20 INCHES. THE NET CLEAR OPENING DIMENSIONS SHALL BE THE RESULT OF NORMAL OPERATION OF THE OPENING. PER CBC 2022 SEC. 1031.3.2
- SHALL HAVE THE BOTTOM OF THE CLEAR OPENING NOT GREATER THAN 44 INCHES MEASURED FROM THE FLOOR. PER CBC 2022 SEC. 1031.3.3
- TEMPERED / SAFETY GLAZING.

WINDOW LEGEND

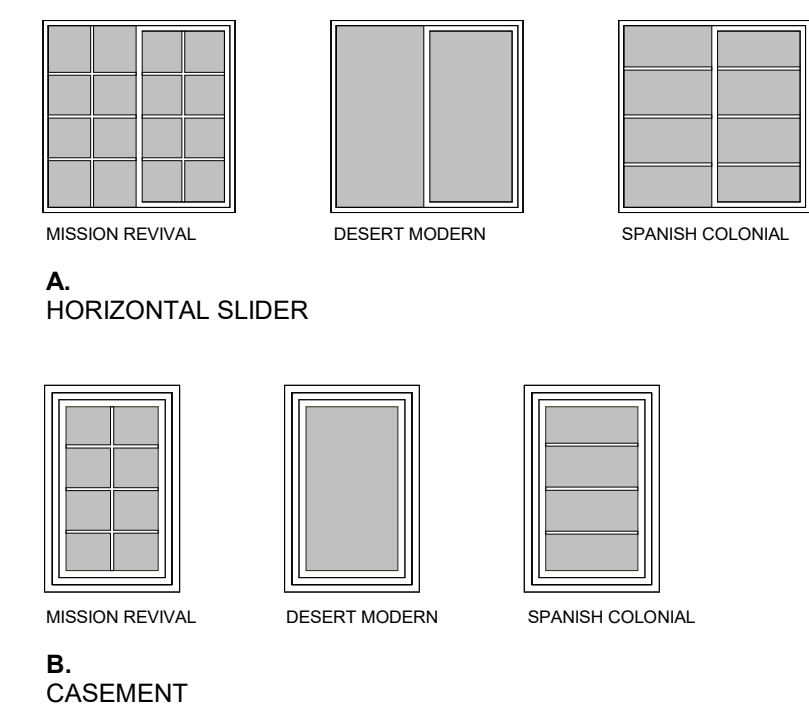

FLOOR PLAN NOTES

- DIMENSIONS ARE TO FACE OF FRAMING U.N.O
- REFER TO STRUCTURAL PLANS FOR FURTHER FRAMING INFORMATION.
- REFER TO ELECTRICAL & MECHANICAL PLANS FOR FURTHER INFORMATION.
- ALL FURNITURE AND EQUIPMENT IS BY OWNER AND IS SHOWN FOR COORDINATION PURPOSES ONLY.
- FLOOR FINISHES TO BE DETERMINED BY THE PROPERTY OWNER.
- SHOWER COMPARTMENTS AND WALLS ABOVE BATHTUBS WITH INSTALLED SHOWER HEADS SHALL BE FINISHED WITH A SMOOTH, NONABSORBENT SURFACE TO A HEIGHT NOT LESS THAN 72" ABOVE THE DRAIN INLET.
- PROVIDE ADEQUATE BLOCKING IN WALLS FOR CABINETS AND OTHER WALL MOUNTED ACCESSORIES INCLUDING BUT NOT LIMITED TO HANDRAILS, SHELVING AND BATHROOM FIXTURES.
- PROVIDE FIRE BLOCKING FOR WALL CAVITIES THAT EXCEED CBC HEIGHT LIMITATION.

AREAS

AREAS-PLAN 5	
SPACE	CONDITIONED AREA
PLAN 5-EXISTING FOOTPRINT OF GARAGE, AS SHOWN IN VIEW 1/A7-101	441 SF

DOOR GENERAL NOTES

- REFER TO GENERAL NOTES SHEET G-102 FOR ADDITIONAL REQUIREMENTS
- REFER TO PLANS FOR LOCATION OF DOORS.
- VERIFY ROUGH OPENING SIZE WITH DOOR MANUFACTURER SPECIFICATIONS PRIOR TO CONSTRUCTION.
- CONTRACTOR TO VERIFY ACTUAL DOOR SIZE TO FIT FINISH OPENING PRIOR TO FABRICATION OF DOOR AND FINISH OPENING.
- OPENINGS BETWEEN THE GARAGE AND RESIDENCE SHALL BE EQUIPPED WITH SOLID WOOD DOORS NOT LESS THAN 1 3/8 INCHES (35 MM) IN THICKNESS. SOLID OR HONEYCOMB-CORE STEEL DOORS NOT LESS THAN 1 3/8 INCHES (35 MM) THICK, OR 20-MINUTE FIRE-RATED DOORS 2022 CRC SECTION R302.5.1. DOORS SHALL BE SELF-LATCHING AND EQUIPPED WITH A SELF-CLOSING OR AUTOMATIC CLOSING DEVICE.
- GLAZING IN DOORS SHALL BE TEMPERED PER SECTION R308.4.1. MEANS.
- DOORS TO MATCH STYLE AND COLOR OF EXISTING HOME.


DOOR SCHEDULE

NO.	TYPE	SIZE		FIRE RATING	REMARKS
		WIDTH	HEIGHT		
2	C	2' - 8"	6' - 8"		
3	D	4' - 0"	6' - 8"		
4	C	2' - 8"	6' - 8"		
22	C	3' - 0"	6' - 8"		3

DOOR REMARKS

- FIRE RATED DOOR. REFER TO GENERAL DOOR NOTE #5
- GLAZING IN DOOR. TEMPERED (BOTH PANES)
- PROVIDE 100 SQ INCHES OF VENTING IN DOOR OR BY OTHER APPROVED MEANS.
- OPTIONAL DOOR.

DOOR LEGEND

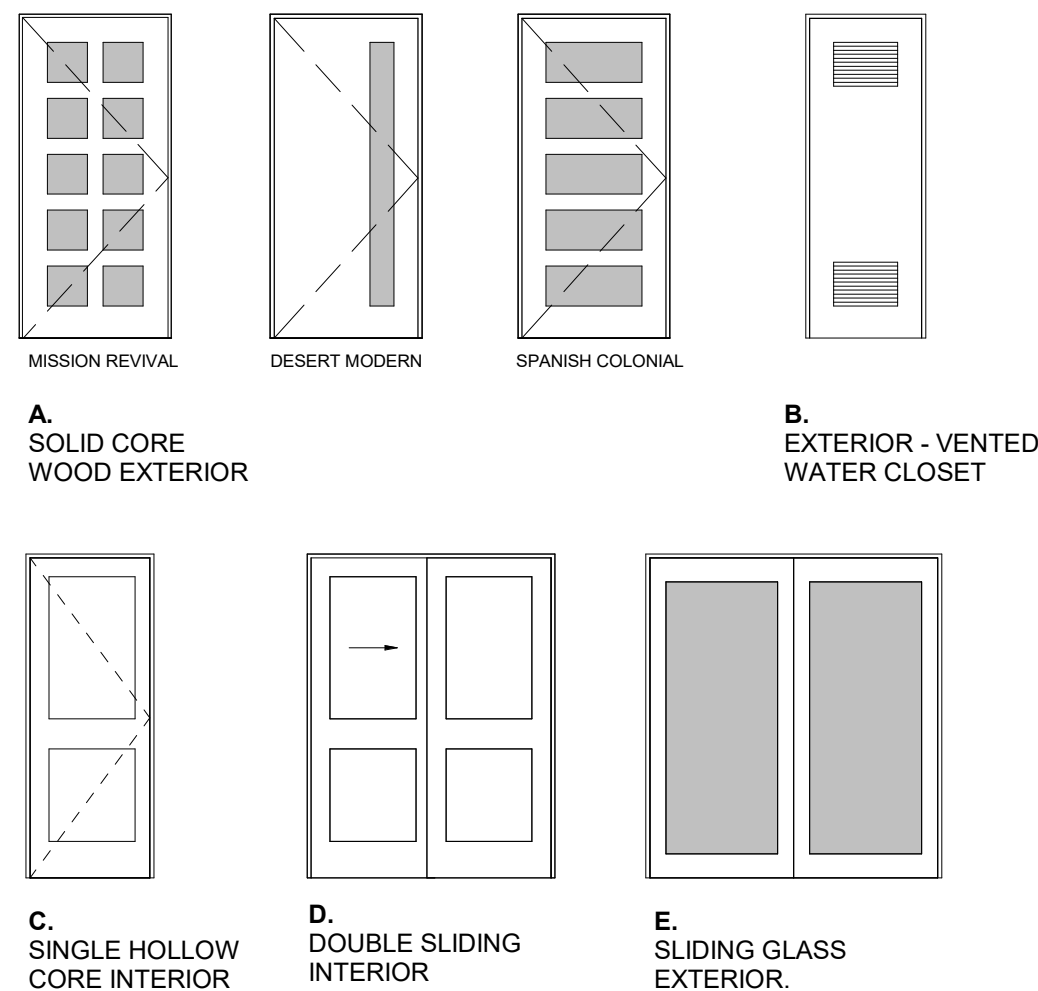

THESE PLANS ARE PROVIDED BY THE CITY OF AGOURA HILLS AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS. IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

PROTOTYPE ADU
2 CAR GARAGE CONVERSION
COACHELLA, CA

FLOOR PLAN & RCP - PLAN 6

PUBLIC SET

DATE
01/11/24
SHEET

A6-101

ELECTRICAL LOAD CALCULATIONS

UTILITY GENERAL NOTES

- 1. REFER TO GENERAL NOTES SHEET G-102 FOR ADDITIONAL REQUIREMENTS.
- 2. SEE DETAILS FOR ADDITIONAL INFORMATION AND REQUIREMENTS.
- 3. SEE TITLE 24 REPORTS FOR ADDITIONAL INFORMATION.

KEYNOTES

B18 ELECTRIC PANEL TBD.
B38 MULTI-ZONE HEAT PUMP CONDENSING UNIT. REFER TO PLANS FOR LOCATION OF INDOOR FAN FAN COIL UNITS. REFER TO TITLE 24 FOR ADDITIONAL INFORMATION. PROVIDE CONCRETE PAD MIN. 6" LARGER THAN UNIT IN EACH DIRECTION, 3" MIN. ABOVE GRADE.



THESE PLANS ARE PROVIDED BY THE CITY OF AGOURA HILLS AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS. IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

PLUMBING FIXTURES

4.303.2 STANDARDS FOR PLUMBING FIXTURES AND FITTINGS
PLUMBING FIXTURES AND FITTINGS SHALL BE INSTALLED IN ACCORDANCE WITH THE CALIFORNIA PLUMBING CODE, AND SHALL MEET THE APPLICABLE STANDARDS REFERENCED IN TABLE 1701.1 OF THE CALIFORNIA PLUMBING CODE.

NOTE:
THIS TABLE COMPILES THE DATA IN SECTION 4.303.1 AND IS INCLUDED AS A CONVENIENCE FOR THE USER.

TABLE - MAXIMUM FIXTURE WATER USE	
FIXTURE TYPE	FLOW RATE
SHOWER HEADS (RESIDENTIAL)	1.8 GMP @ 80 PSI
LAVATORY FAUCETS (RESIDENTIAL)	MAX. 1.2 GPM @ 60 PSI MIN. 0.8 GPM @ 20 PSI
LAVATORY FAUCETS IN COMMON & PUBLIC USE AREAS	0.5 GPM @ 60 PSI
KITCHEN FAUCETS	1.8 GPM @ 60 PSI
METERING FAUCETS	0.25 GAL/CYCLE
WATER CLOSET	1.28 GAL/FLUSH
URINALS	0.125 GAL/FLUSH


RCP NOTES

- HEIGHT OF CEILINGS SHALL BE MEASURED FROM TOP OF SLAB TO FINISH FACE OF GWB OR FACE OF CEILING GRID AS INDICATED ON THE REFLECTED CEILING PLAN, UON.
- ALL LIGHT FIXTURES ARE TO BE INSTALLED ACCORDING TO THE ARCHITECTURAL ELECTRICAL PLAN.
- REFER TO ARCHITECTURAL ELECTRICAL PLANS FOR FURTHER INFORMATION.
- REFER TO MECHANICAL PLANS FOR FURTHER INFORMATION.
- REFER TO FLOOR PLAN FOR ELEVATION AND SECTION REFERENCES.

LEGEND


NOTE: ALL OUTDOOR OUTLETS SHALL HAVE GFCI PROTECTION AND WEATHERPROOF COVERS.

	ELECTRICAL SWITCH		SMOKE DETECTOR/ALARM		DUPLEX OUTLET ARC-FAULT CIRCUIT INTERRUPTER
	ELECTRICAL SWITCH-VACANCY SENSOR		COMBINATION SMOKE/CARBON MONOXIDE		DUPLEX OUTLET 240 VOLTS
	ELECTRICAL SWITCH-FAN		TELEPHONE LOCATION		DUPLEX OUTLET GROUND FAULT INTERRUPTER
	EXHAUST FAN W/HUMIDISTAT		CABLE TELEVISION LOCATION		DUPLEX OUTLET WATERPROOF GROUND FAULT INTERRUPTER
	WALL MOUNTED HIGH-EFFICACY LIGHT				DUPLEX OUTLET AFCI-HALF HOT
	RECESSED HIGH-EFFICACY DOWNLIGHT				COLD WATER STUB OUT
	RECESSED HIGH-EFFICACY DOWNLIGHT VAPOR PROOF				HOT WATER STUB OUT
	ELECTRICAL WIRING				WATER HOSE BIBB WITH SHUT OFF VALVE
	CEILING FAN OPTIONAL (PRE WIRE FOR CEILING FAN ONLY)				22\"X30\" MIN. CEILING ACCESS PANEL
	10' - 0"		CEILING HEIGHT		

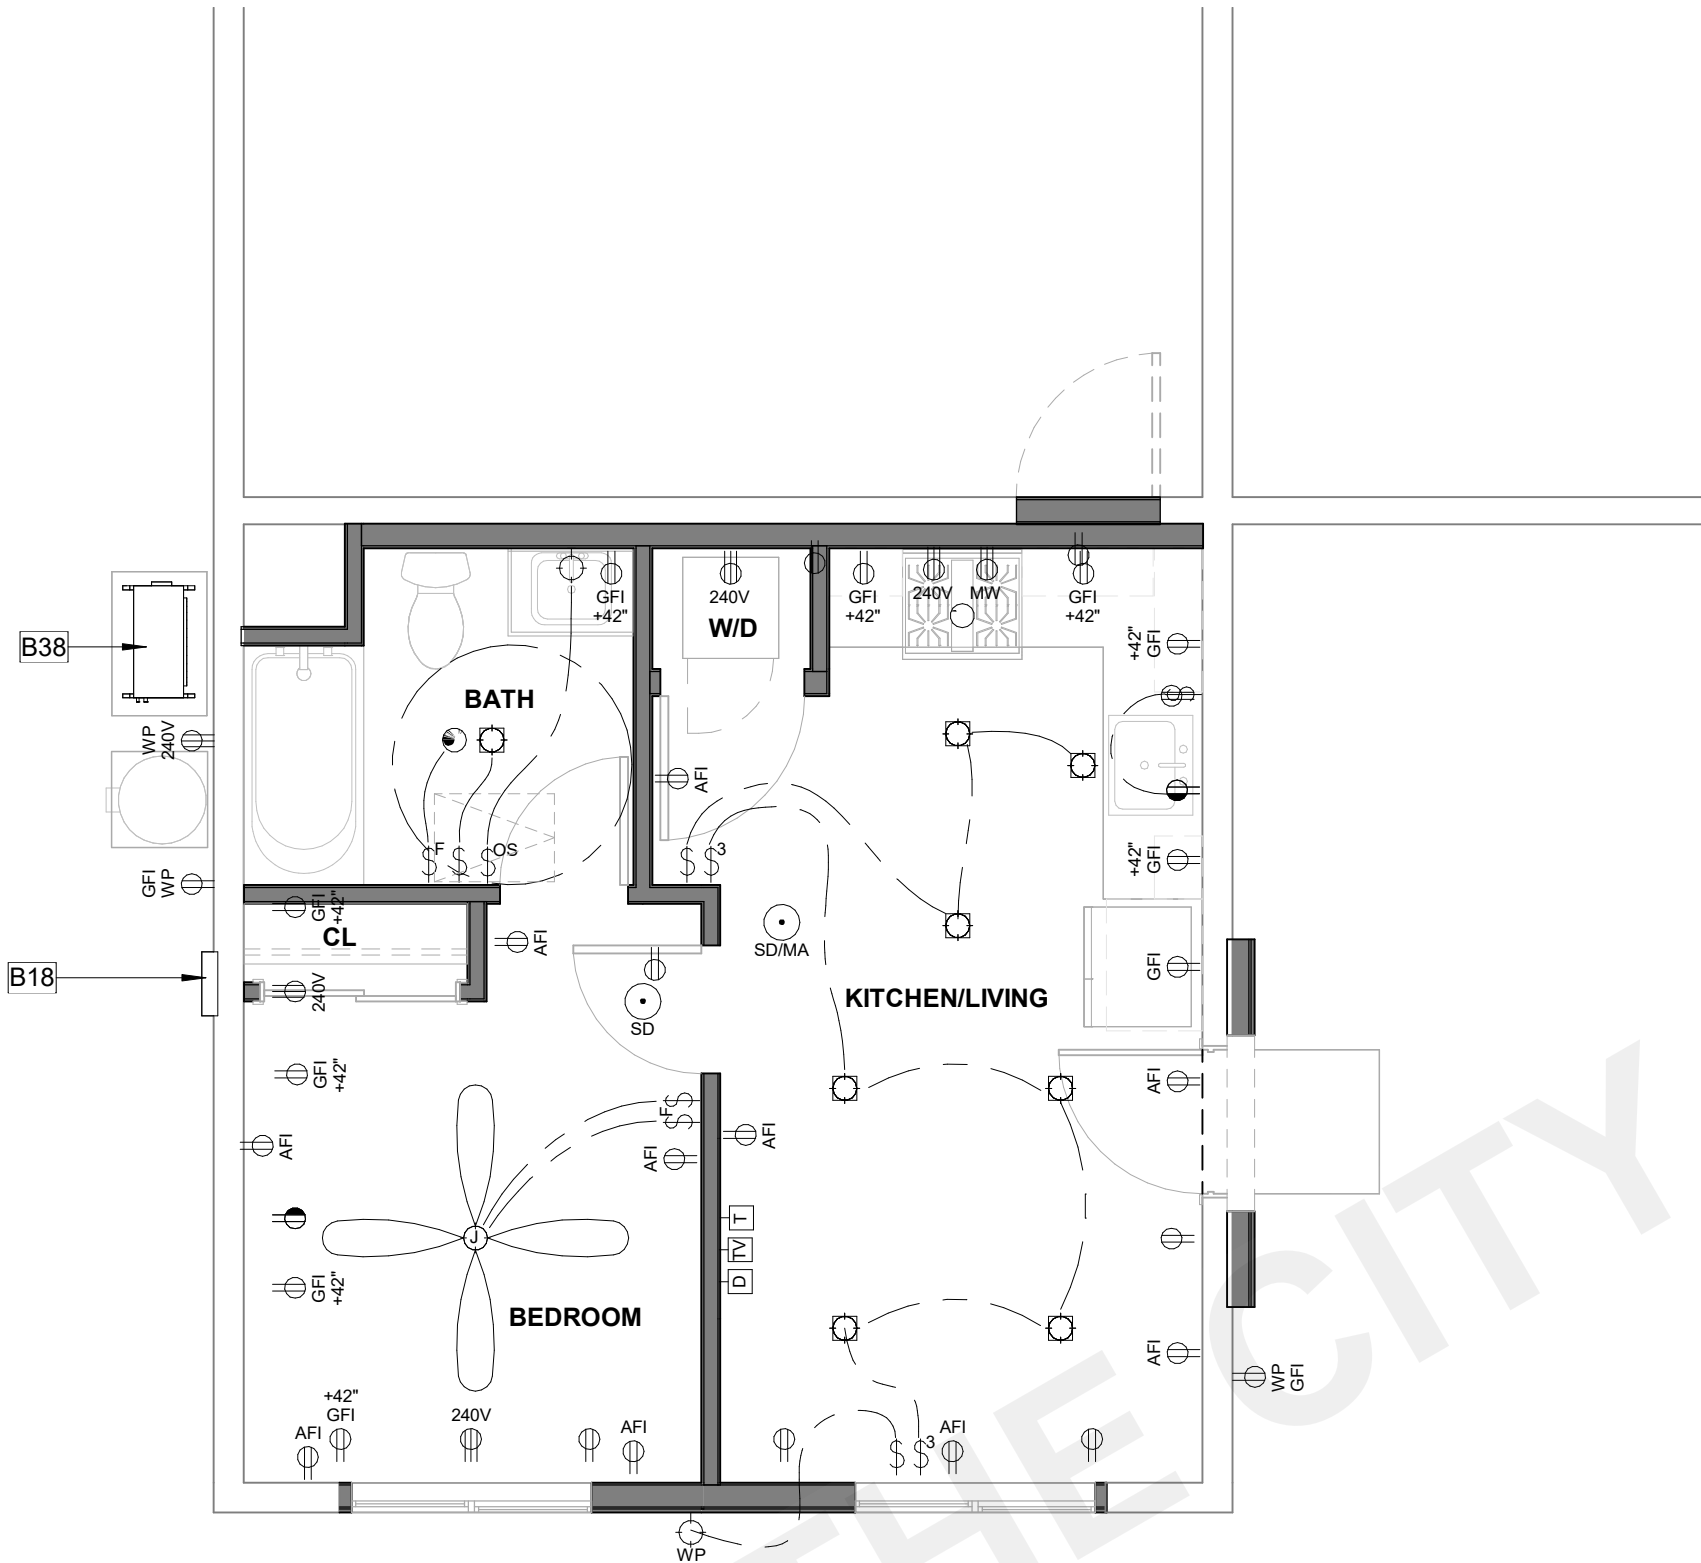

1 ELECTRICAL FLOOR PLAN

A6-201 | A6-111 SCALE: 1/4" = 1'-0"

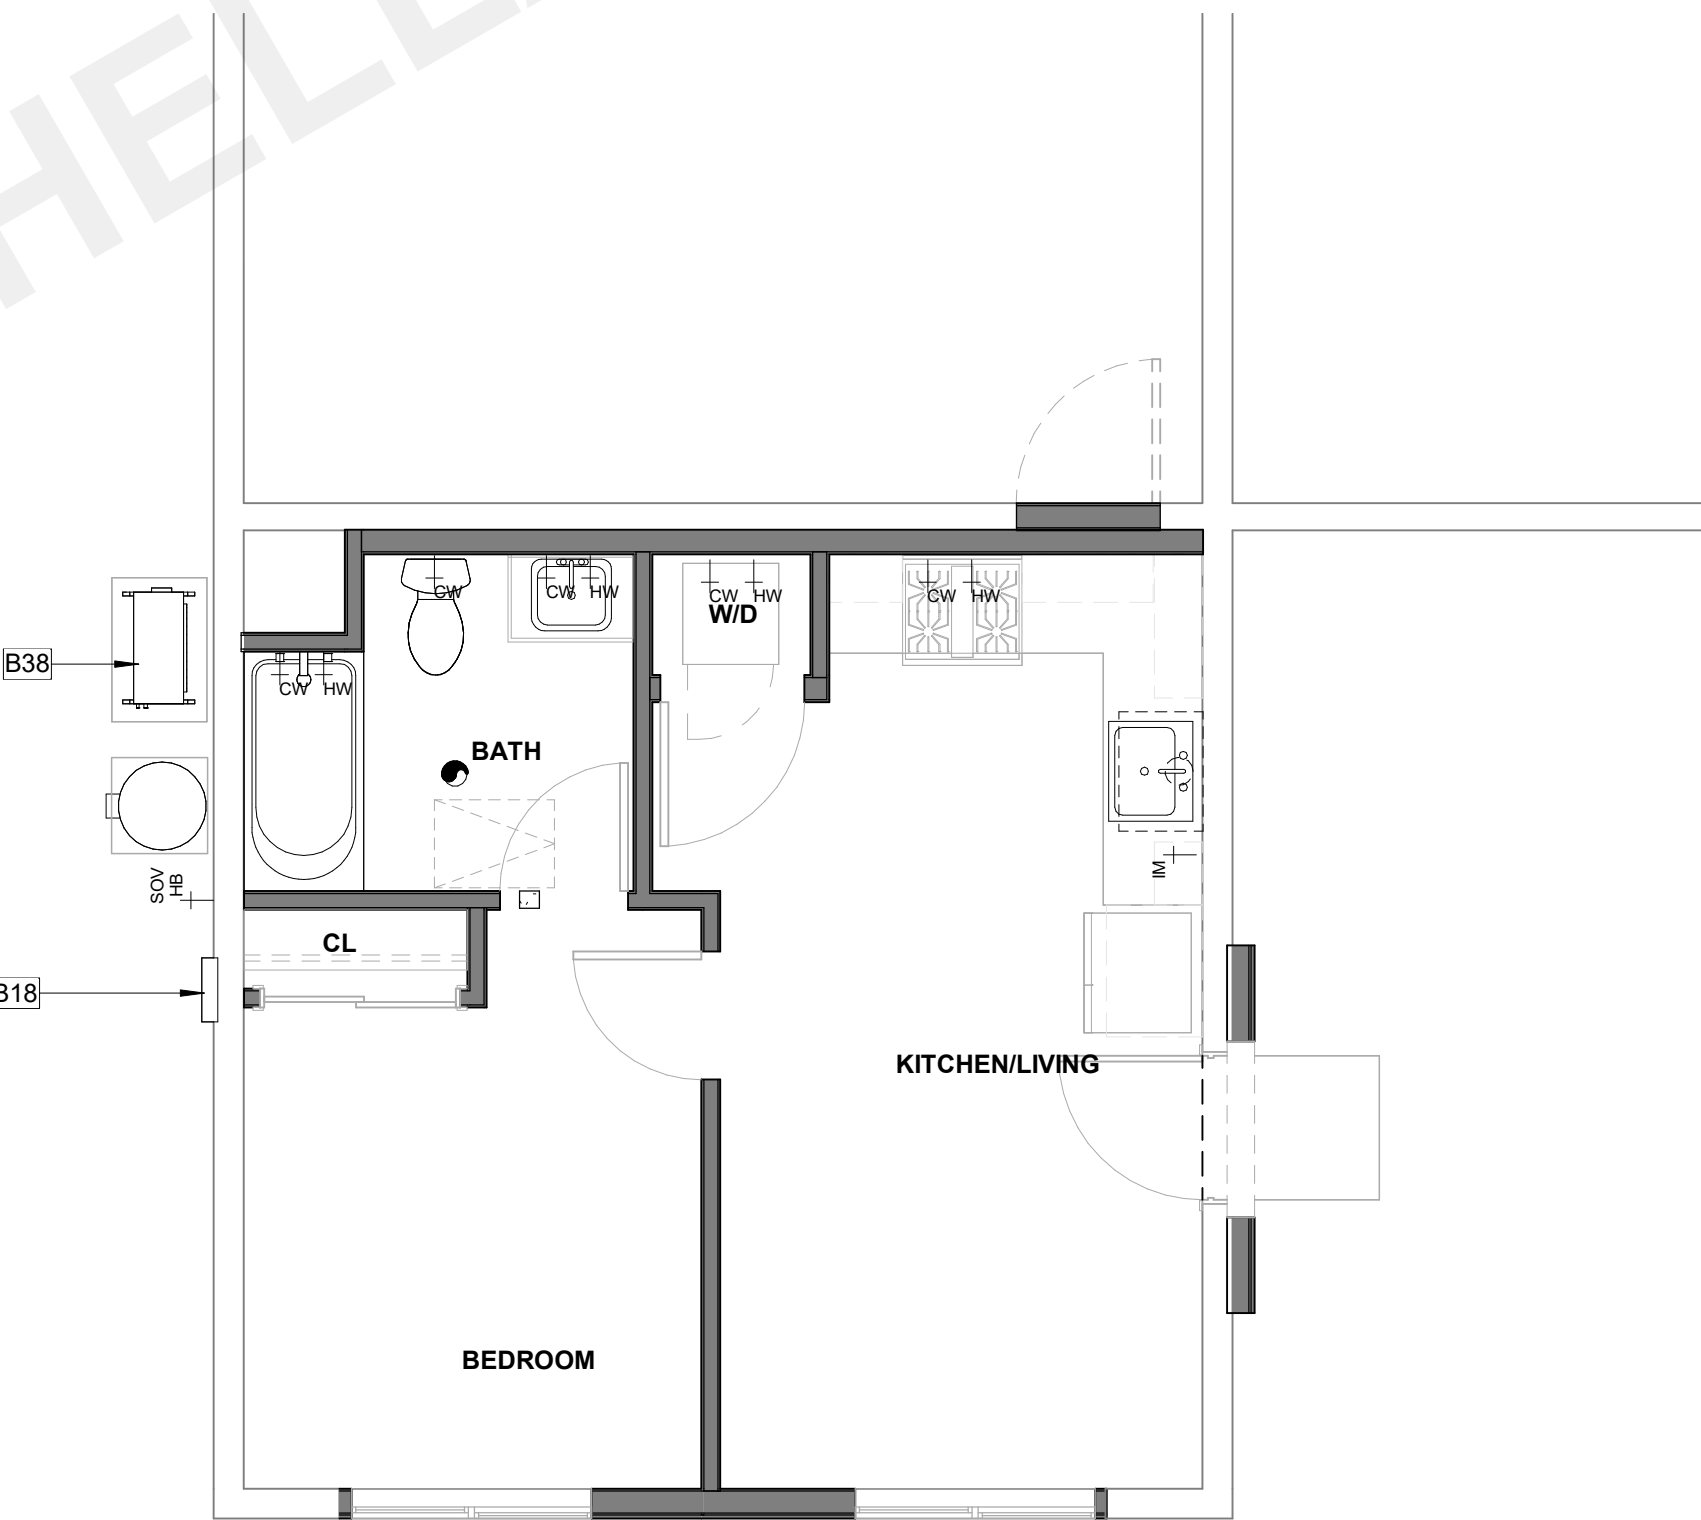

2 MECHANICAL FLOOR PLAN

A6-201 | A6-111 SCALE: 1/4" = 1'-0"

VENTILATION SUMMARIES

1) LOCAL EXHAUST VENTILATION

BATHROOM	OPTION A	OPTION B
BATHROOM FAN FLOW (cfm)	50 CFM	50 CFM
DUCT TYPE	FLEX DUCT	SMOOTH DUCT
DUCT SIZE (in)	4"	4"
MAX. ALLOWABLE DUCT LENGTH (ft)	70'	105'
THIS EXHAUST FAN IS REQUIRED TO BE RATED FOR SOUND AT A MAX. OF 3 SONES.		

KITCHEN	OPTION A	OPTION B
KITCHEN FAN FLOW (cfm)	100 CFM	50 CFM
DUCT TYPE	FLEX DUCT	SMOOTH DUCT
DUCT SIZE (in)	5"	5"
MAX. ALLOWABLE DUCT LENGTH (ft)	35'	85'
THIS EXHAUST FAN IS REQUIRED TO BE RATED FOR SOUND AT A MAX. OF 3 SONES.		

2) WHOLE BUILDING VENTILATION

PER ASHRAE STANDARD 62.2, CEC EQUATION 150.0-B	OPTION A	OPTION B
BUILDING FAN FLOW (cfm)	50 CFM	50 CFM
DUCT TYPE	FLEX DUCT	SMOOTH DUCT
DUCT SIZE (in)	4"	4"
MAX. ALLOWABLE DUCT LENGTH (ft)	70'	105"
THIS EXHAUST FAN IS REQUIRED TO BE RATED FOR SOUND AT A MAX. OF 1 SONE.		
THIS EXHAUST FAN IS REQUIRED TO OPERATE CONTINUOUSLY TO ENSURE CONTINUOUSLY TO ENSURE INDOOR AIR QUALITY.		

TOTAL (MINIMUM) REQUIRED VENTILATION RATE

PER ASHRAE STANDARD 62.2, CEC EQUATION 150.0-B
QCFM = .03(FLOOR AREA) + 7.5 (# OF BEDROOMS + 1)

WHOLE DWELLING UNIT MECHANICAL VENTILATION

PER SECTION 150.0(O)(C)(i) [ASHRAE 62.2.4.1.2]
1 BED - MINIMUM CUBIC FEET PER MINUTE (CFM) (Equation 150.0-B)
Qtot = 0.03Afloor + 7.5(Nbr + 1) .03(sf) + 7.5 (1+1) = CFM < 50 CFM

EFFECTIVE ANNUAL AVERAGE INFILTRATION RATE

PER SECTION 150.0(O)(C)(ii)
a. (Equation 150.0-C) Q50 = Vdu (x) 2 ACH50 / 60minutes
a. (Equation 150.0-D) Q50 = Vdu (x) Verified ACH50 / 60minutes
b. (Equation 150.0-E) Qtot = 0.052 (x) Q50 x wsf x [H/Ht]*z [ASHRAE 62.2.4.1.2.1]

REQUIRED MECHANICAL VENTILATION RATE

AND REQUIRED MECHANICAL VENTILATION RATE PER 150.0(O)(C)(iii)
[ASHRAE 62.2.4.1.2]
(Equation 150.0-F) Qfan = Qtot (-) ϕ (Qinf (x) Aext)

PROTOTYPE ADU
2 CAR GARAGE COVERSION
COACHELLA, CA
MECHANICAL AND ELECTRICAL
PLANS AND REFLECTED CEILING
PLAN - PLAN 6

PUBLIC SET


DATE
01/11/24
SHEET

A6-111

1/19/2024 8:55:02 AM
Autodesk Docs/2309_Coachella ADUs/2309-01_Coachella ADUs_Garage Unit.rvt


B SECTION B - MODERN

A6-202 A6-202 SCALE: 1/4" = 1'-0"

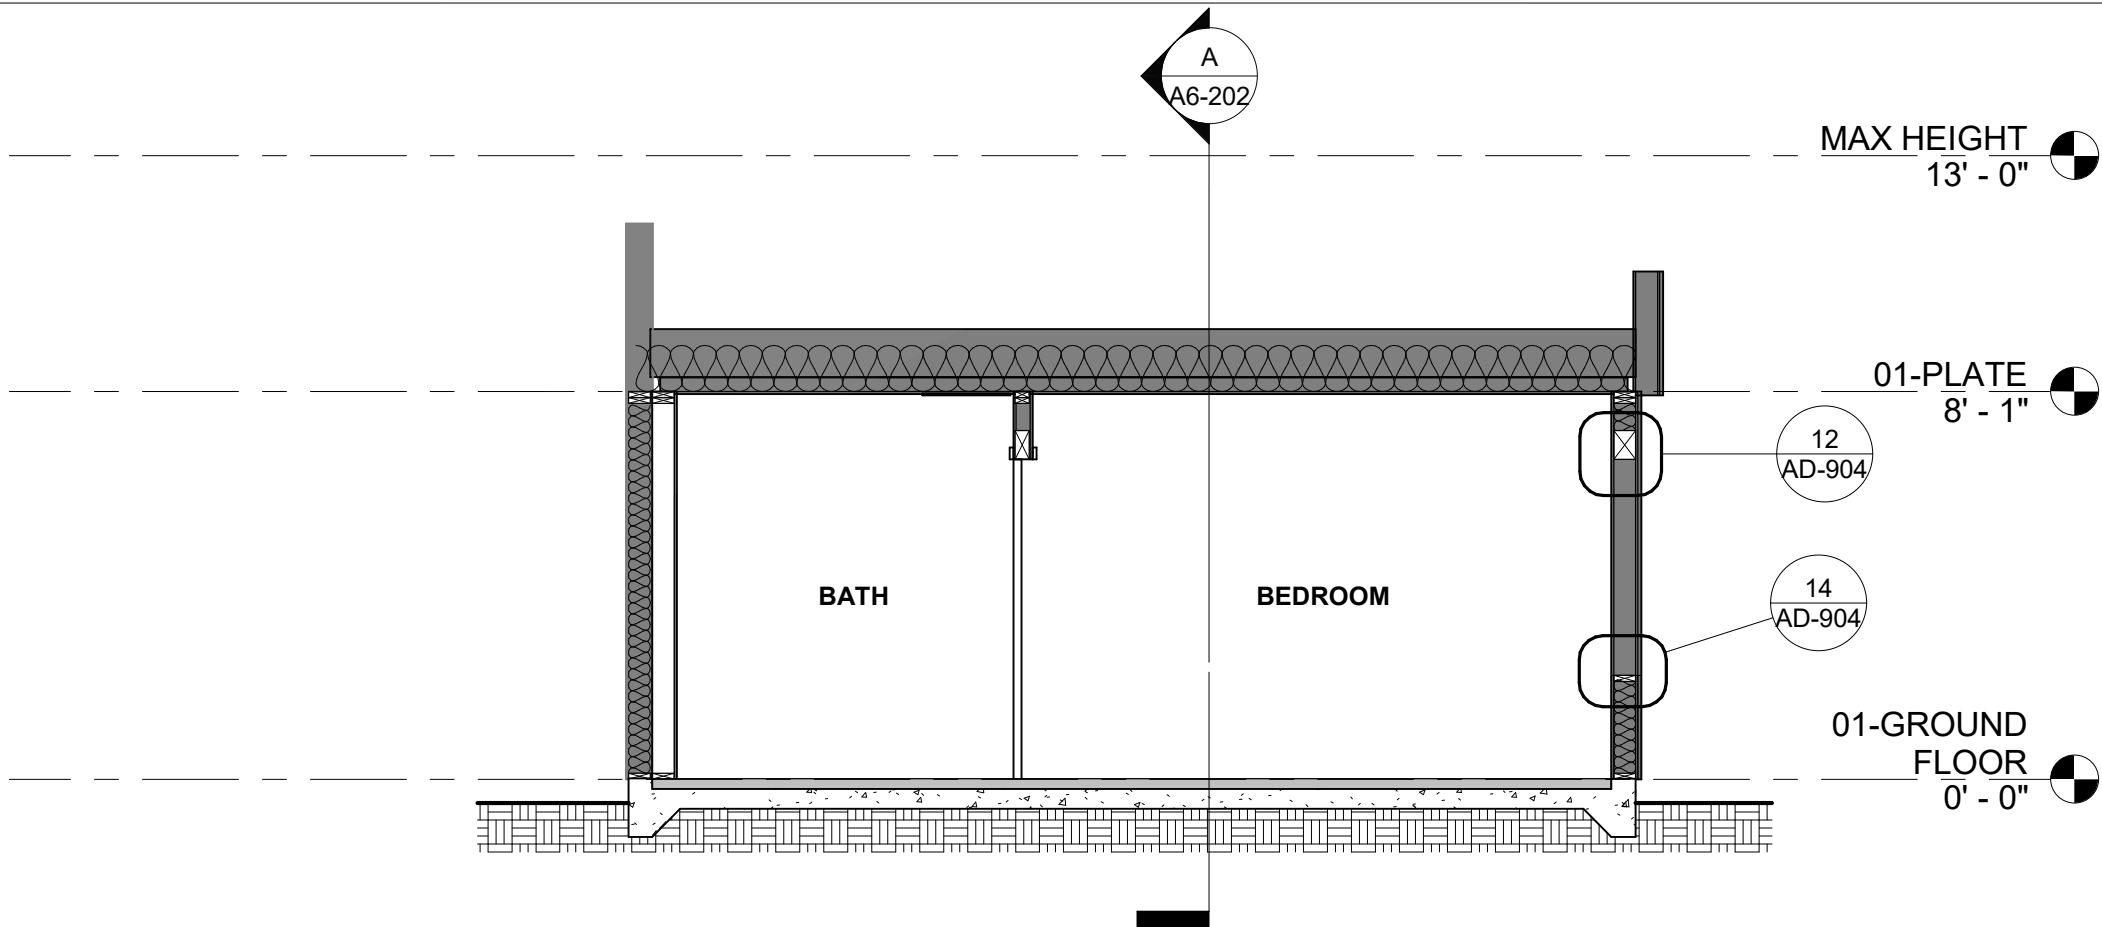


A SECTION A - MODERN

A6-101 A6-202 SCALE: 1/4" = 1'-0"

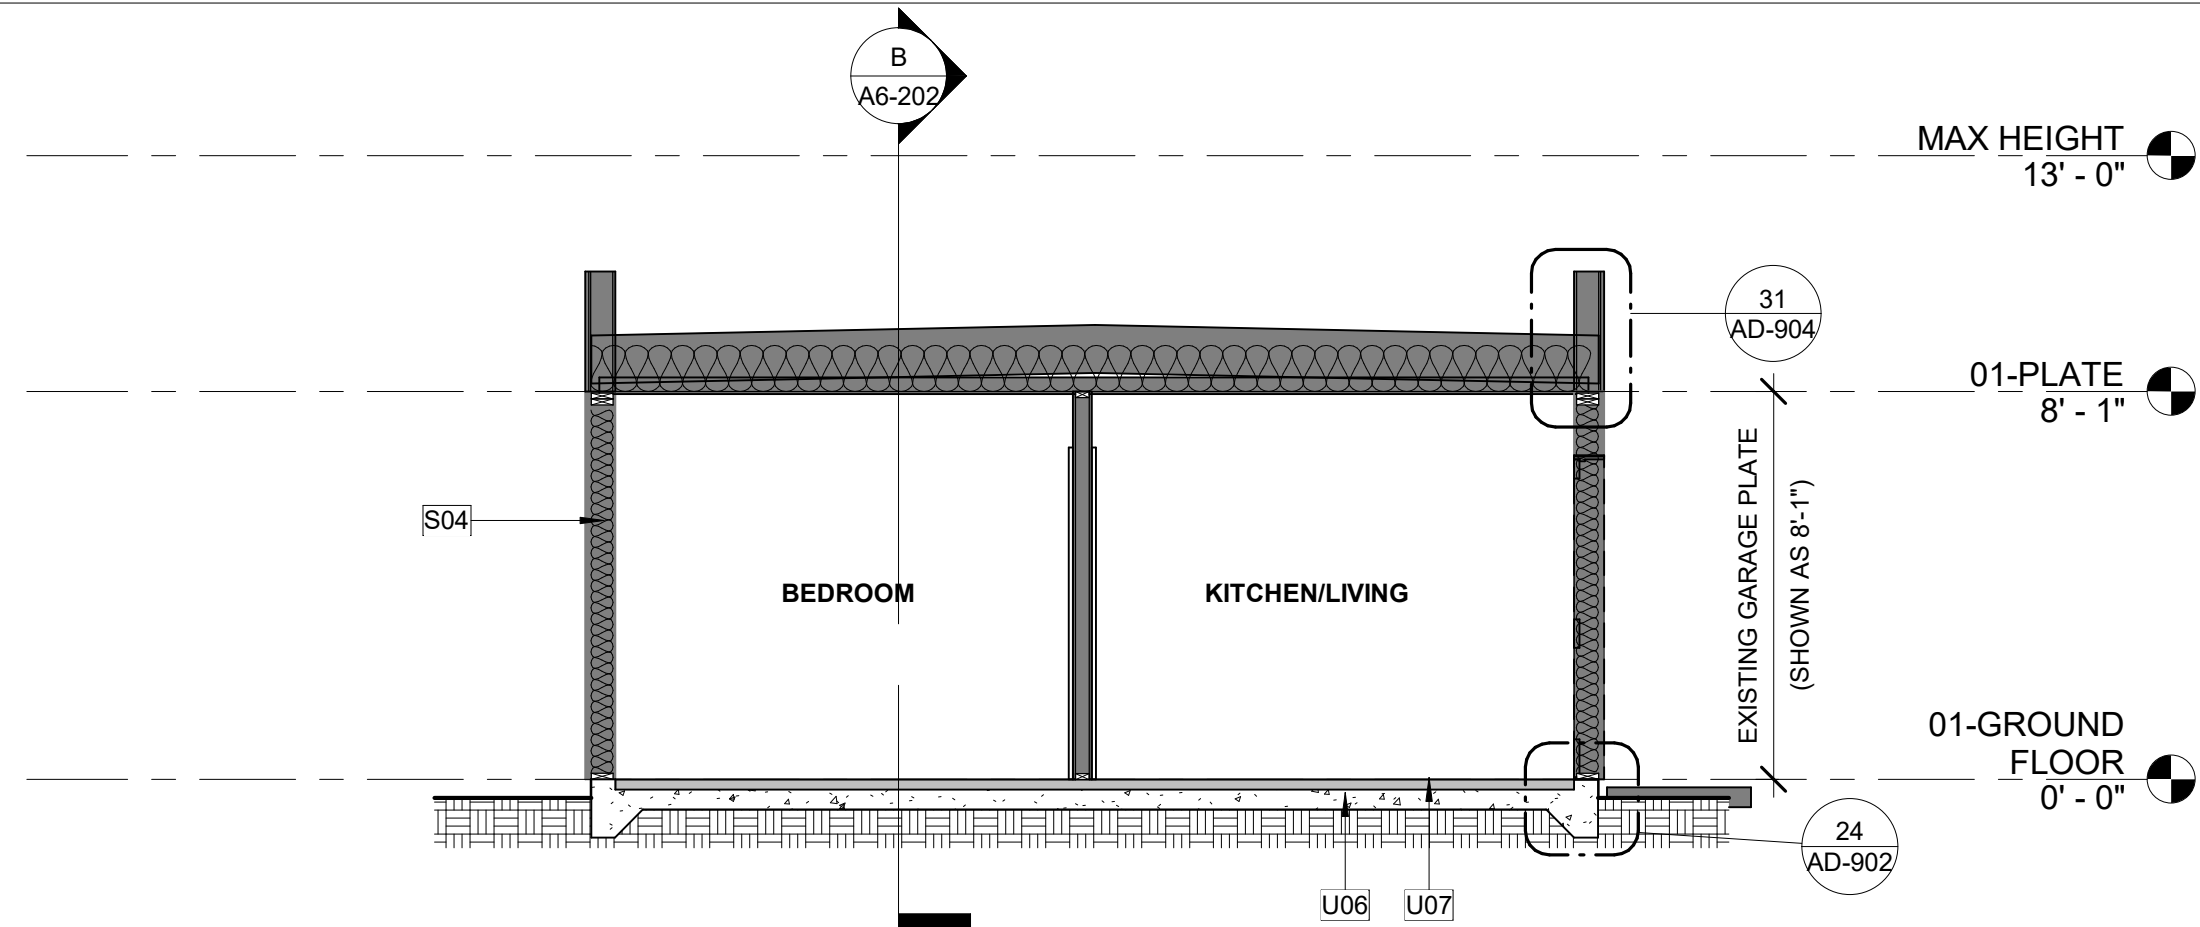


3 LEFT ELEVATION - MODERN

A6-101 A6-202 SCALE: 1/4" = 1'-0"

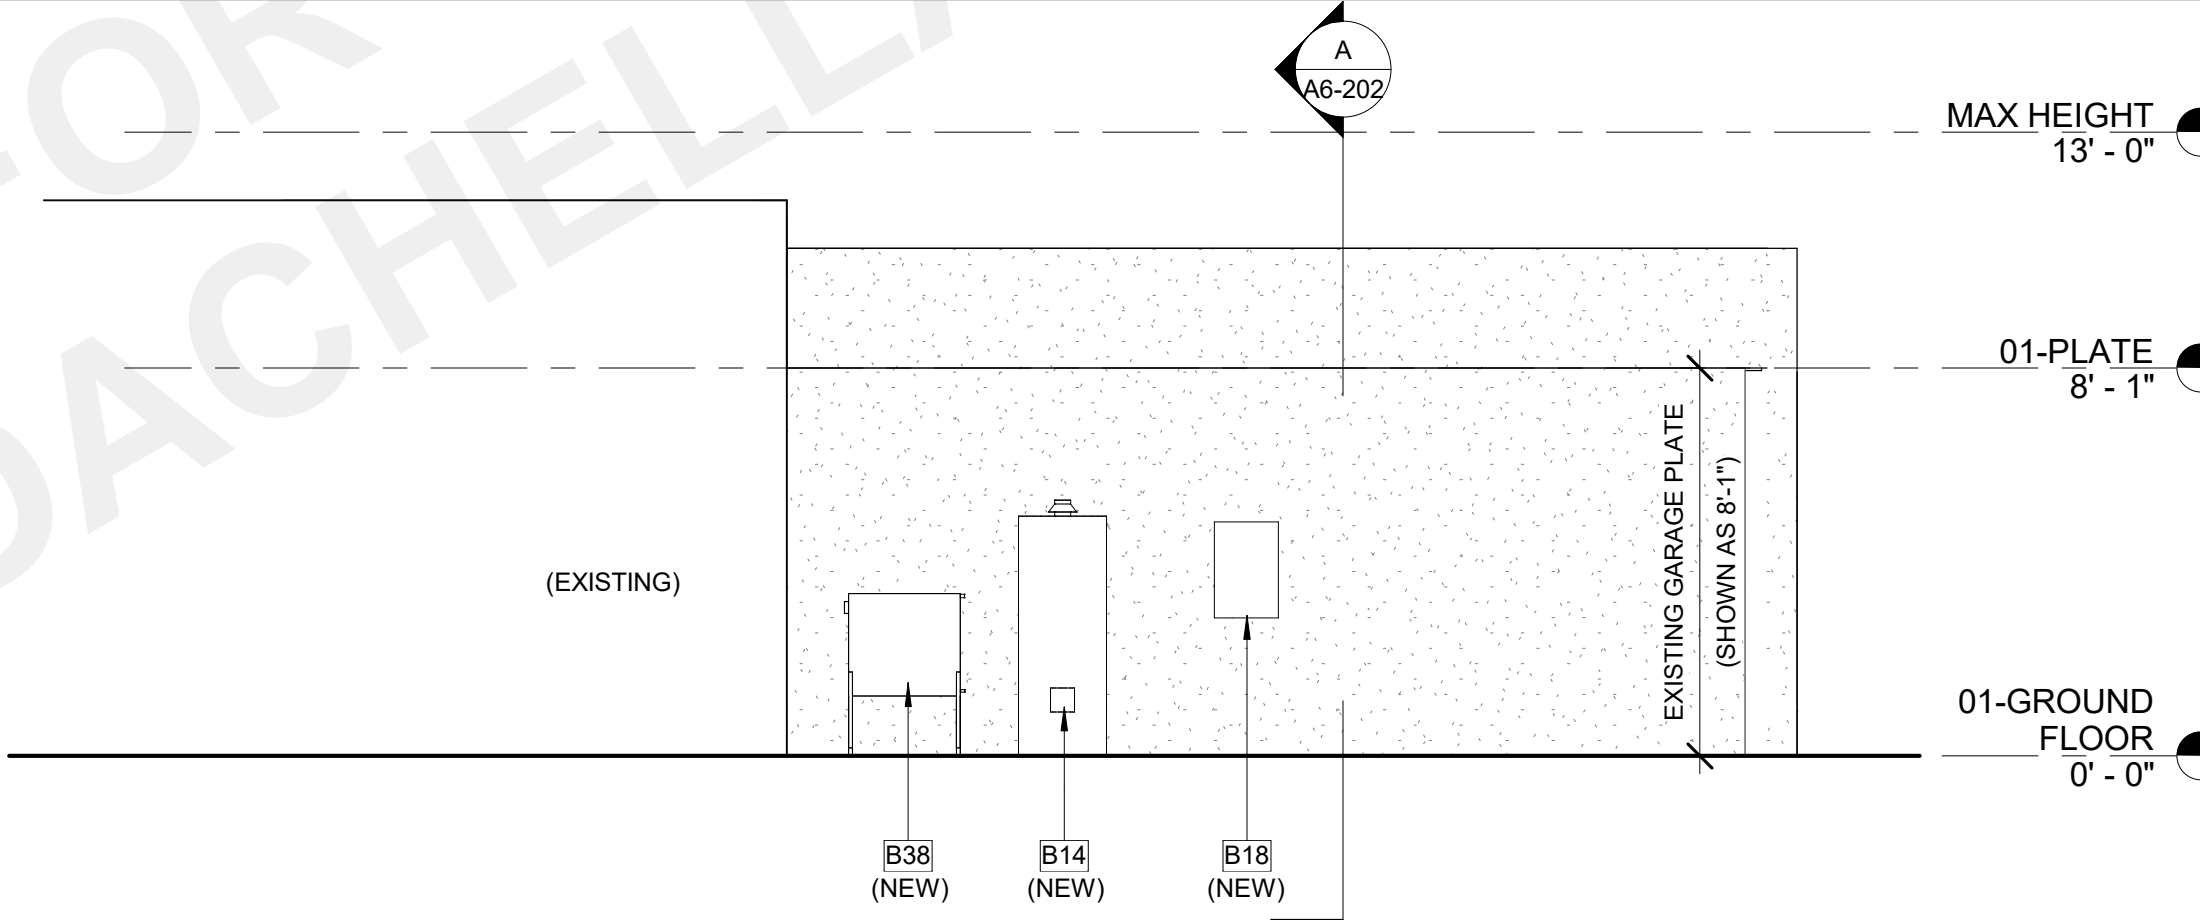


2 RIGHT ELEVATION - MODERN - FRONT FACING GARAGE

A6-101 A6-202 SCALE: 1/4" = 1'-0"

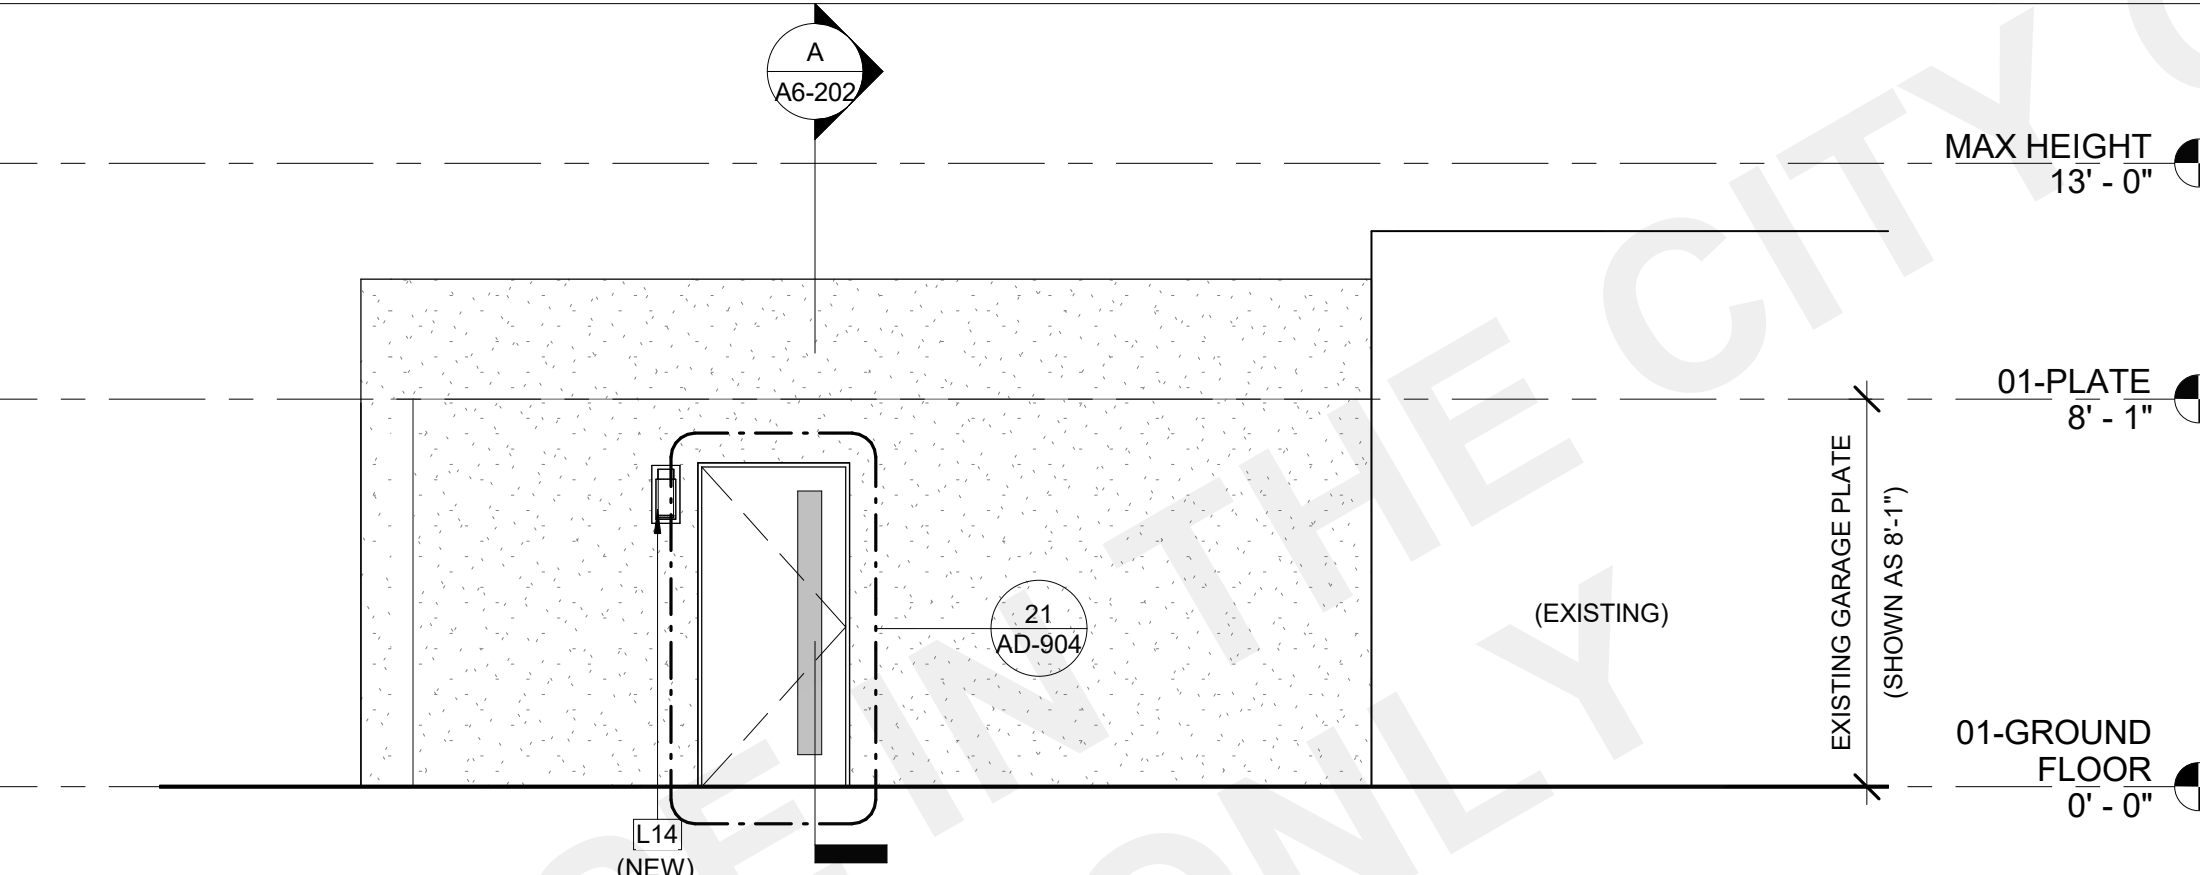

1 FRONT ELEVATION - MODERN - FRONT FACING GARAGE

A6-202 SCALE: 1/4" = 1'-0"

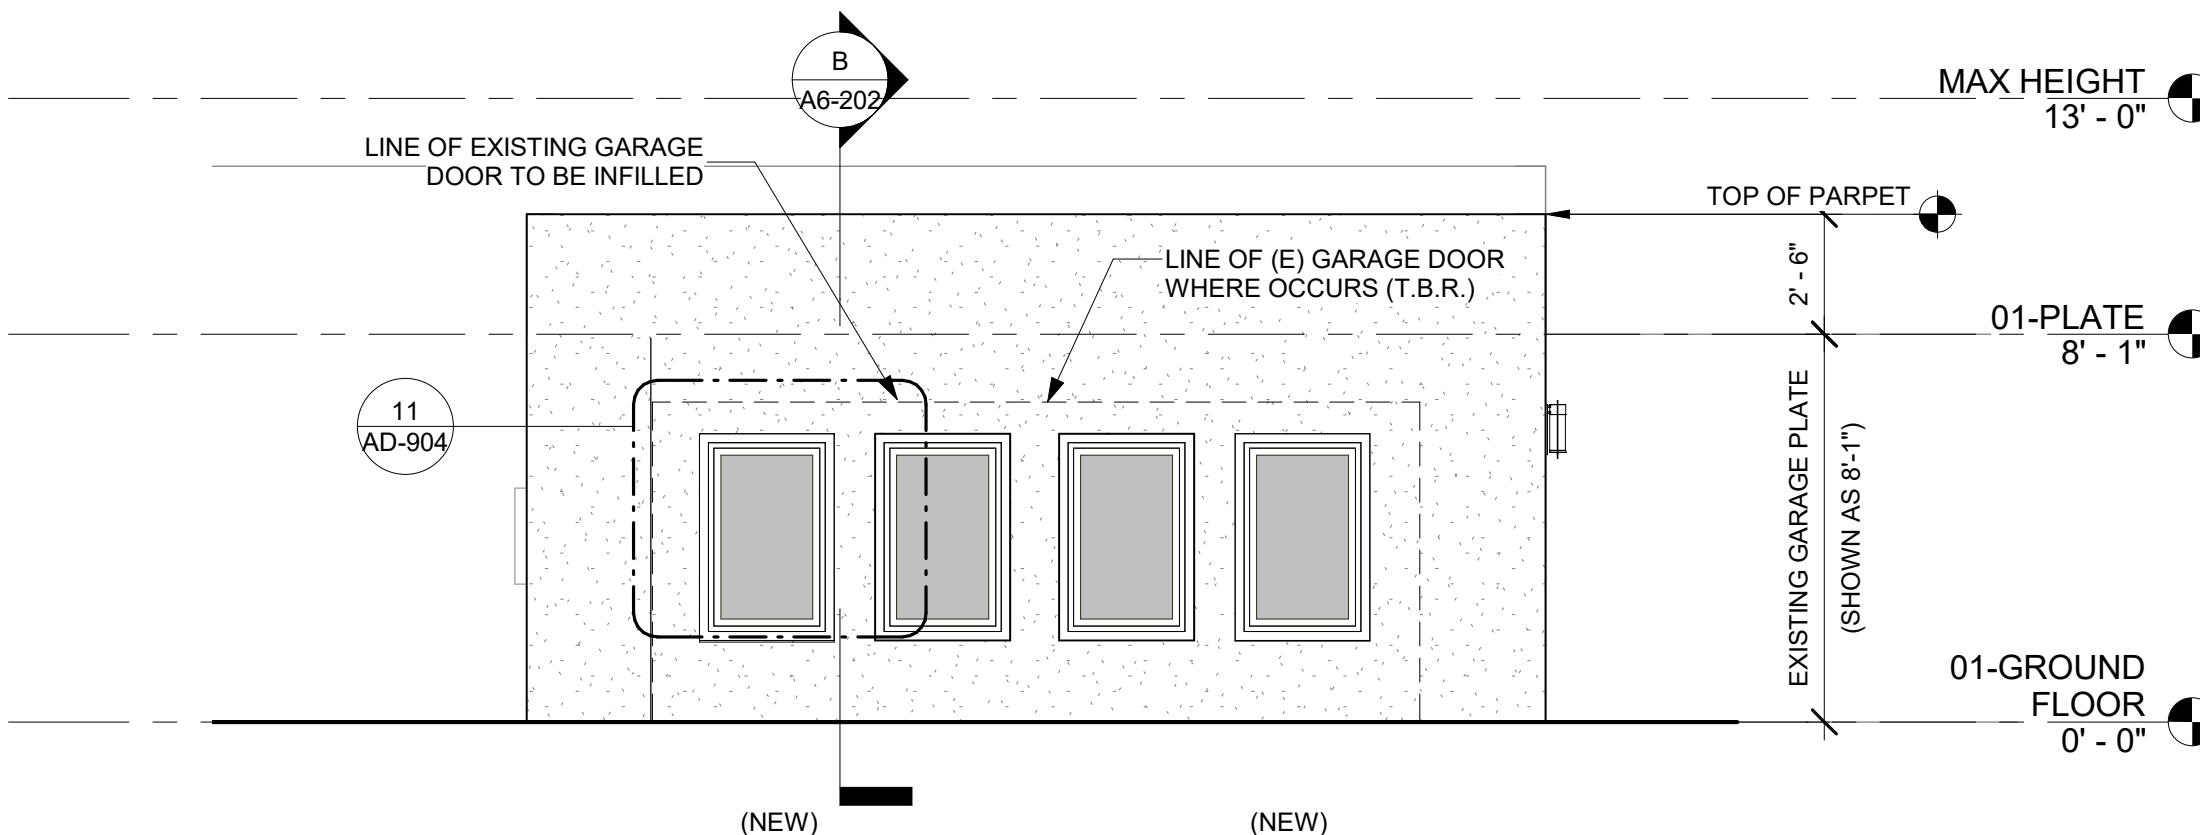

GENERAL NOTES

1. REFER TO GENERAL NOTES SHEET G-102 FOR ADDITIONAL REQUIREMENTS
2. SEE DETAILS FOR ADDITIONAL INFORMATION AND REQUIREMENTS.
3. REFER TO ROOF PLAN FOR OVERHANGS, FASCIA PER DETAILS, PROVIDE ALUMINUM GUTTER. SEE ROOF PLAN FOR APPROXIMATE DOWNSPOUT LOCATIONS, U.N.O.
4. REFER TO DOOR AND WINDOW SCHEDULES AND TYPES FOR DOOR AND WINDOW INFORMATION.
5. REFER TO PLOT PLAN FOR PLAN TYPE, ELEVATION STYLE AND COLOR SCHEME.
6. THE NOMINAL THICKNESS AND ATTACHMENT OF EXTERIOR WALL COVERINGS SHALL BE IN ACCORDANCE WITH CRC TABLE R703.3(1).
7. ANCHORED VENEER, BRICK, CONCRETE, MASONRY OR STONE IN ACCORDANCE WITH CRC R703.8
8. ADHERED VENEER, CONCRETE, STONE OR MASONRY IN ACCORDANCE WITH CRC R703.12
9. EXTERIOR PLASTER (STUCCO) INSTALLATION SHALL COMPLY WITH THE PROVISIONS OF CRC R703.7 AND COMPLIANCE WITH ASTM C926 AND ASTM C1063, STANDARD SPECIFICATIONS FOR INSTALLATION OF LATHING AND FURRING TO RECEIVE INTERIOR AND EXTERIOR PORTLAND CEMENT-BASED PLASTER, INCLUDING INSTALLATION OF CONTROL JOINTS.
10. GYPSUM SHEATHING SHALL BE ATTACHED TO EXTERIOR WALLS IN ACCORDANCE WITH CRC TABLE R602.3.
11. CLADDING ATTACHMENT OVER FOAM SHEATHING TO WOOD FRAMING IN ACCORDANCE WITH CRC R703.15. REFER TO CRC R703.8 FOR ANCHORED MASONRY OR STONE VENEER INSTALLED OVER FOAM SHEATHING.

KEYNOTES

- B14 50 GALLON TANK TYPE ELECTRIC WATER HEATER. REFER TO TITLE 24 FOR ADDITIONAL INFORMATION. PROVIDE CONCRETE PAD MIN. 6" LARGER THAN UNIT IN EACH DIRECTION. 3" MIN. ABOVE GRADE. STRAPPING DETAIL 51/AD-902.
- B18 ELECTRIC PANEL TBD.
- B38 MULTI-ZONE HEAT PUMP CONDENSING UNIT. REFER TO PLANS FOR LOCATION OF INDOOR FAN FAN COIL UNITS. REFER TO TITLE 24 FOR ADDITIONAL INFORMATION. PROVIDE CONCRETE PAD MIN. 6" LARGER THAN UNIT IN EACH DIRECTION, 3" MIN. ABOVE GRADE.
- L14 EXTERIOR LIGHT SCHEME B. DARK SKY AND TITLE 24 COMPLIANT.
- S04 2X8 WALL INSULATION. REFER TO TITLE 24 (R-21 MIN.)
- U06 CONCRETE SLAB FOUNDATION PER STRUCTURAL. 10 MIL VAPOR RETARDER CONFORMING TO ASTM E1745 CLASS A REQUIREMENTS.
- U07 LEVEL EXISTING FLOOR SLAB

VENTING REQUIRED

ROOF VENTILATION - REQUIRED - 2 CAR GARAGE CONVERSION			
ATTIC ZONE	AREA	FACTOR	REQUIRED SI
ATTIC-2 CAR GARAGE CONVERSION	441 SF	0.0033	212 in ²

VENTING PROPOSED

ATTIC ZONE	NUMBER	VENT TYPE	FREE AREA
2 CAR GARAGE CONVERSION	3	O'HAGIN FIRE & ICE	292.50 in ²
HIGH			292.50 in ²
			292.50 in ²

LEGEND

NOTE: EXTERIOR WALL COVERINGS SHALL BE EITHER A NON-COMBUSTIBLE MATERIAL, AN IGNITION RESISTANT MATERIAL, OR OTHERWISE COMPLY WITH THE REQUIREMENTS SET FORTH IN THE 2022 CRC SECTION R337.7.

- EXISTING WALL COVERING
- NEW EXTERIOR FINISH AND COLOR TO MATCH THAT OF PRINCIPAL DWELLING
- 10'-0" HEIGHT OF TOP OF ROOFING SURFACE (INCLUDING CRICKETS AND INSULATION)
- 1/2" / 1'-0" ROOF SLOPE (REFER TO ROOF PLAN FOR ACTUAL SLOPE)
- ROOF VENT - O'HAGIN FIRE & ICE LINE - FLAME AND EMBER RESISTANT VENT (CRC R337 COMPLIANT)
 - S-TILE OR COMPOSITE SHINGLE TYPE PER EXISTING ROOF TYPE
- EXISTING ROOFING MATERIAL



THESE PLANS ARE PROVIDED BY THE CITY OF AGOURA HILLS AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRACT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.


PROTOTYPE ADU
2 CAR GARAGE CONVERSION
COACHELLA, CA
EXT. ELEVATIONS & SECTIONS -
PLAN 6 - MODERN

PUBLIC SET
DATE
01/11/24
SHEET

A6-202

1/19/2024 8:55:04 AM
Autodesk Docs\12309_Coachella ADU\22939-01_Coachella ADUs_Garage Unit.rvt

U 356

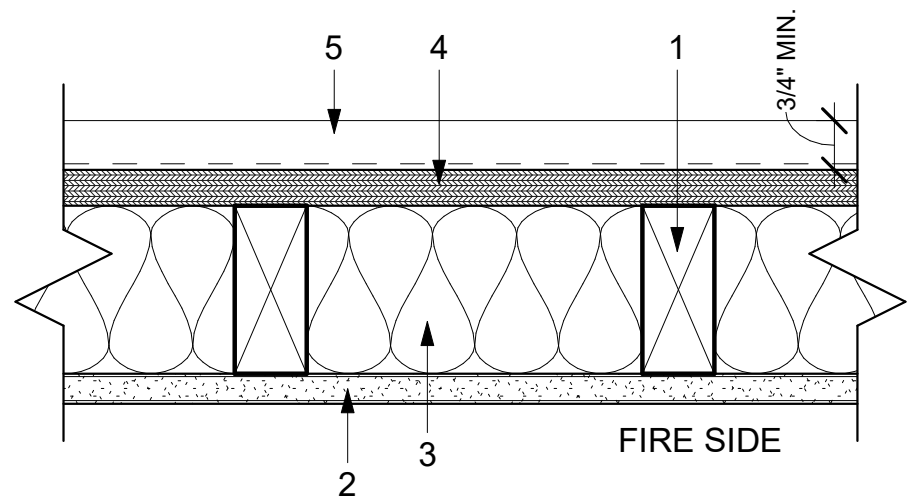


WOOD STUDS, GYPSUM BOARD AND CEMENT STUCCO

- 1. WOOD STUDS**
NOMINAL 2X4 SPACED 16" O.C. WITH (2) 2X4 TOP PLATES (1) 2X4 BOTTOM PLATE. STUDS Laterally-braced by wood structural panel sheathing (item 5) and effectively fire stopped at top and bottom of wall.
- 2. GYPSUM BOARD**
ANY CLASSIFIED 5/8" THICK, 48" WIDE, APPLIED VERTICALLY AND NAILED TO STUDS AND BEARING PLATES 7" O.C. WITH 6D CEMENT-COATED NAILS, 1 7/8" LONG WITH 1/4" DIAM. HEAD.
- JOINTS AND NAILHEADS (NOT SHOWN) - WALLBOARD JOINTS COVERED WITH TAPE AND JOINT COMPOUND. NAIL HEADS COVERED WITH JOINT COMPOUND.
- 3. BATTS AND BLANKETS**
MINERAL FIBER OR GLASS INSULATION, 3 1/2" THICK. PRESSURE FIT TO FILL WALL CAVITIES BETWEEN STUDS AND PLATES. MINERAL FIBER INSULATION TO BE UNFACED AND TO HAVE A MIN. DENSITY OF 3 PCF. GLASS FIBER INSULATION TO BE FACED WITH ALUMINUM FOIL OR FRAFT PAPER AND TO HAVE A MIN. DENSITY OF 0.9 PCF (MIN. R-13 THERMAL INSULATION RATING). FIBER SPRAYED - AS AN ALTERNATE TO BATTS AND BLANKETS (ITEM 4) - SPRAY APPLIED CELLULOSE INSULATION MATERIAL. THE FIBER IS APPLIED WITH WATER TO COMPLETELY FILL THE ENCLOSED CAVITY IN ACCORDANCE WITH THE APPLICATION INSTRUCTIONS SUPPLIED WITH THE PRODUCT. NOMINAL DRY DENSITY OF 3.0 LB/CU.FT.
- 4. WOOD STRUCTURAL PANEL SHEATHING**
MIN 7/16" THICK, 4 FT. WIDE WOOD STRUCTURAL PANELS, MIN. GRADE "C-D" OR "SHEATHING", INSTALLED WITH LONG DIMENSION OF SHEET (STRENGTH AXIS) OR FACE GRAIN OF PLYWOOD PARALLEL WITH OR PERPENDICULAR TO STUDS. VERTICAL JOINTS CENTERED ON STUDS. HORIZONTAL JOINTS BACKED WITH NOMINAL 2X4 WOOD BLOCKING. ATTACHED TO STUDS ON EXTERIOR SIDE OF WALL WITH 6D CEMENT COATED BOX NAILS SPACED 6" O.C. AT PERIMETER OF PANELS AND 12" O.C. ALONG INTERIOR STUDS.
- 5. EXTERIOR FACING**
INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTION. ONE OF THE FOLLOWING EXTERIOR FACINGS IS TO BE APPLIED OVER THE SHEATHING. REFER TO PLAN FOR INFORMATION:
- D. CEMENTITIOUS STUCCO - PORTLAND CEMENT OR SYNTHETIC STUCCO SYSTEM WITH SELF-FURRING METAL LATH OR ADHESIVE BASE COAT. THICKNESS FROM 3/8" TO 3/4", DEPENDING ON SYSTEM.
- H. FIBER-CEMENT SIDING - FIBER-CEMENT EXTERIOR SIDING INCLUDING SMOOTH AND PATTERNED PANEL OR LAP SIDING.

UL DES U305

NOTE:
AT INTERIOR WALL USE:
5/8" SHEETROCK FIRECODE CORE PANELS,
5/8" SHEETROCK ULTRAUGHT PANELS FIRE CODE X OR
5/8" FIBEROCK PANELS -
2 X 4 WOOD STUD 16" OR 24" O.C.

XHEZ.W-L-1166

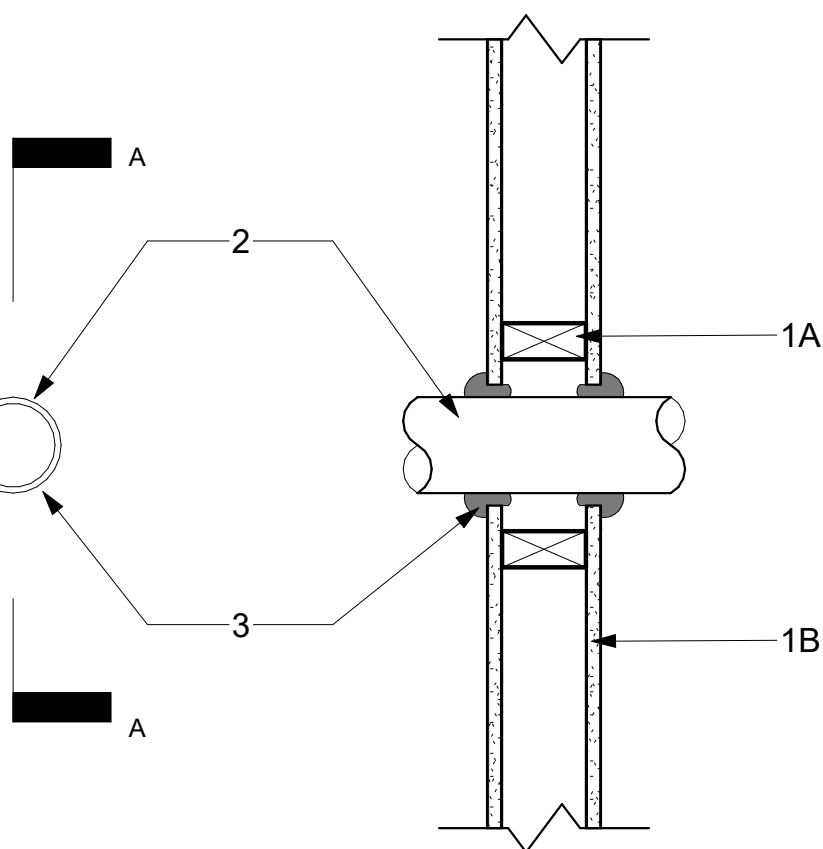


WALL SYSTEM PENETRATION
F RATING - 1 AND 2 HR (SEE ITEM 1B)
T RATING - 0 HR

- 1. WALL ASSEMBLY**
THE 1 OR 2 HR. FIRE RATED GYPSUM WALLBOARD/STUD WALL ASSEMBLY SHALL BE CONSTRUCTED OF THE MATERIALS AND IN THE MANNER SPECIFIED IN THE INDIVIDUAL U300 OR U400 SERIES WALL AND PARTITION DESIGNS IN THE UL FIRE RESISTANCE DIRECTORY AND SHALL INCLUDE THE FOLLOWING CONSTRUCTION FEATURES:
- A. STUDS-
WALL FRAMING MAY CONSIST OF EITHER WOOD STUDS OR STEEL CHANNEL STUDS. WOOD STUDS TO CONSIST OF NOM. 2 IN. BY 4 IN. LUMBER SPACED 16 IN. O.C. STEEL STUDS TO BE MIN. 3 1/2 IN. WIDE AND SPACED MAX. 24 IN. O.C.
- B. GYPSUM BOARD (BEARING THE UL CLASSIFICATION MARKING)-
THICKNESS, TYPE, NUMBER OF LAYERS AND FASTENERS AS REQUIRED IN THE INDIVIDUAL WALL AND PARTITION DESIGN. MAX. DIAM. OF OPENING IS 5 IN.
- THE HOURLY F RATING OF THE FIRESTOP SYSTEM IS EQUAL TO THE HOURLY FIRE RATING OF THE WALL ASSEMBLY IN WHICH IT IS INSTALLED.
- 2. THROUGH- PENETRANTS**
ONE METALLIC PIPE, CONDUIT OR TUBING INSTALLED EITHER CONCENTRICALLY OR ECCENTRICALLY WITHIN THE FIRESTOP SYSTEM. THE ANNULAR SPACE BETWEEN THE PIPE, CONDUIT OR TUBING AND PERIPHERY OF THE OPENING SHALL BE MIN. OF 0 IN. (POINT CONTACT) TO A MAX. 1/8 IN. PIPE, CONDUIT OR TUBING TO BE RIGIDLY SUPPORTED ON BOTH SIDES OF WALL ASSEMBLY. THE FOLLOWING TYPES AND SIZES OF METALLIC PIPES, CONDUITS OR TUBING MAY BE USED:
- A. COPPER TUBING-
NOM. 4 IN. DIAM. (OR SMALLER) TYPE M (OR HEAVIER) COPPER TUBING.
- B. COPPER PIPE-
NOM. 4 IN. DIAM. (OR SMALLER) REGULAR (OR HEAVIER) COPPER PIPE.
- C. STEEL PIPE-
NOM. 4 IN. DIAM. (OR SMALLER) SCHEDULE 5 (OR HEAVIER) STEEL PIPE.
- D. CONDUIT-
NOM. 4 IN. DIAM. (OR SMALLER) STEEL ELECTRICAL METALLIC OR RIGID STEEL CONDUIT
- E. IRON PIPE-
NOM. 4 IN. DIAM. (OR SMALLER) CAST OR DUCTILE IRON PIPE.
- 3. FILL, VOID OR CAVITY MATERIALS** (BEARING THE UL CLASSIFICATION MARKING) -
CAULK OR PUTTY-MIN. 1/2 IN. DIAMETER BEAD CAULK OR PUTTY APPLIED CONTINUOUSLY AROUND THE PENETRANT ON THE WALL SURFACES ON BOTH SIDES OF THE WALL.
- 3M COMPANY - CP 25WB+ CAULK OR MPS-2+ PUTTY


43 THROUGH PENETRATION @ WALL1

SCALE: 1 1/2" = 1'-0"

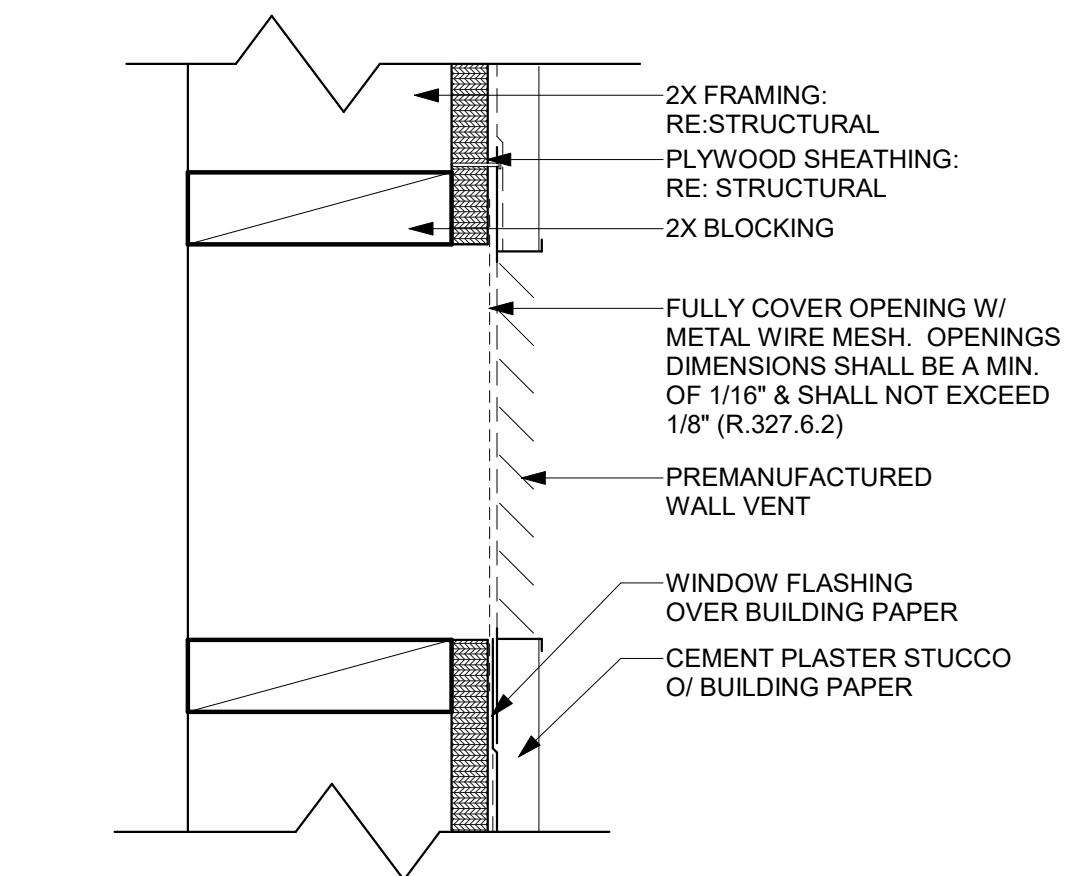


31 WALL VENT

SCALE: 3" = 1'-0"

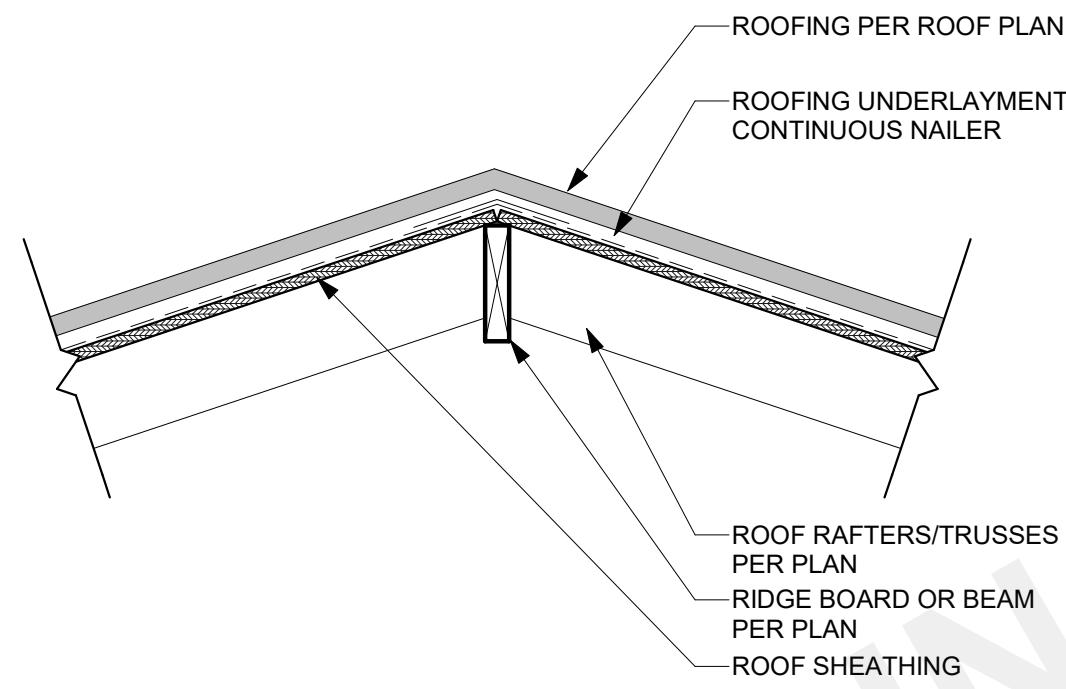


32 HIP/RIDGE

SCALE: 1" = 1'-0"

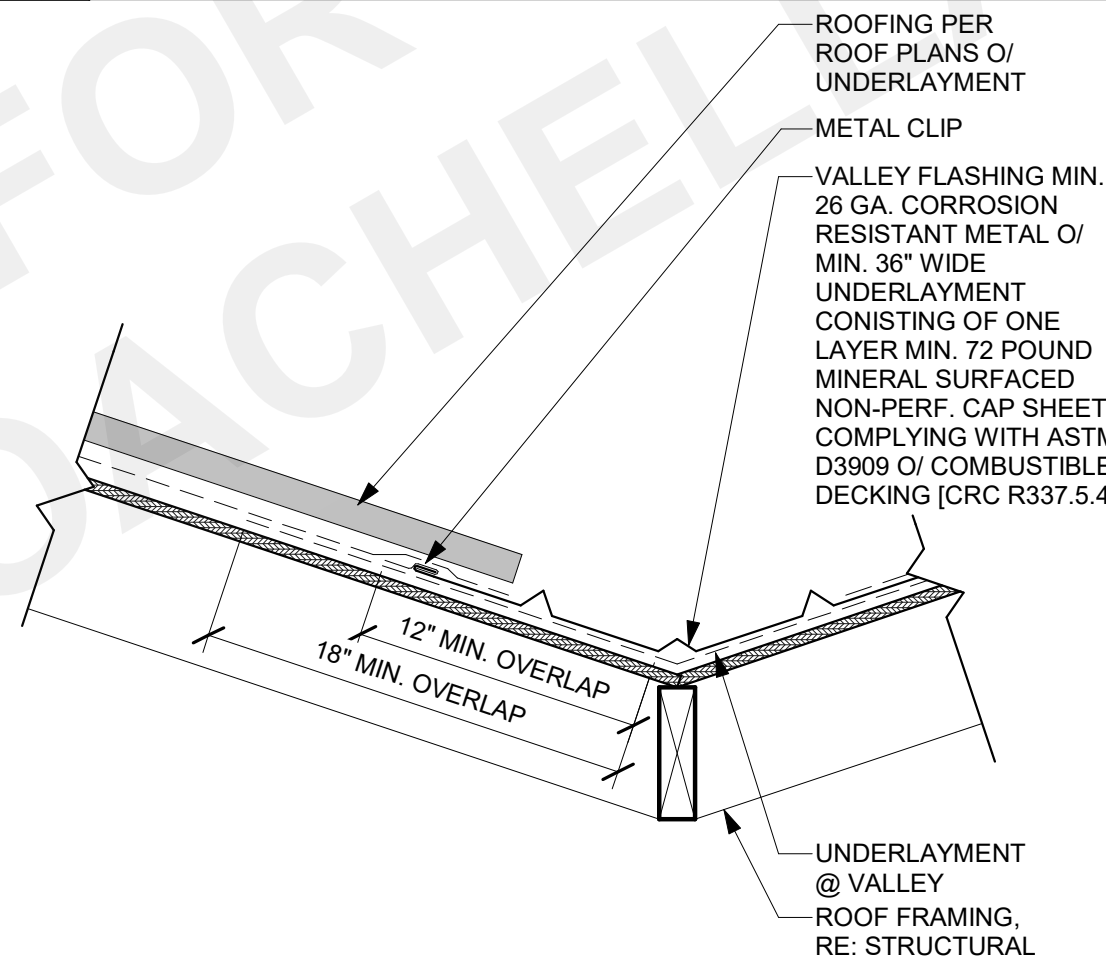


33 VALLEY FLASHING

SCALE: 1 1/2" = 1'-0"

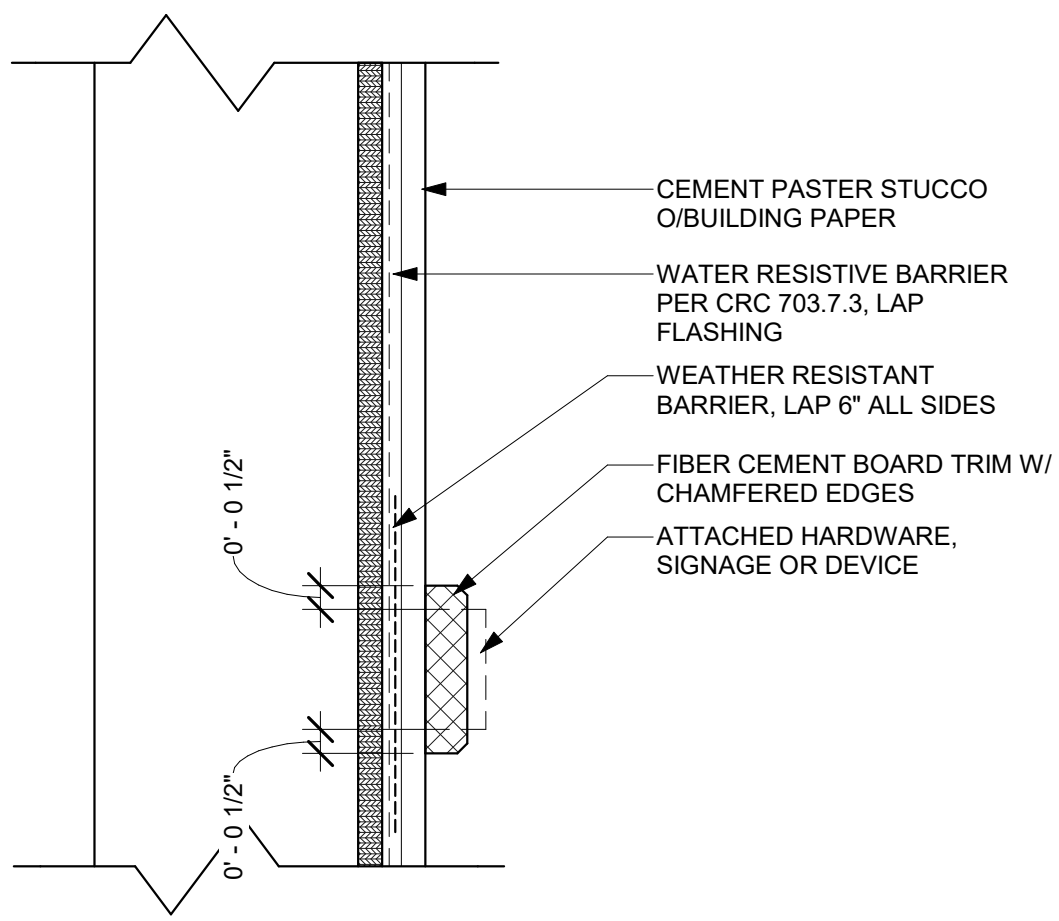

21 MOUNTING PAD


SCALE: 3" = 1'-0"

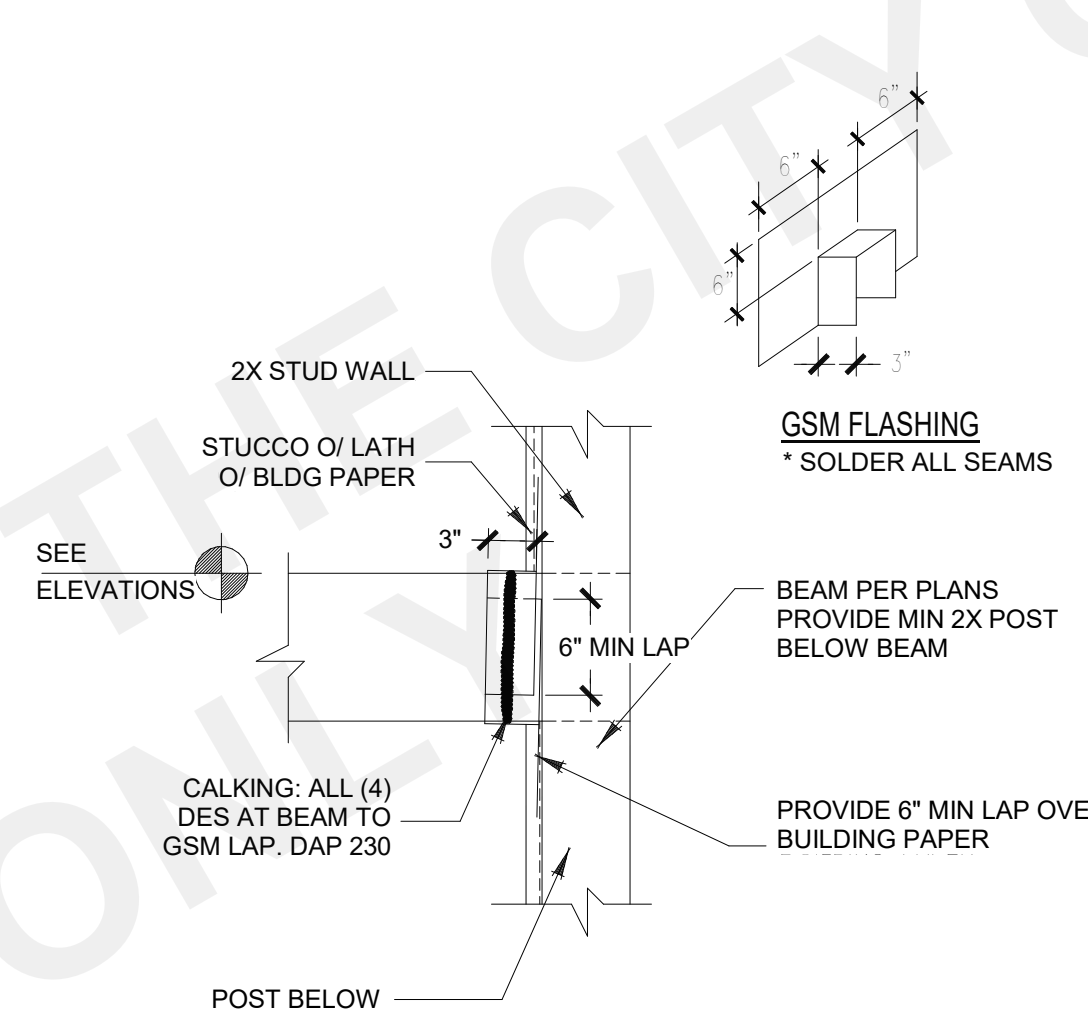

NOTE:
* NO NAILS THROUGH GSM INTO BEAM
* NO NAILS SHALL PENETRATE GSM WITHIN 2" OF BEAM

23 BEAM TO WALL FLASHING

SCALE: 1" = 1'-0"

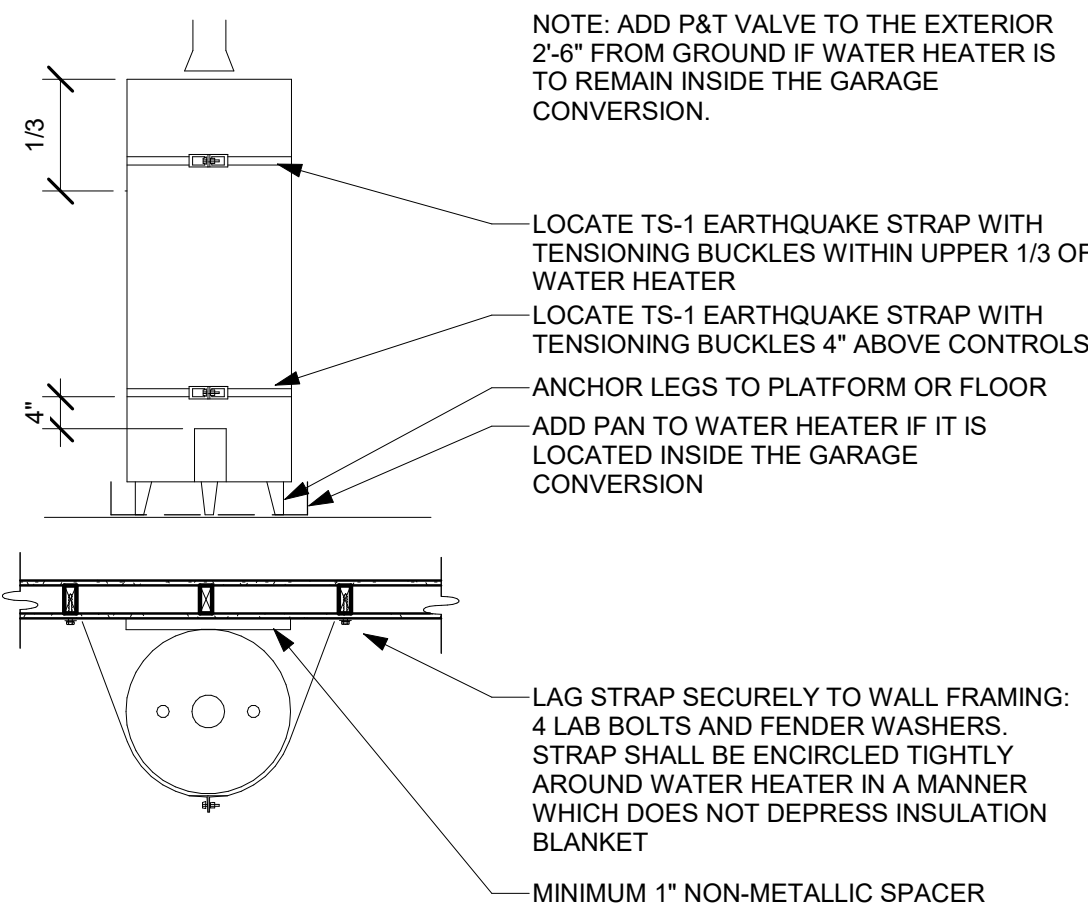


24 WATER HEATER MOUNTING

SCALE: 1/2" = 1'-0"

- FLASH'G PAPER, MOISTOP FLASHING OR EQUAL, (9" WIDE MIN.) O/ NAIL'G FIN @ TOP OF WINDOWS (HEAD) TYP. TWO CONTINUOUS BEADS OF MOISTOP SEALANT OR EQUAL UNDER FLASH'G PAPER (1) O/ NAIL'G FIN AND (1) AT TOP OF FLSH'G PAPER TYP NAIL'G
- FLASH'G PAPER, MOISTOP FLASHING OR EQUAL, (9" WIDE MIN.) O/ WOOD FRM'G & UNDER NAIL'G FIN @ SIDE OF WINDOWS (JAMB) TYP.
- 1 = INDICATES SEQUENCE FOR INSTALLATION.
 - 9" MOIST STOP FLASHING PAPER TYP. OF FLASH'G PAPER
 - THE ACTUAL NUMBER OF FLASH'G. PIECES REQUIRED IS DETERMINED BY THE RADIUS OF THE OPEN'G AND THE SIZE OF THE FLASH'G. (9" WIDE FLASH'G MIN.)
 - APPLY A CONTINUOUS BEAD OF SEALANT COMPLYING WITH AAMA 800 TO THE BACKSIDE (INTERIOR) OF THE WINDOW MOUNTING FLANGES
 - AT WINDOW HEAD, JAMBS AND SILL ALL CORROSIVE RESISTANT FASTENERS ARE TO BE NAILED THROUGH FIN NO CLOSER THAN 3" O.C. AND NOT MORE THAN 16" O.C. FASTENERS SHALL BE WITHIN 10" FROM CORNERS.
 - NO NAILS SHALL BE BENT OVER THE NAILING FIN TO SECURE WINDOW
- REFER TO AAMA 2400-10 STANDARD PRACTICEW FOR INSTALLATION OF WINDOWS WITH MOUNTING FLANGES IN STUD CONSTRUCTION FOR ADDITIONAL REQUIREMENTS.

12 TYPICAL WIN FLASHING

SCALE: 1/2" = 1'-0"

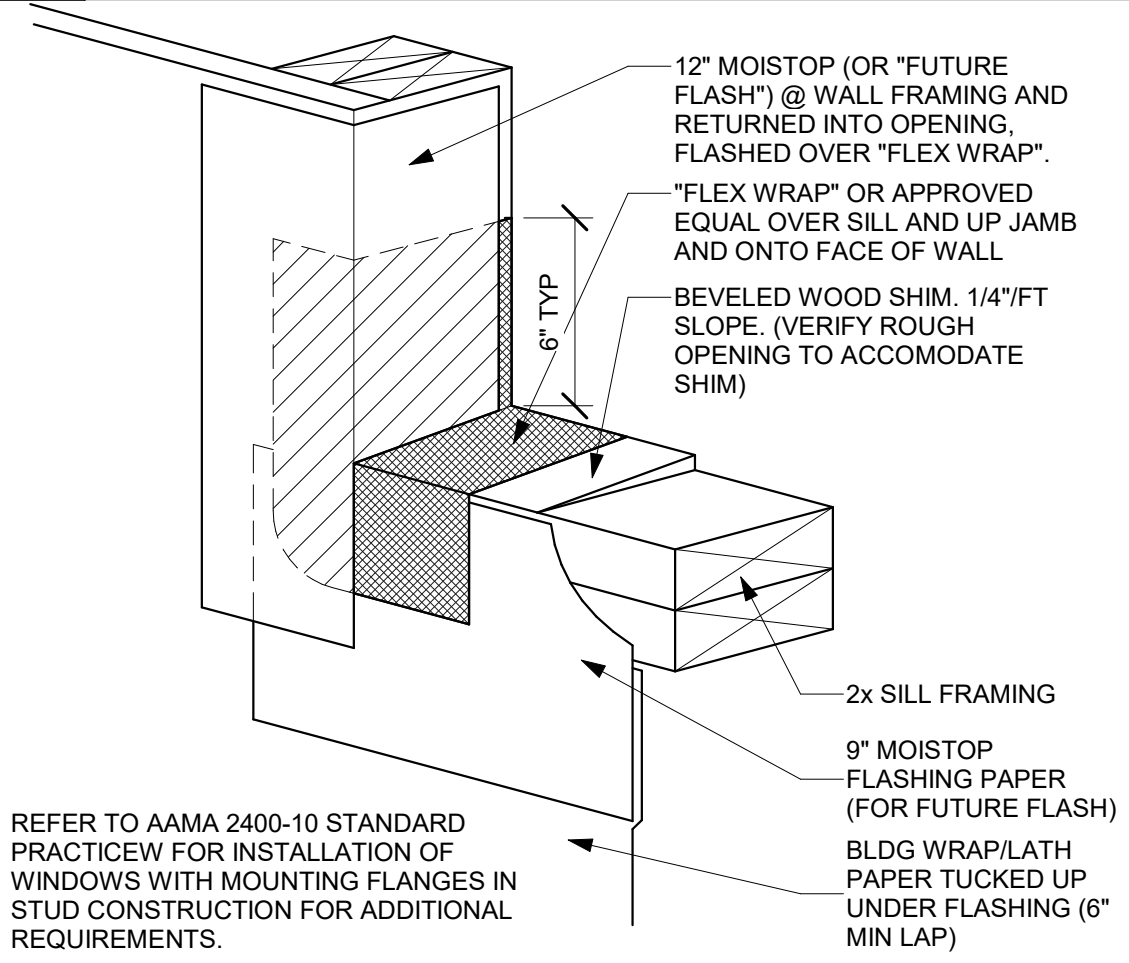


REFER TO AAMA 2400-10 STANDARD PRACTICEW FOR INSTALLATION OF WINDOWS WITH MOUNTING FLANGES IN STUD CONSTRUCTION FOR ADDITIONAL REQUIREMENTS.

13 TYPICAL CORNER WIN FLASHING

SCALE: 1/2" = 1'-0"

53 1-HR EXT. RATED WALL ASSEMBLY

SCALE: 3" = 1'-0"

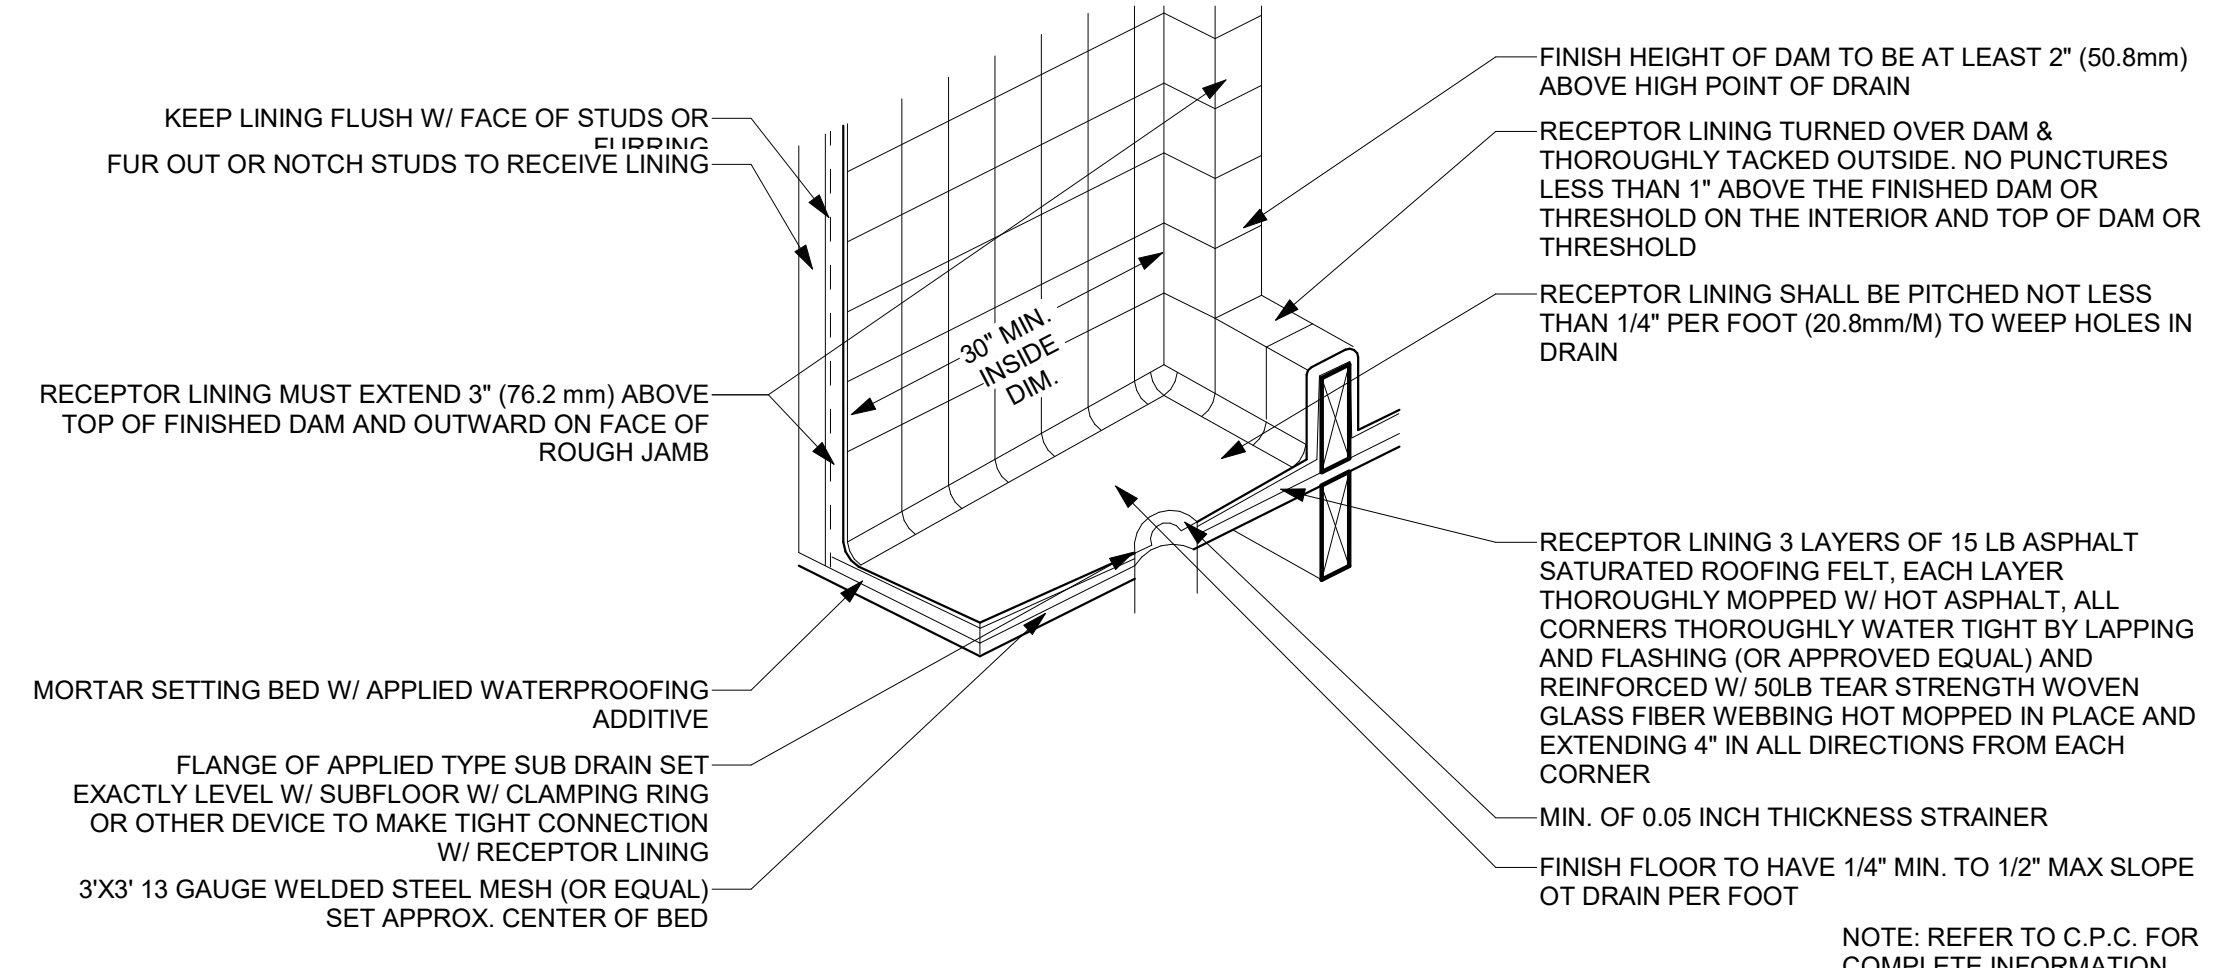

54 SHOWER - RECEPTOR

SCALE: 12" = 1'-0"



THESE PLANS ARE PROVIDED BY THE CITY OF AGOURA HILLS AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRACT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

PROTOTYPE ADU
2 CAR GARAGE CONVERSION
COACHELLA, CA


ARCHITECTURAL DETAILS -
COMMON

PUBLIC SET

DATE
01/11/24
SHEET


AD-901

1/19/2024 8:55:05 AM
Autodesk Docs\12393_Coachella ADU\2939-01_Coachella ADUs_Garage Unit.rvt

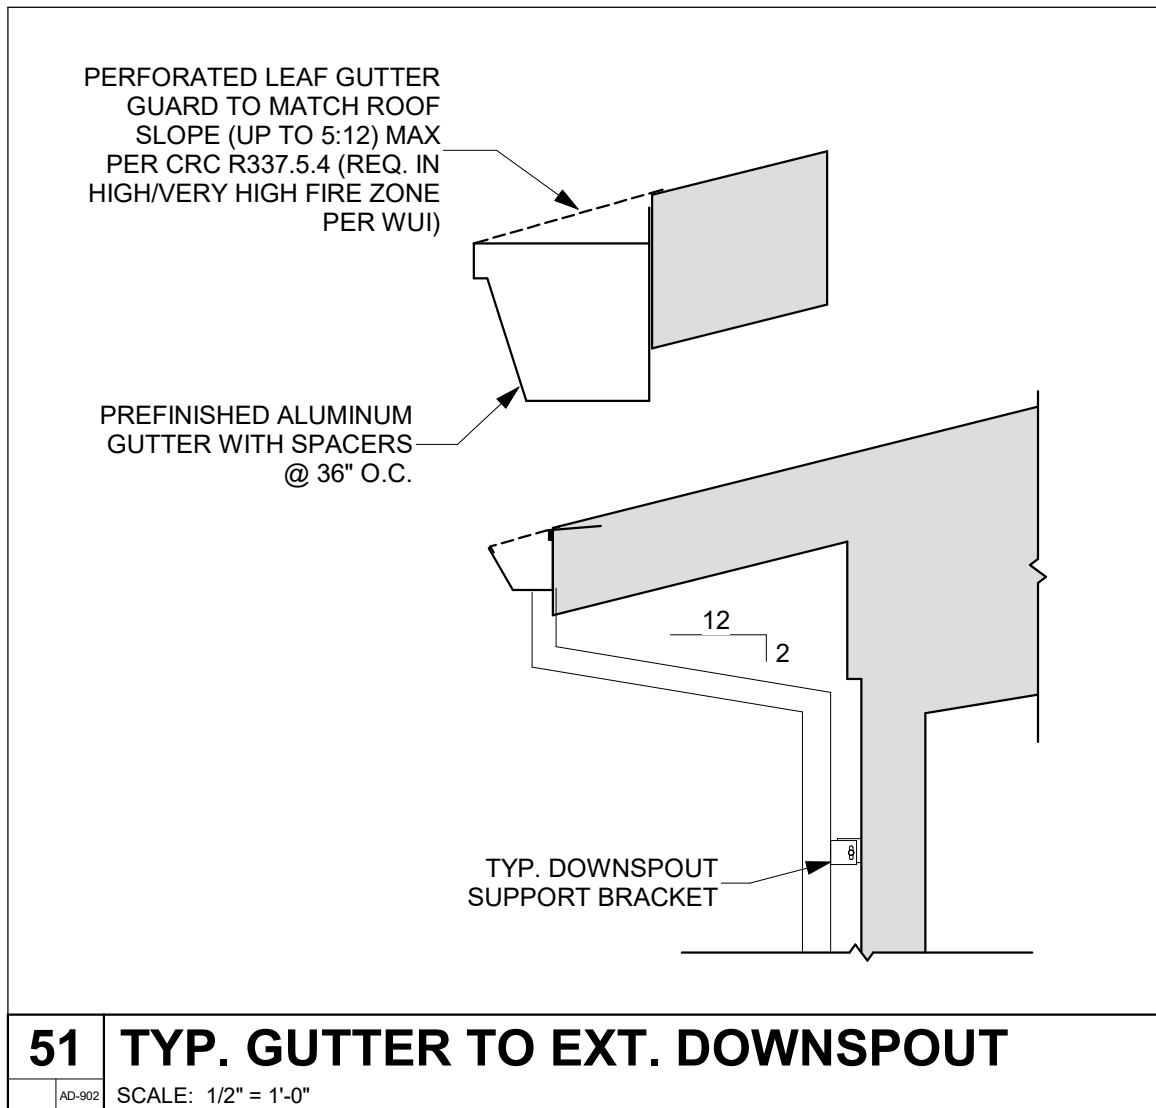


51 TYP. GUTTER TO EXT. DOWNSPOUT

SCALE: 1/2" = 1'-0"

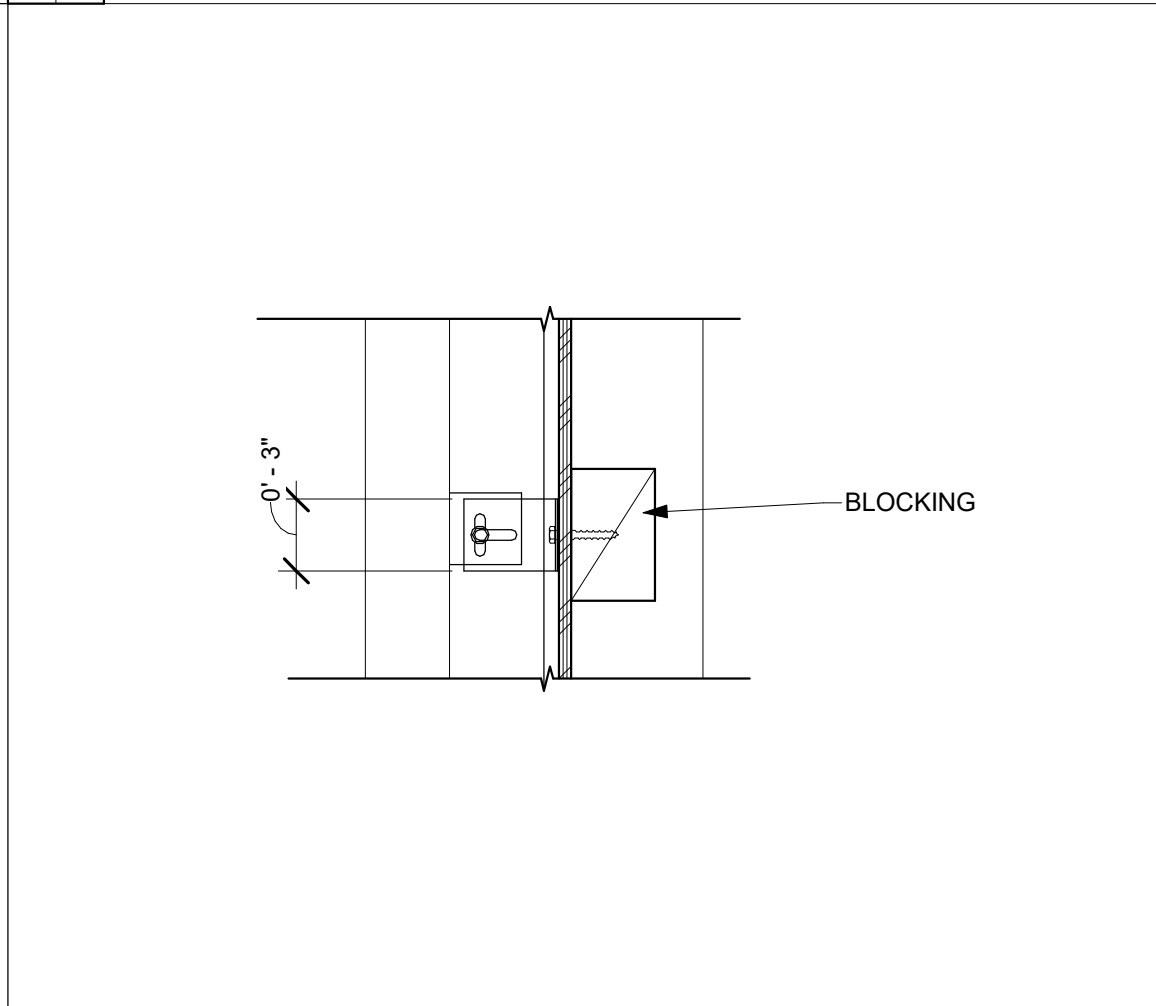


52 DOWNSPOUT ATTACHMENT

SCALE: 1 1/2" = 1'-0"

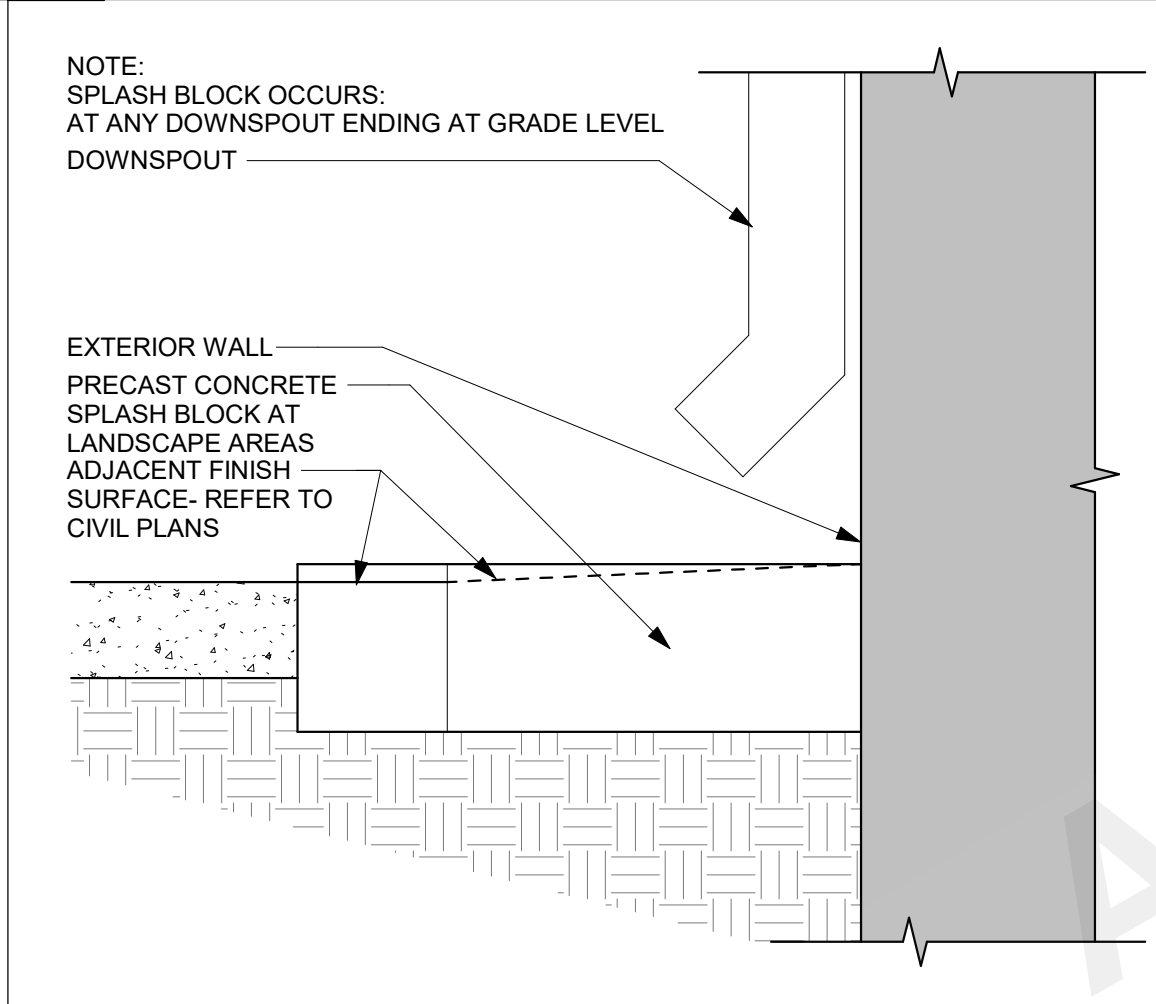


53 DOWNSPOUT TO SPLASH BLOCK

SCALE: 1 1/2" = 1'-0"




31 DOOR TRIM - SLIDING GLASS

SCALE: 3/4" = 1'-0"

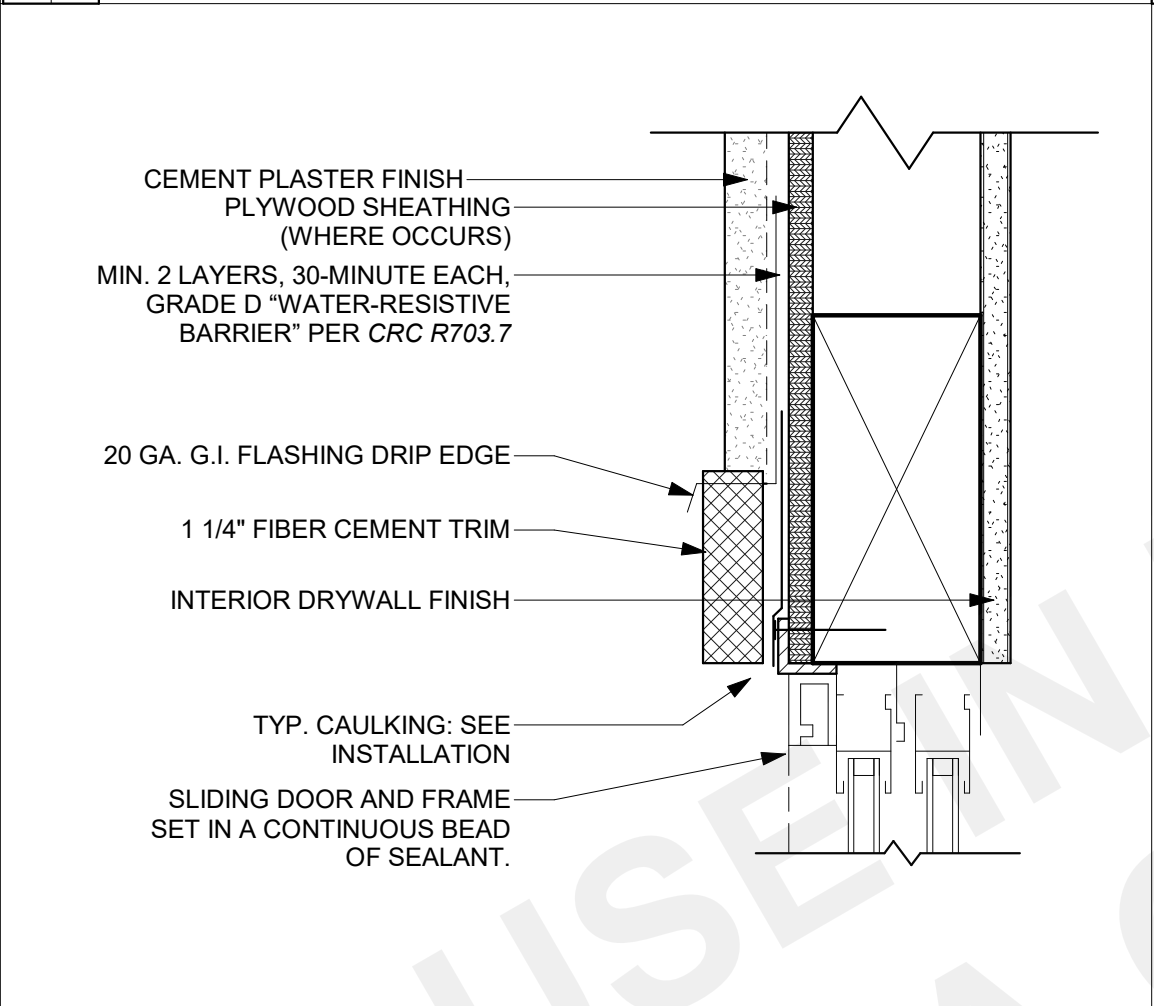


32 TYP. HEAD SLIDING GLASS DOOR

SCALE: 3" = 1'-0"

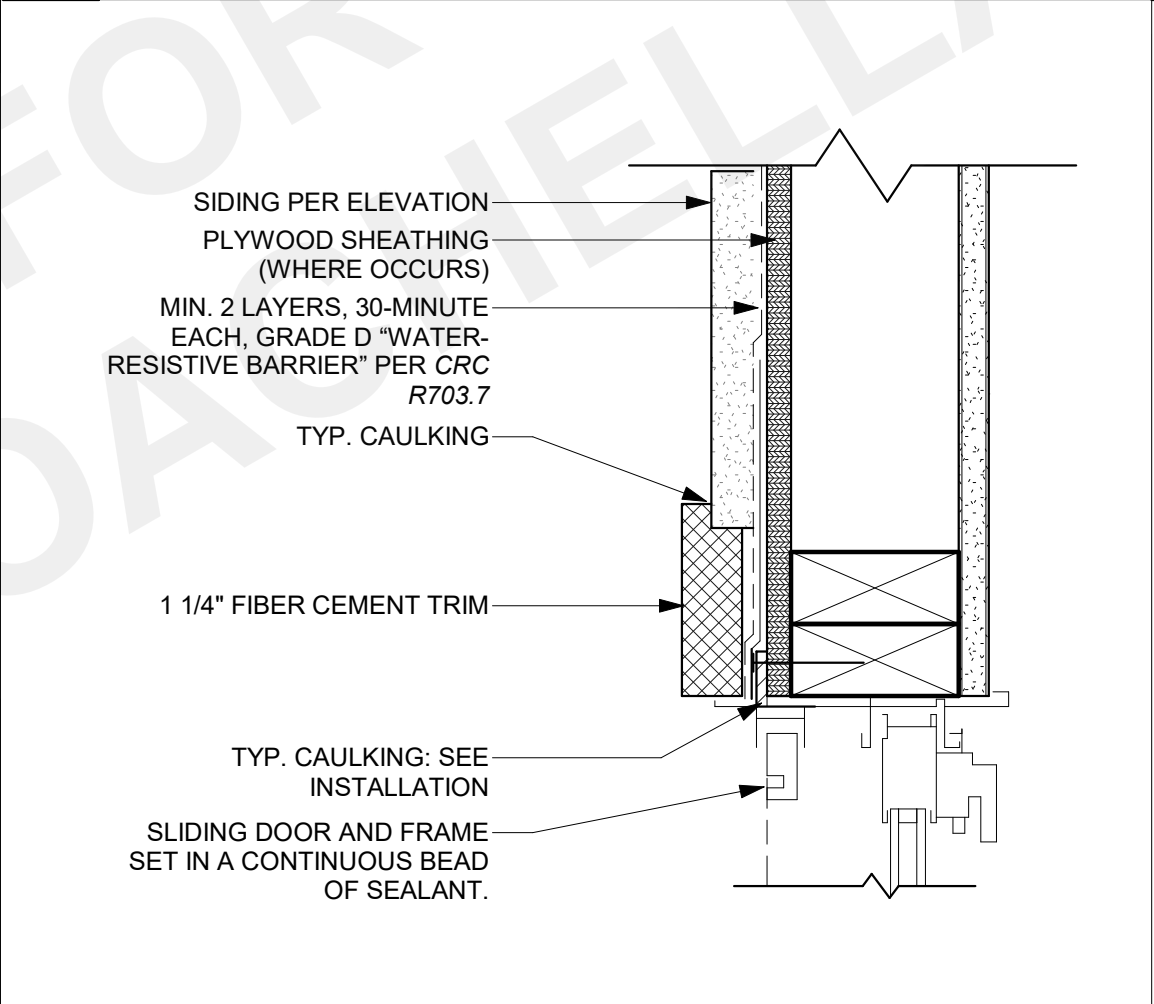


33 TYP. JAMB AT SLIDING GLASS DOOR

SCALE: 3" = 1'-0"

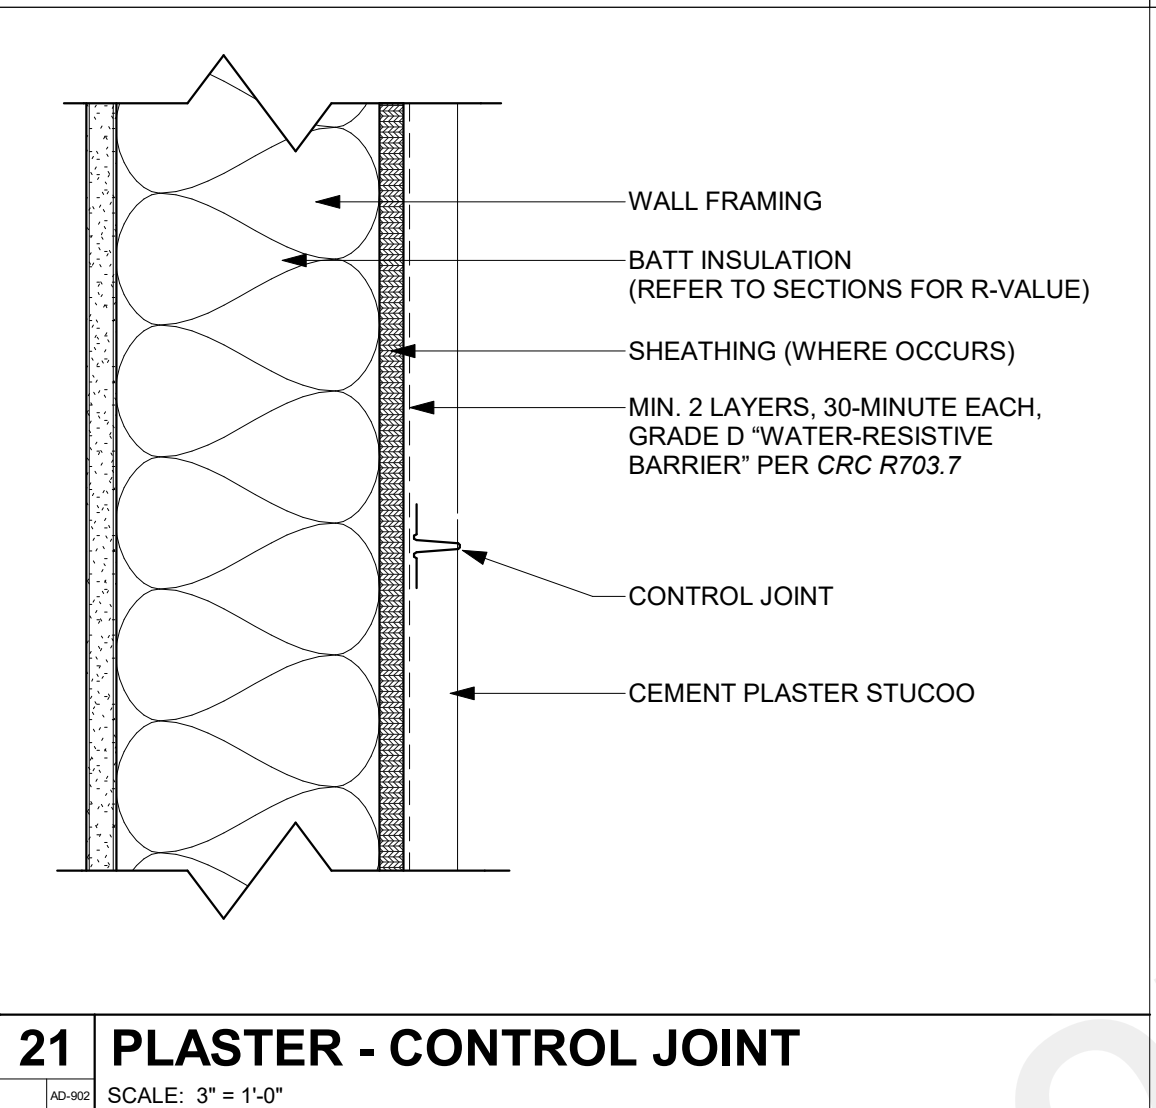


21 PLASTER - CONTROL JOINT

SCALE: 3" = 1'-0"

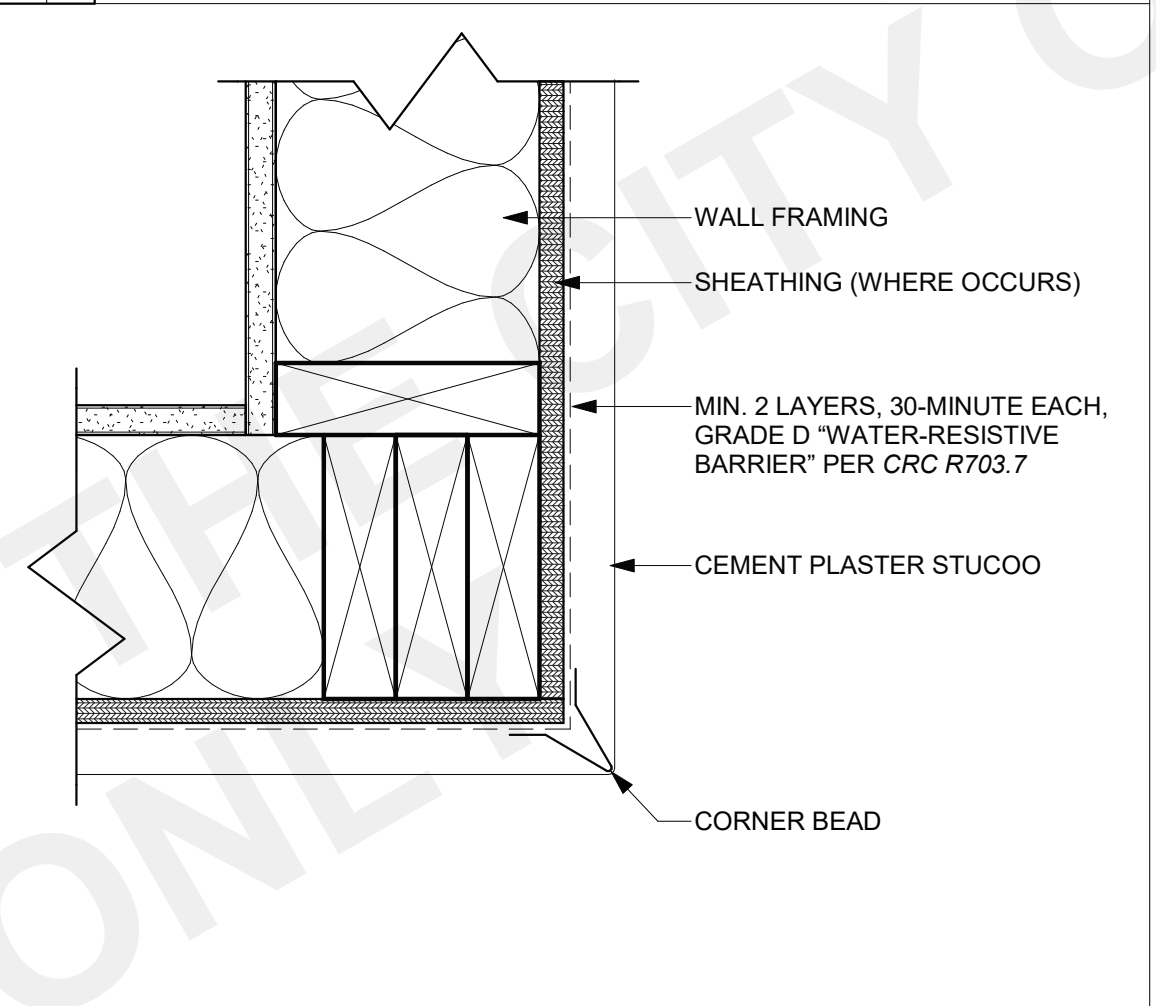


22 PLASTER - OUTSIDE CORNER

SCALE: 3" = 1'-0"

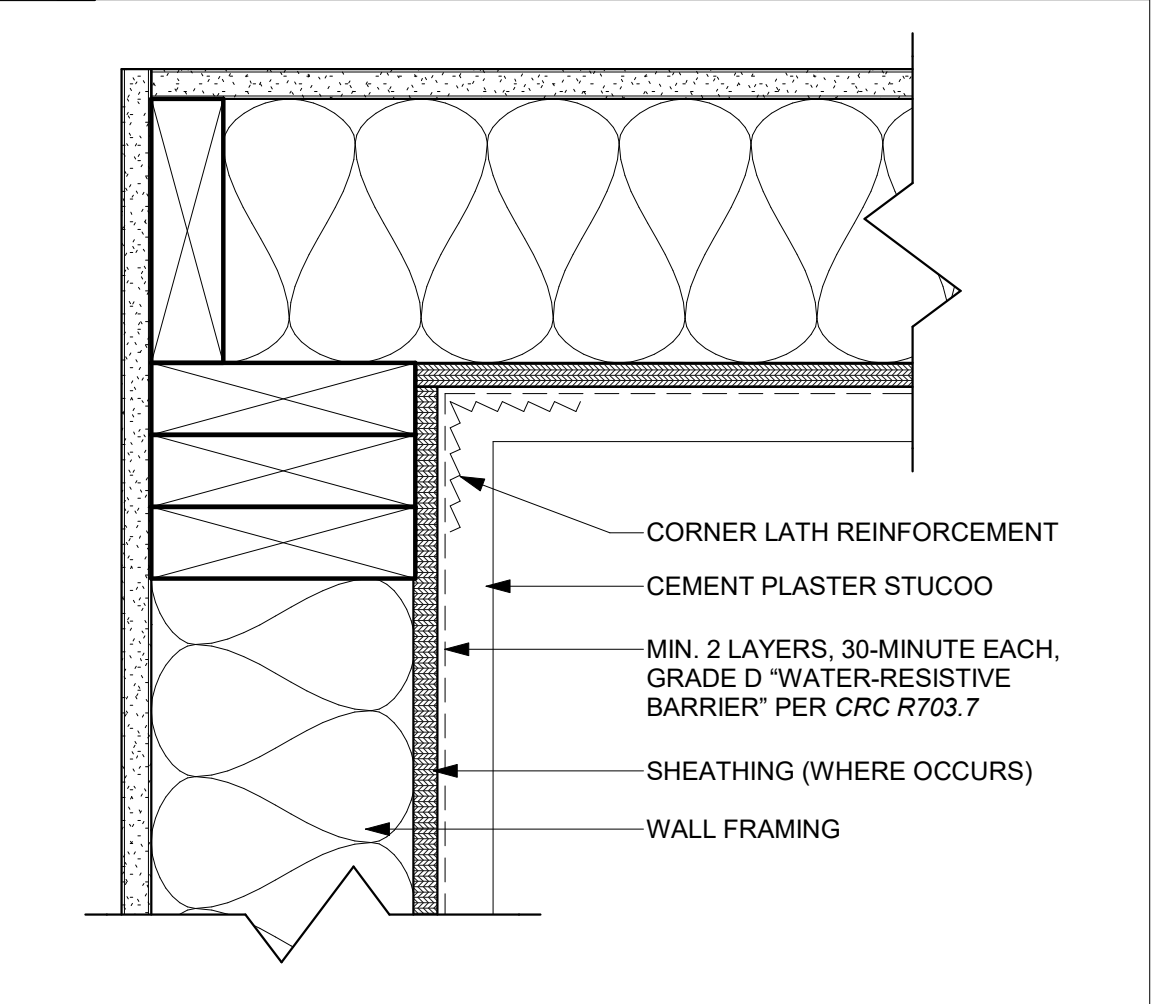


23 PLASTER - INSIDE CORNER

SCALE: 3" = 1'-0"

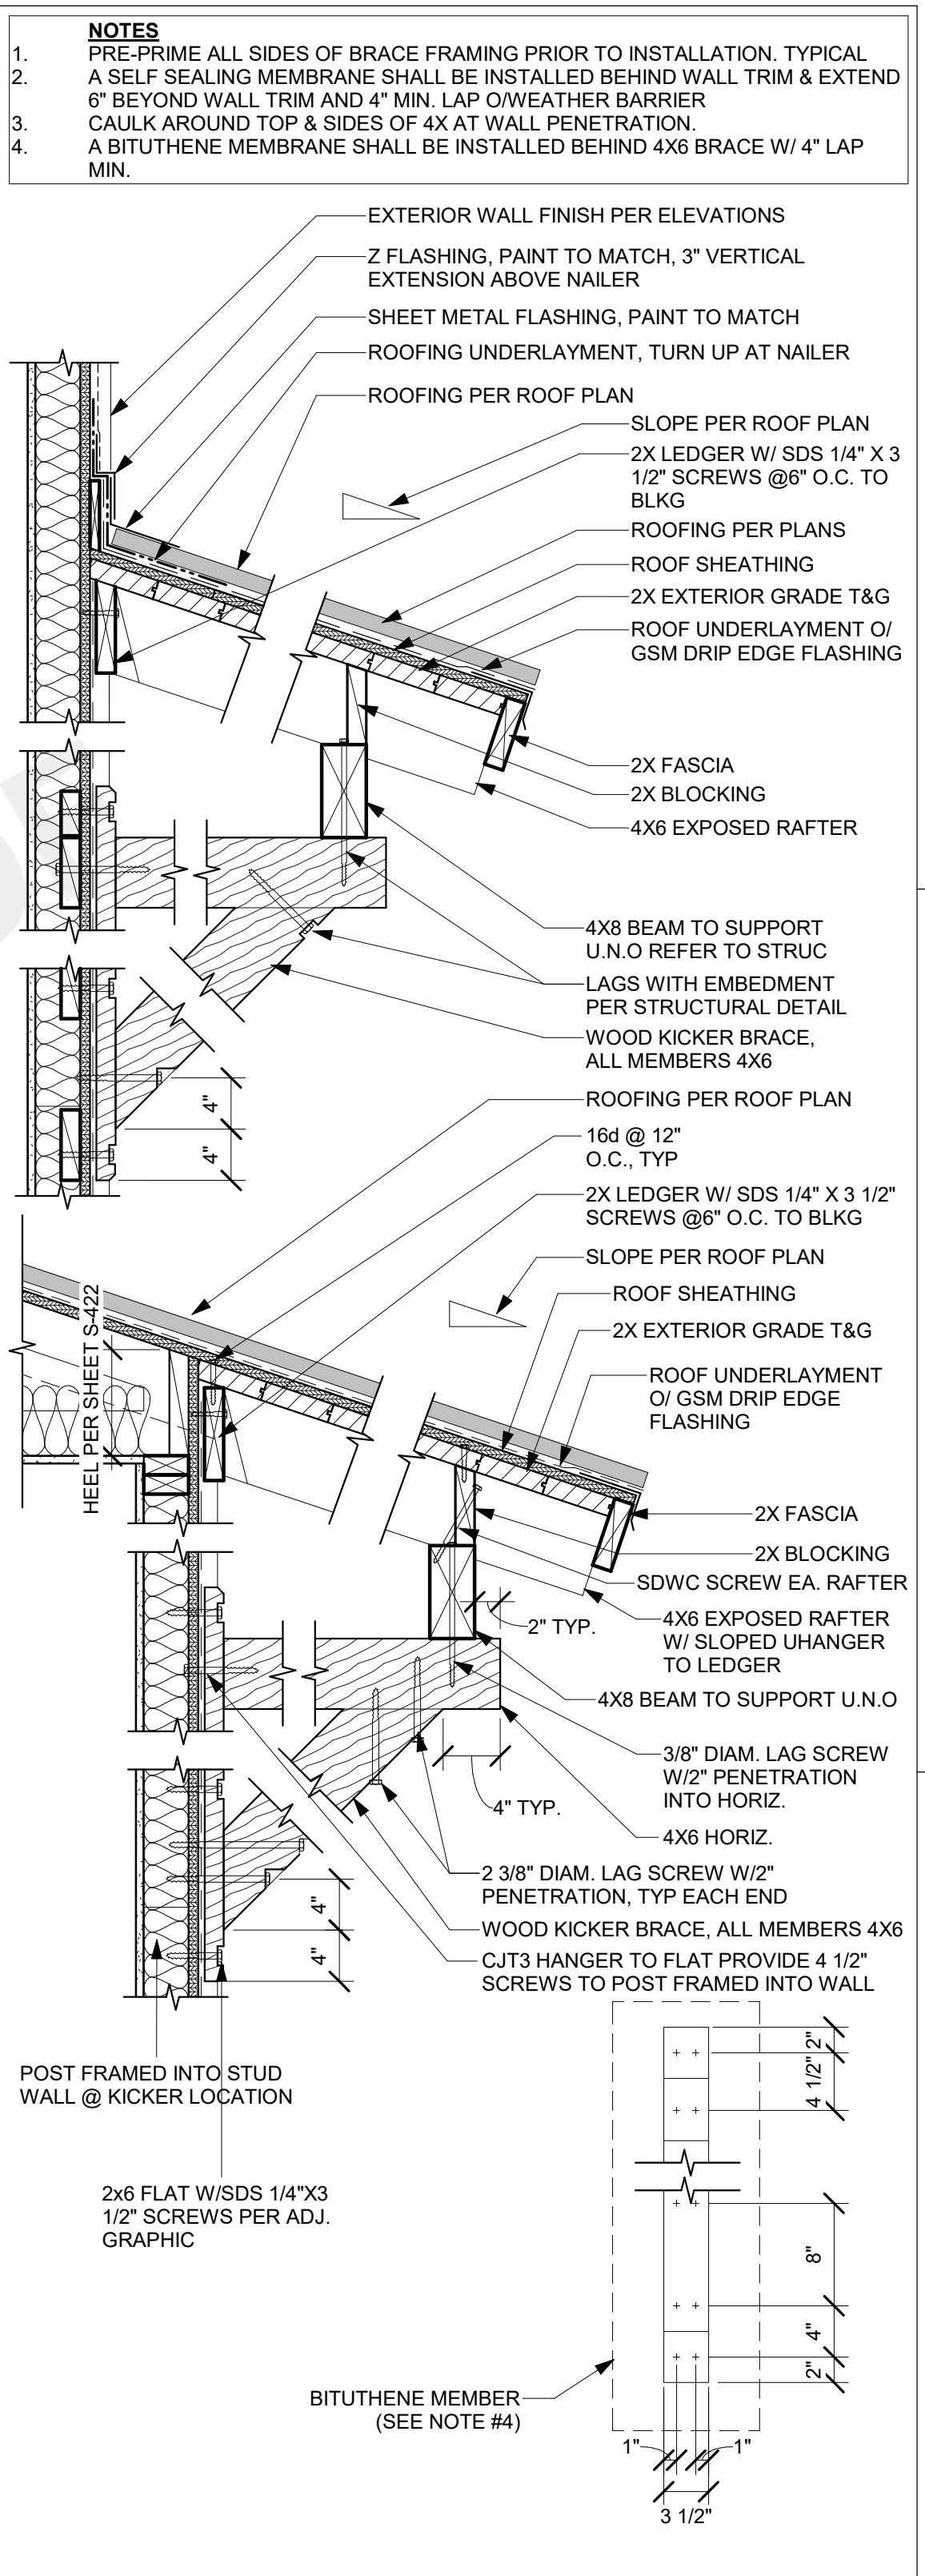


13 SHED ROOF WITH KICKER

SCALE: 1" = 1'-0"

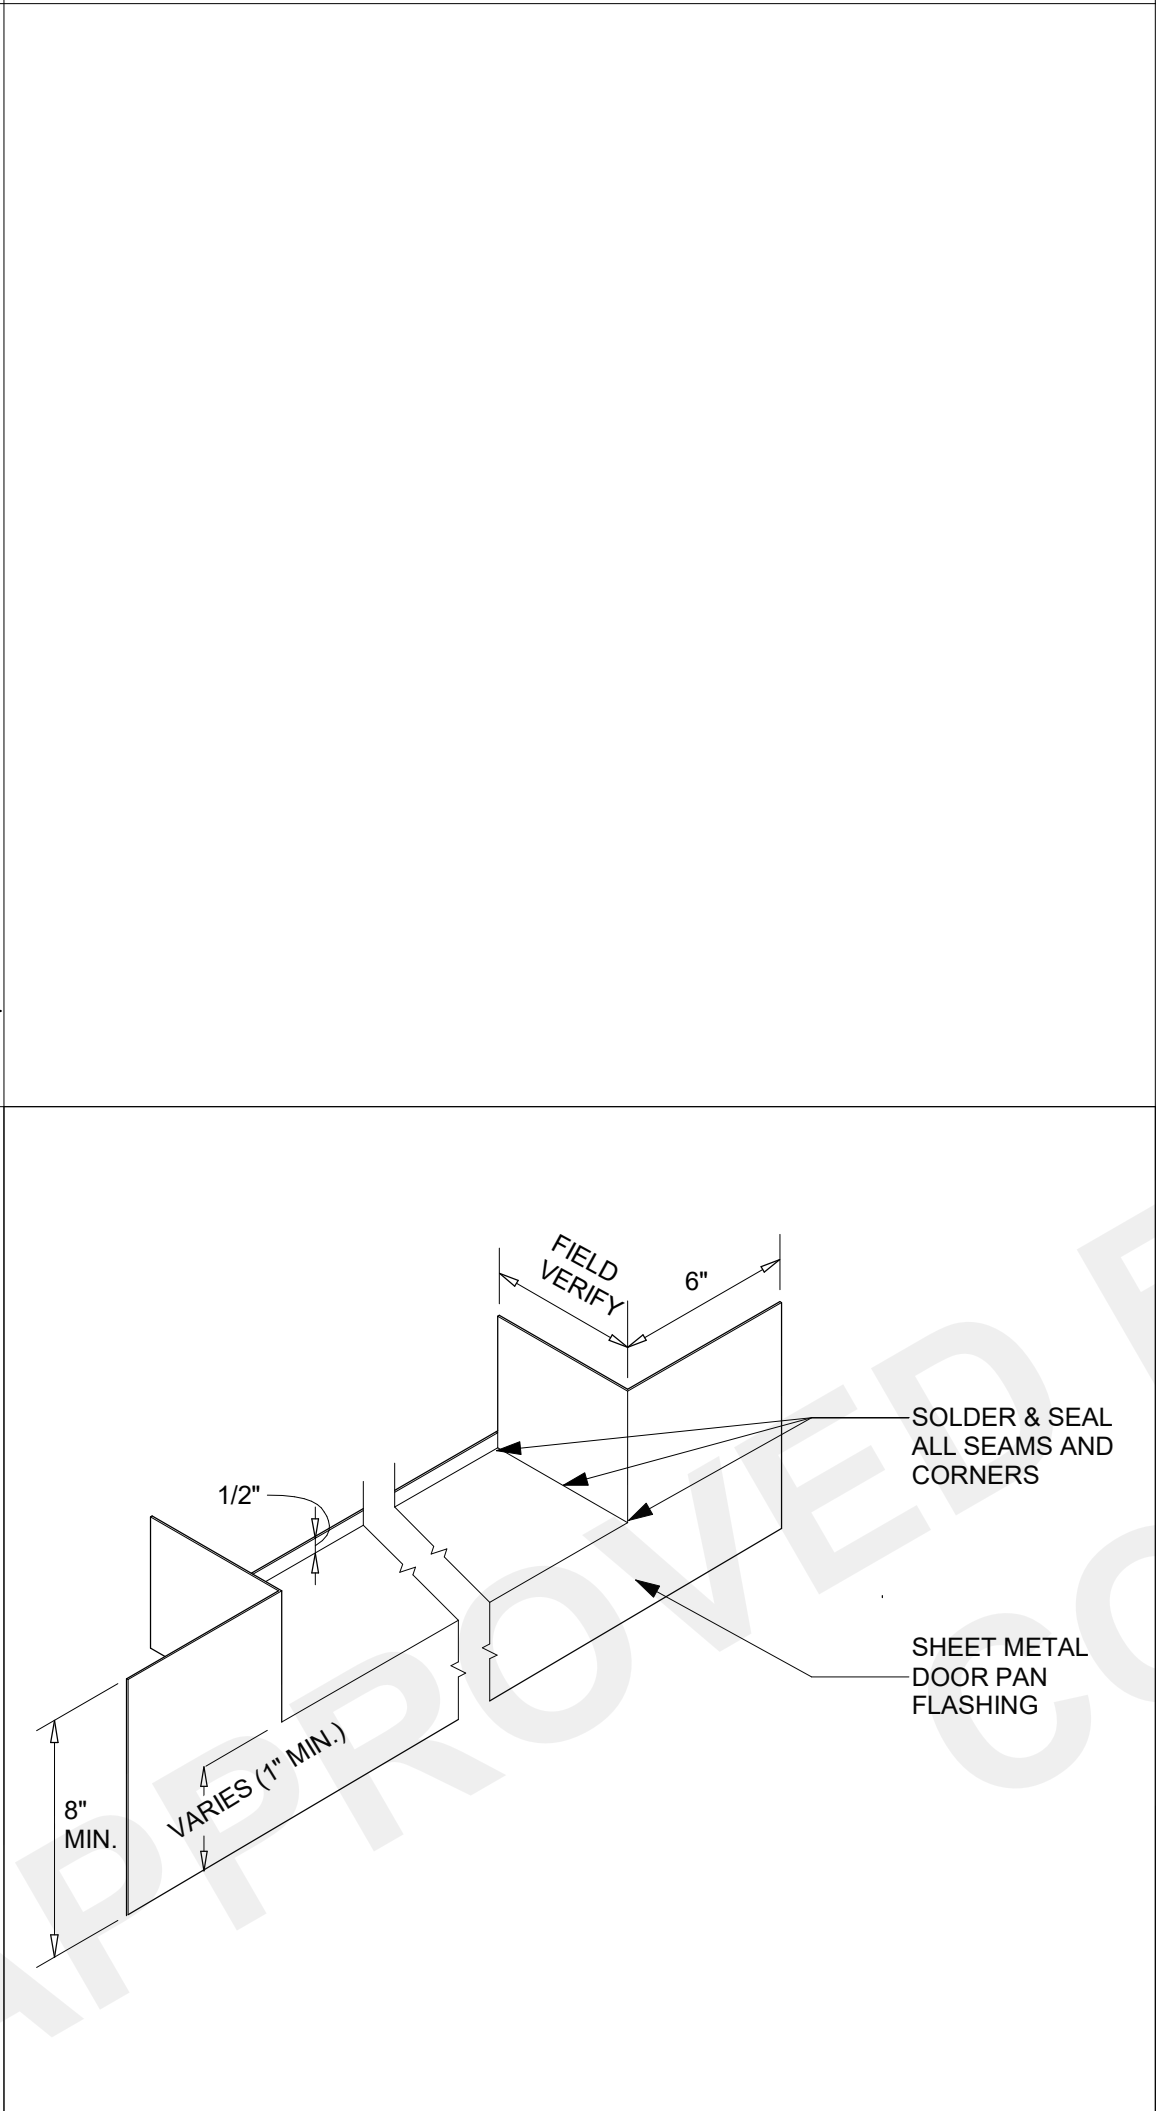


43 DOOR SILL PAN FLASHING

SCALE: 1 1/2" = 1'-0"

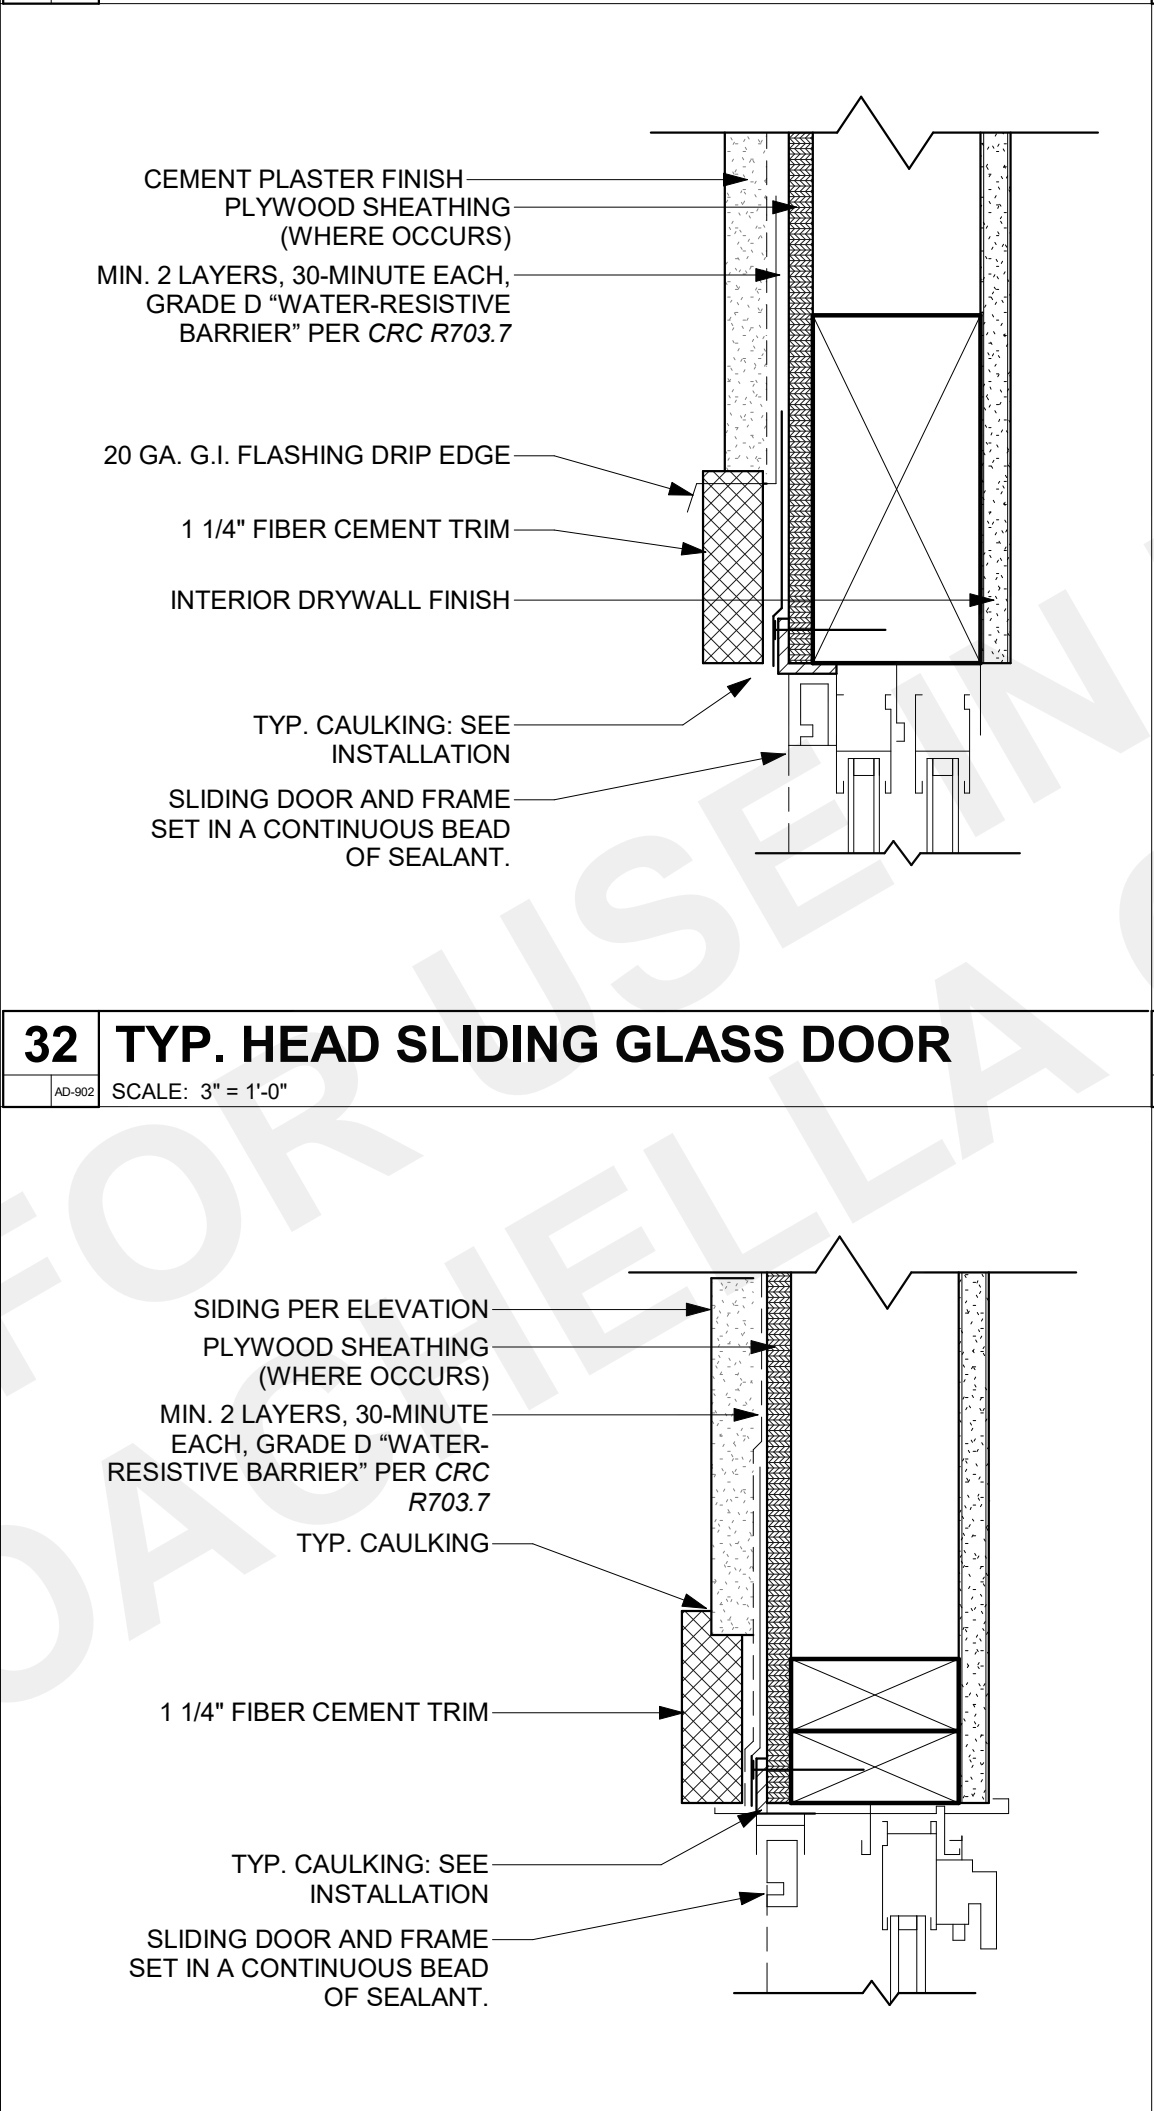


34 DOOR-SLIDING GLASS - THRESHOLD

SCALE: 3" = 1'-0"

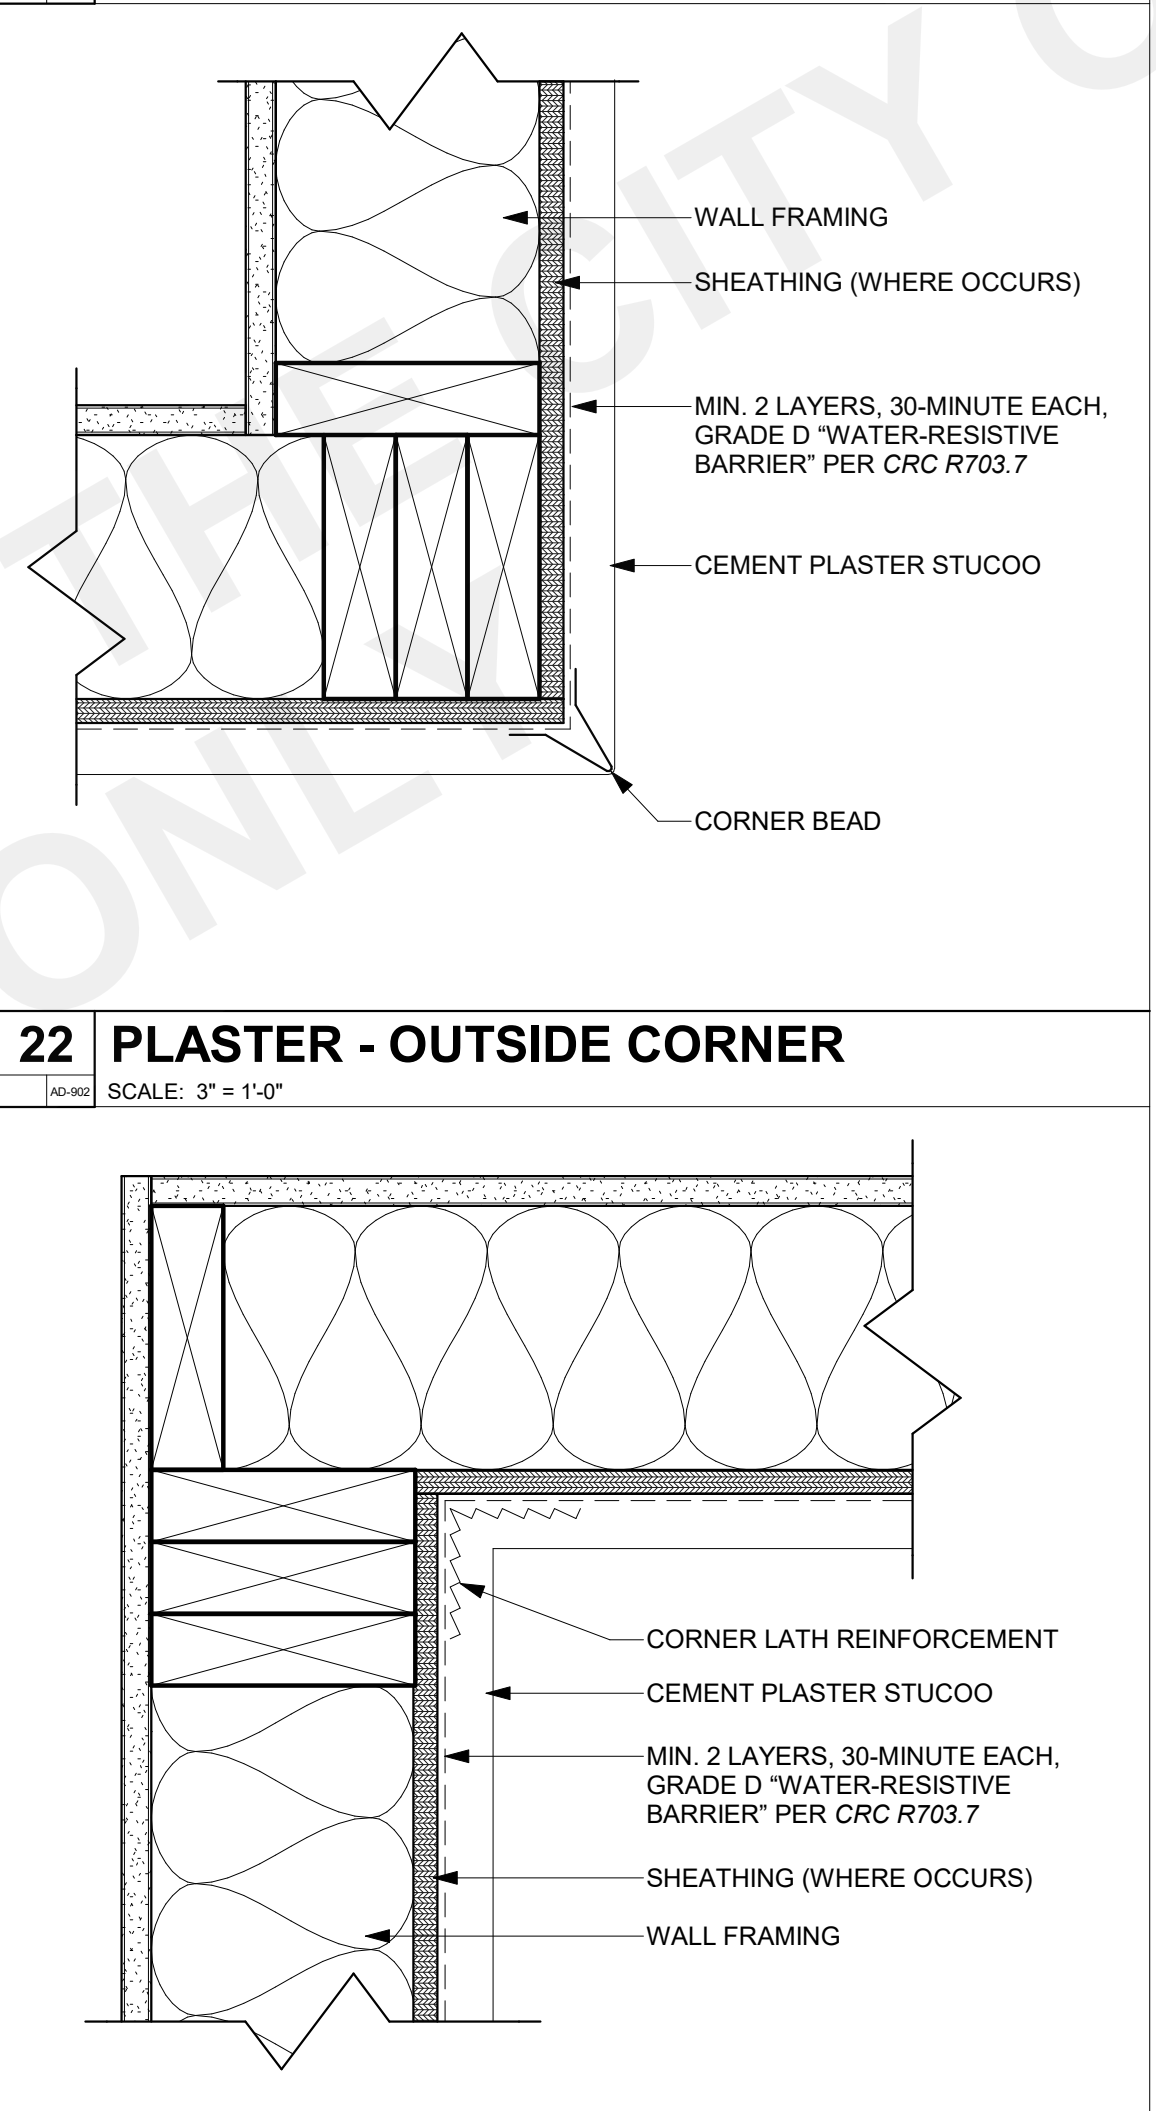


24 PLASTER - FOUNDATION

SCALE: 3" = 1'-0"

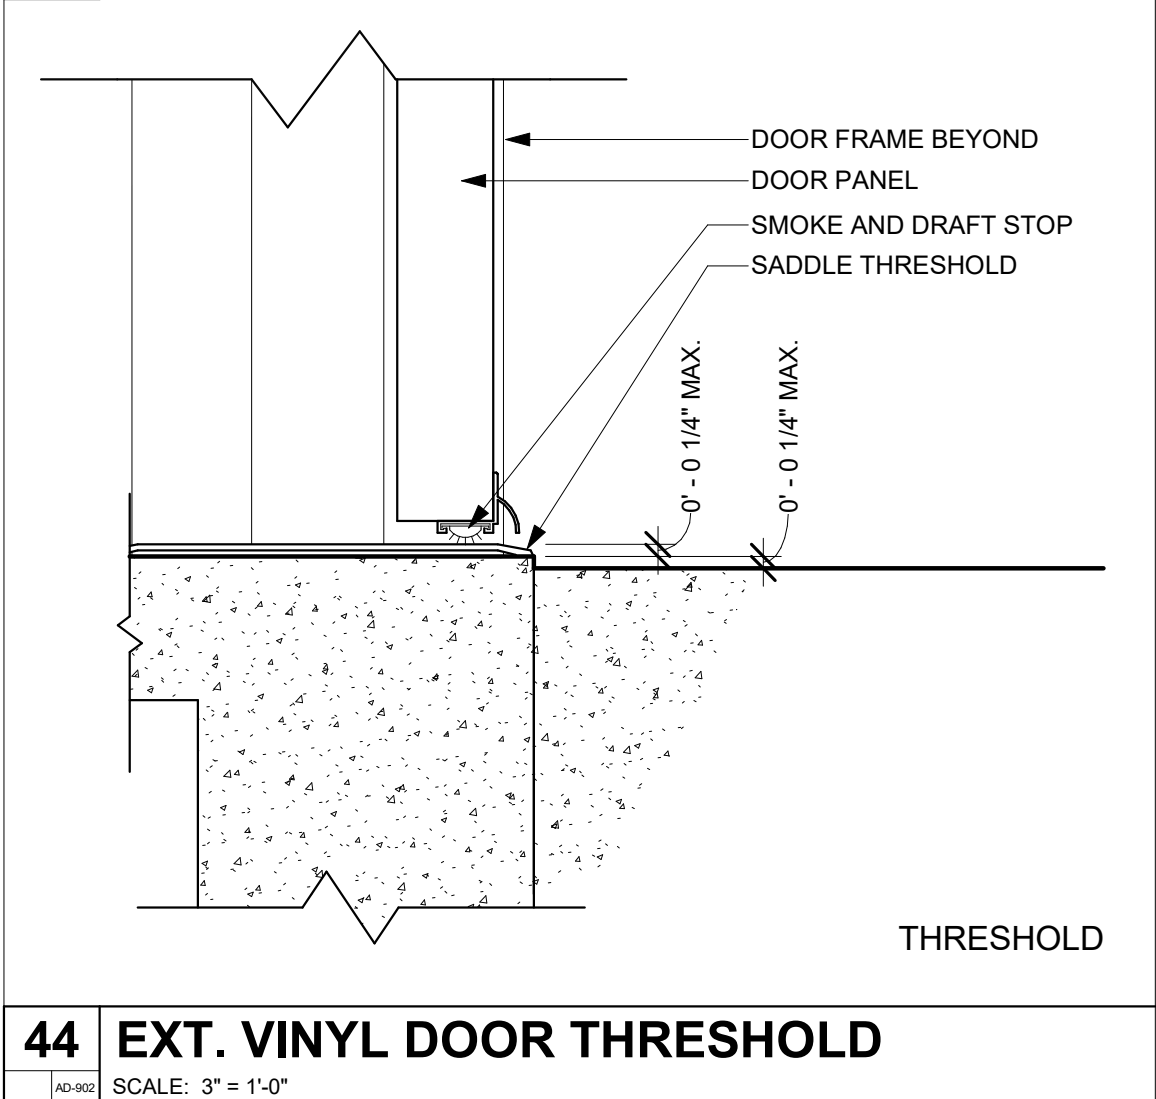


44 EXT. VINYL DOOR THRESHOLD

SCALE: 3" = 1'-0"

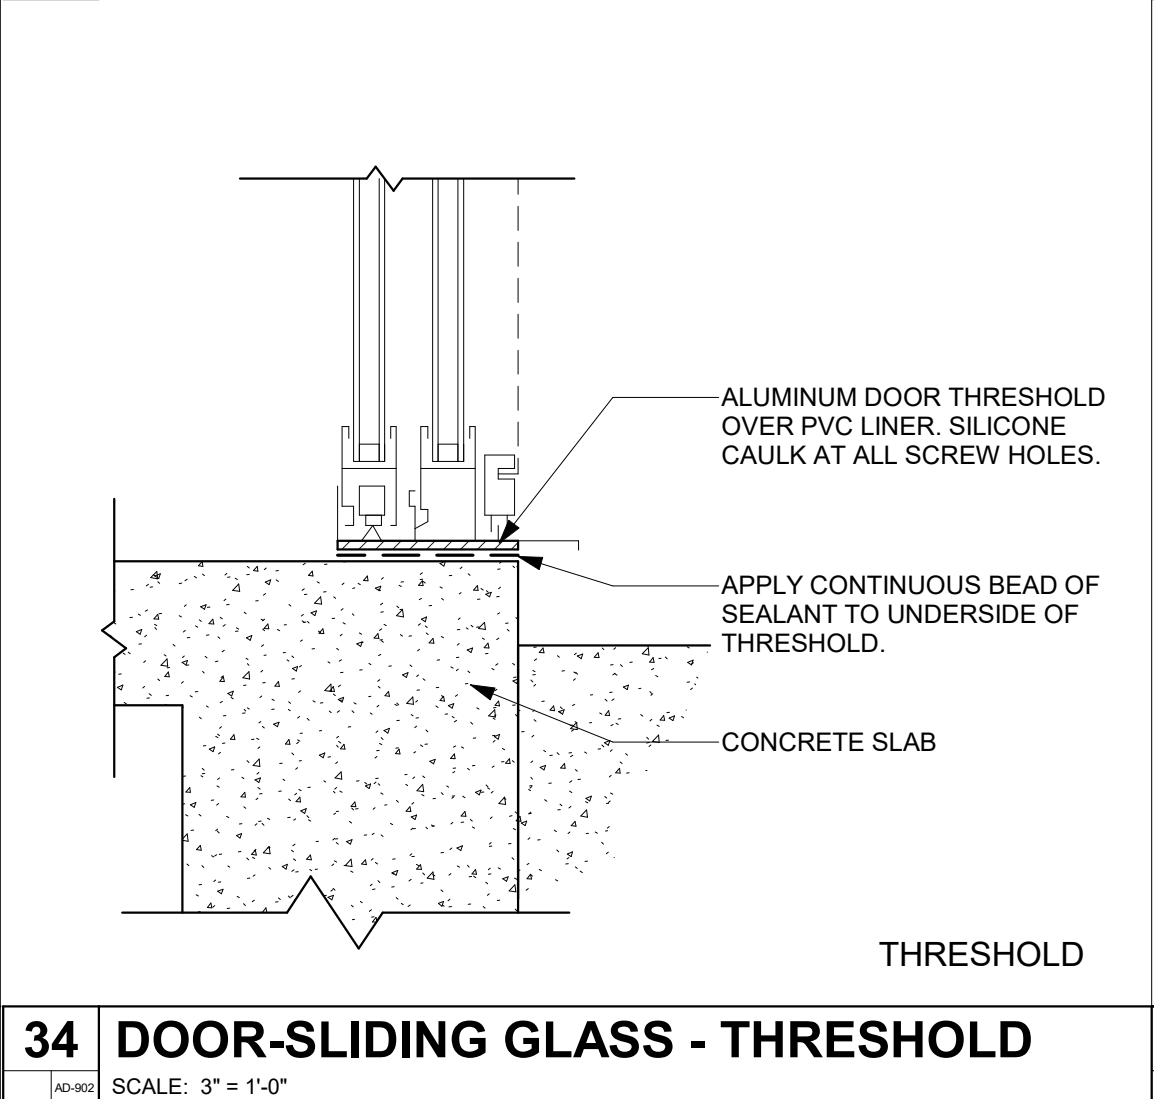

34 DOOR-SLIDING GLASS - THRESHOLD

SCALE: 3" = 1'-0"

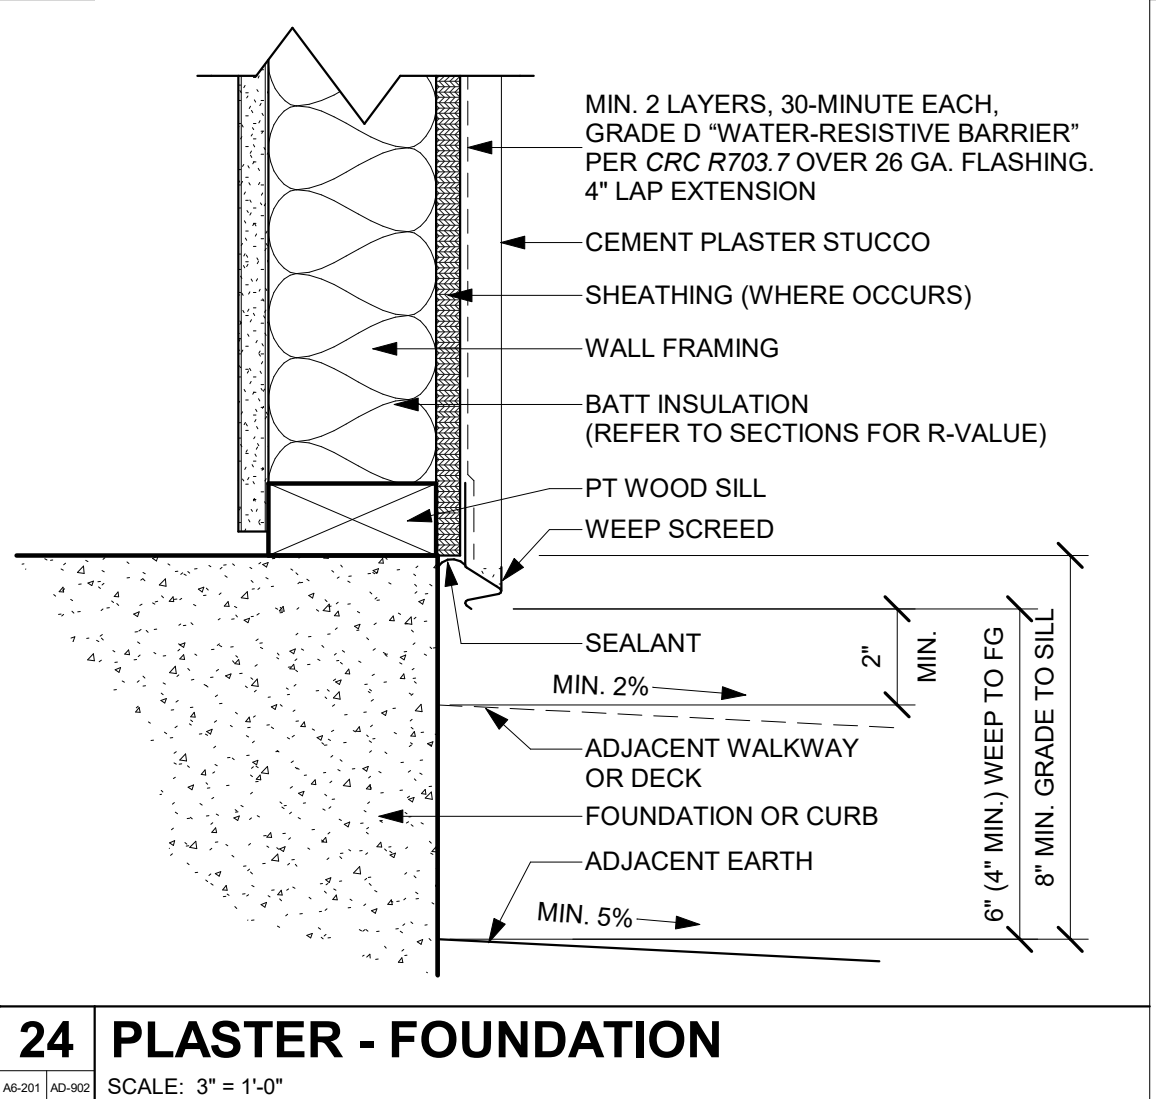

24 PLASTER - FOUNDATION

SCALE: 3" = 1'-0"



THESE PLANS ARE PROVIDED BY THE CITY OF AGOURA HILLS AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRACT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

**PROTOTYPE ADU
2 CAR GARAGE CONVERSION**
COACHELLA, CA

**ARCHITECTURAL DETAILS -
COMMON**

PUBLIC SET


DATE
01/11/24
SHEET

AD-902

1/19/2024 8:55:05 AM
Autodesk Docs/2393_Coachella ADU/2393-01_Coachella ADUs_Garage Unit.rvt




THESE PLANS ARE PROVIDED BY THE CITY OF AGOURA HILLS AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRACT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

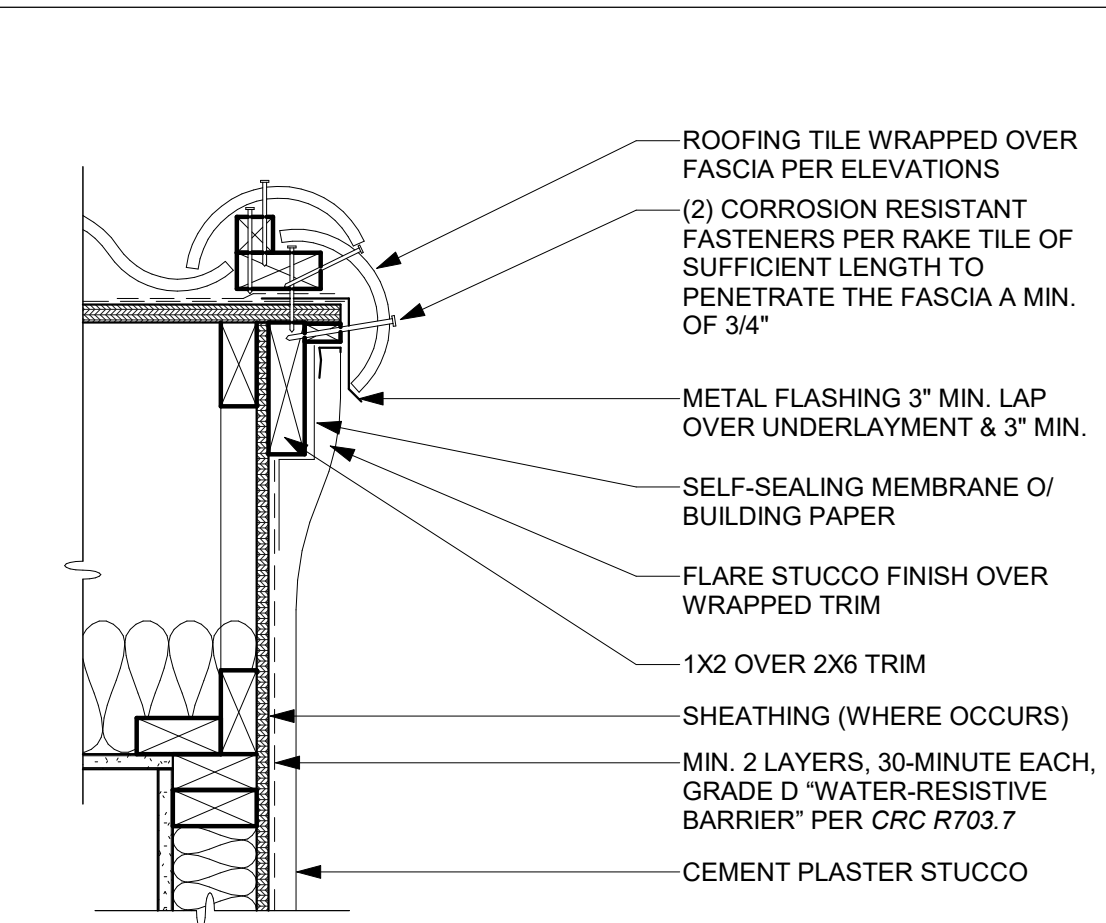


31 RAKE @ PLASTER - MISSION

SCALE: 1 1/2" = 1'-0"

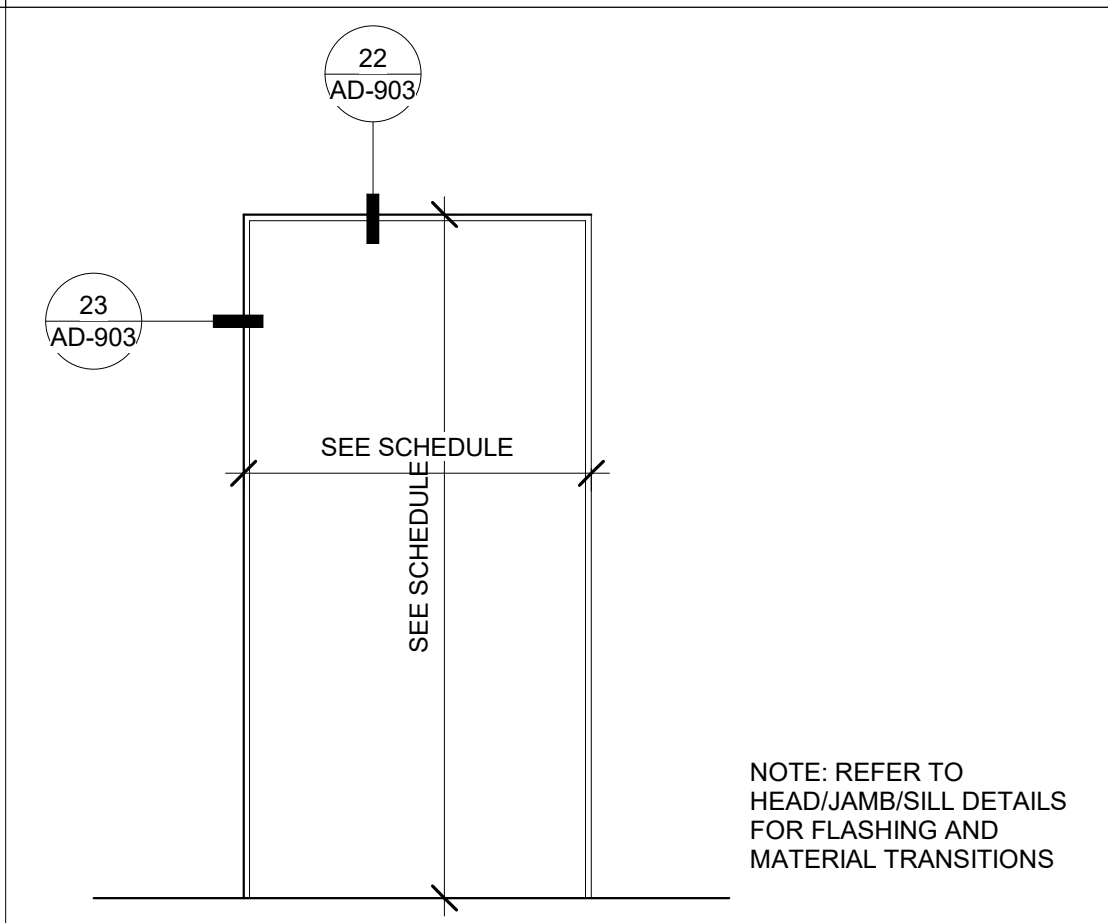


21 DOOR TRIM - MISSION REVIVAL

SCALE: 3/4" = 1'-0"

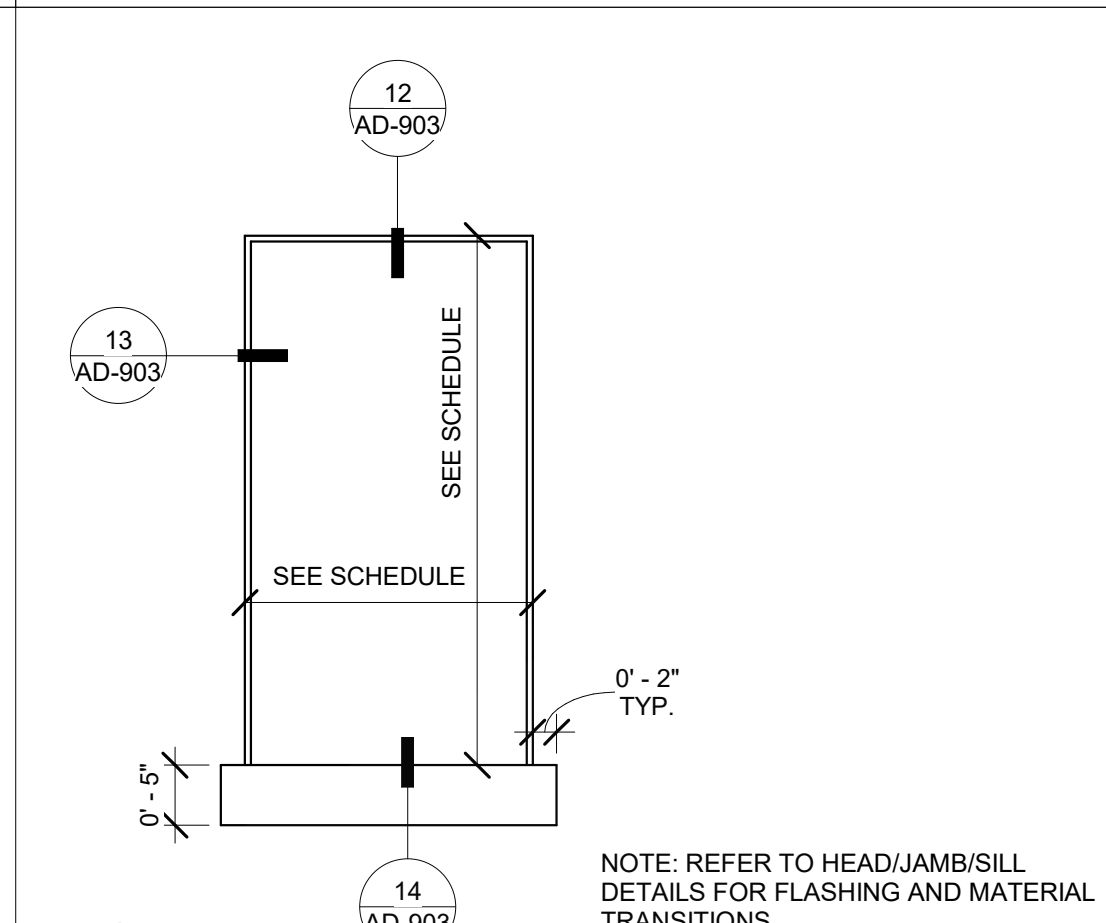


11 WINDOW TRIM - MISSION REVIVAL

SCALE: 3/4" = 1'-0"

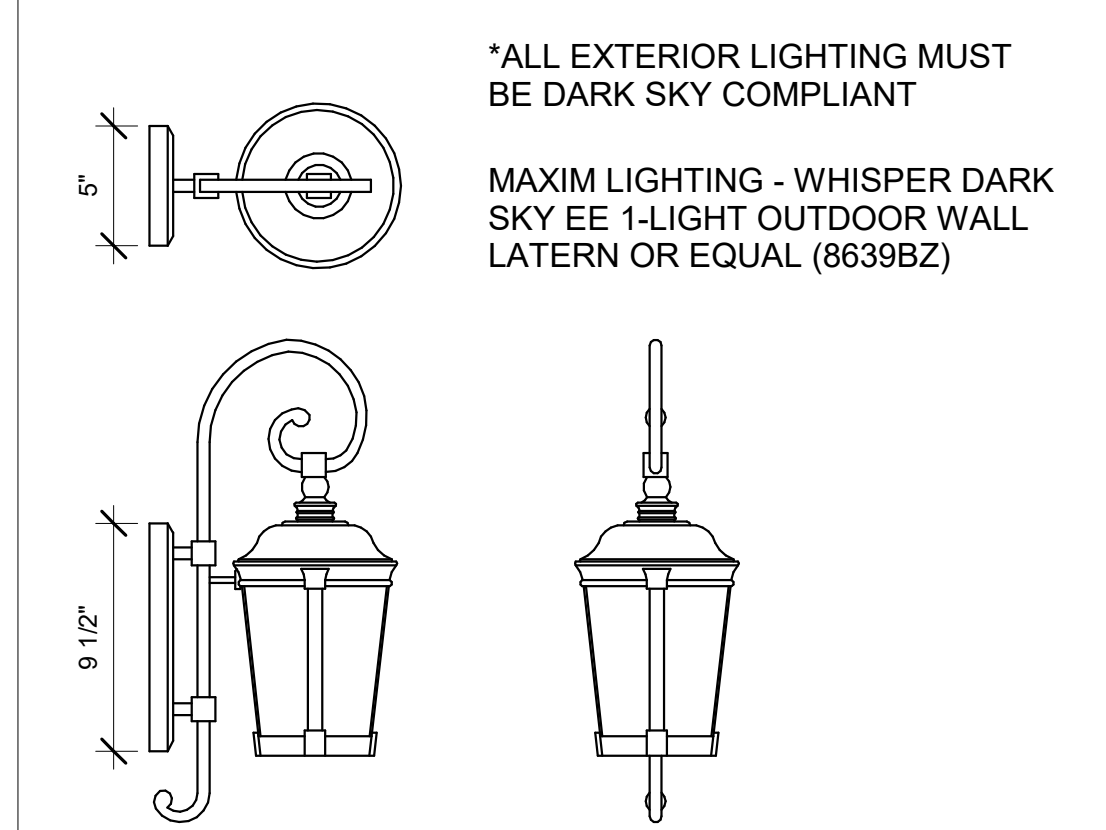


42 LIGHT FIXTURE - MISSION REVIVAL

SCALE: 1 1/2" = 1'-0"

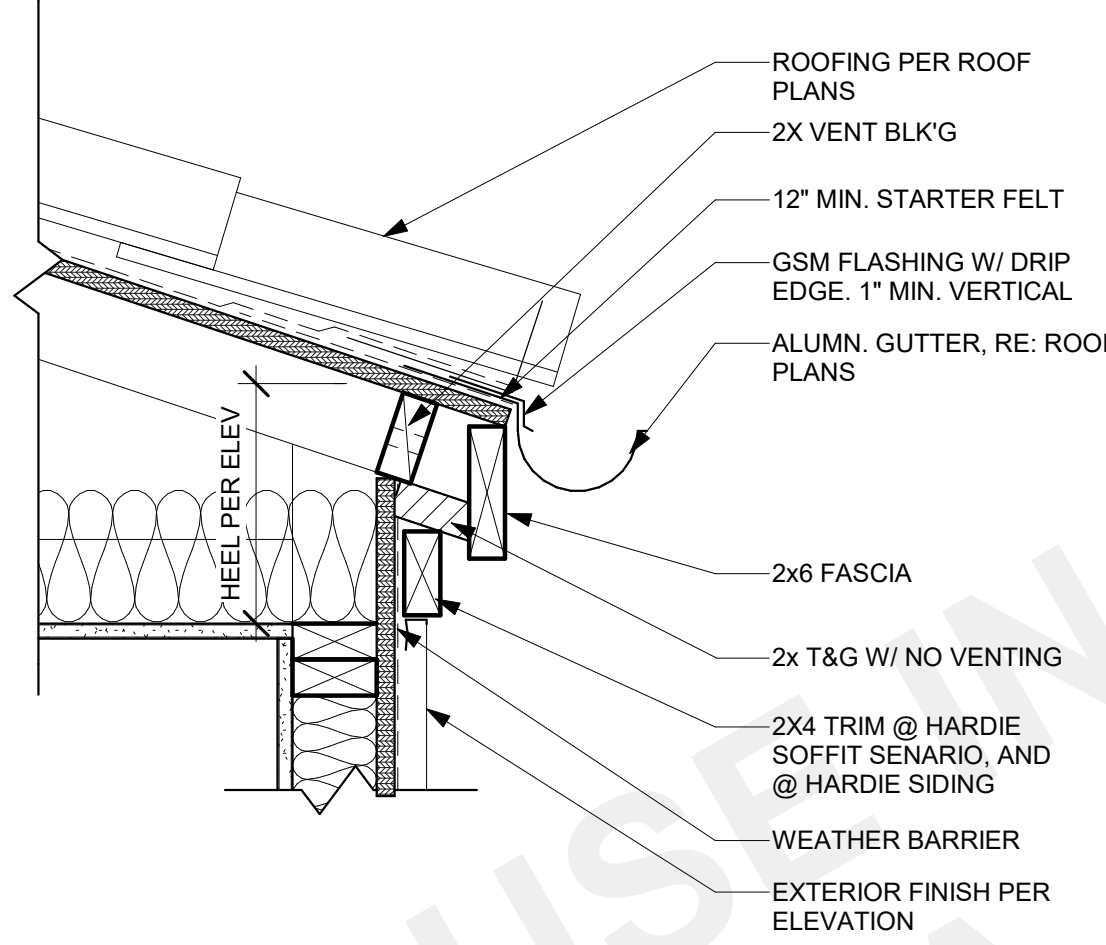


32 EAVE @ PLASTER - MISSION

SCALE: 1 1/2" = 1'-0"

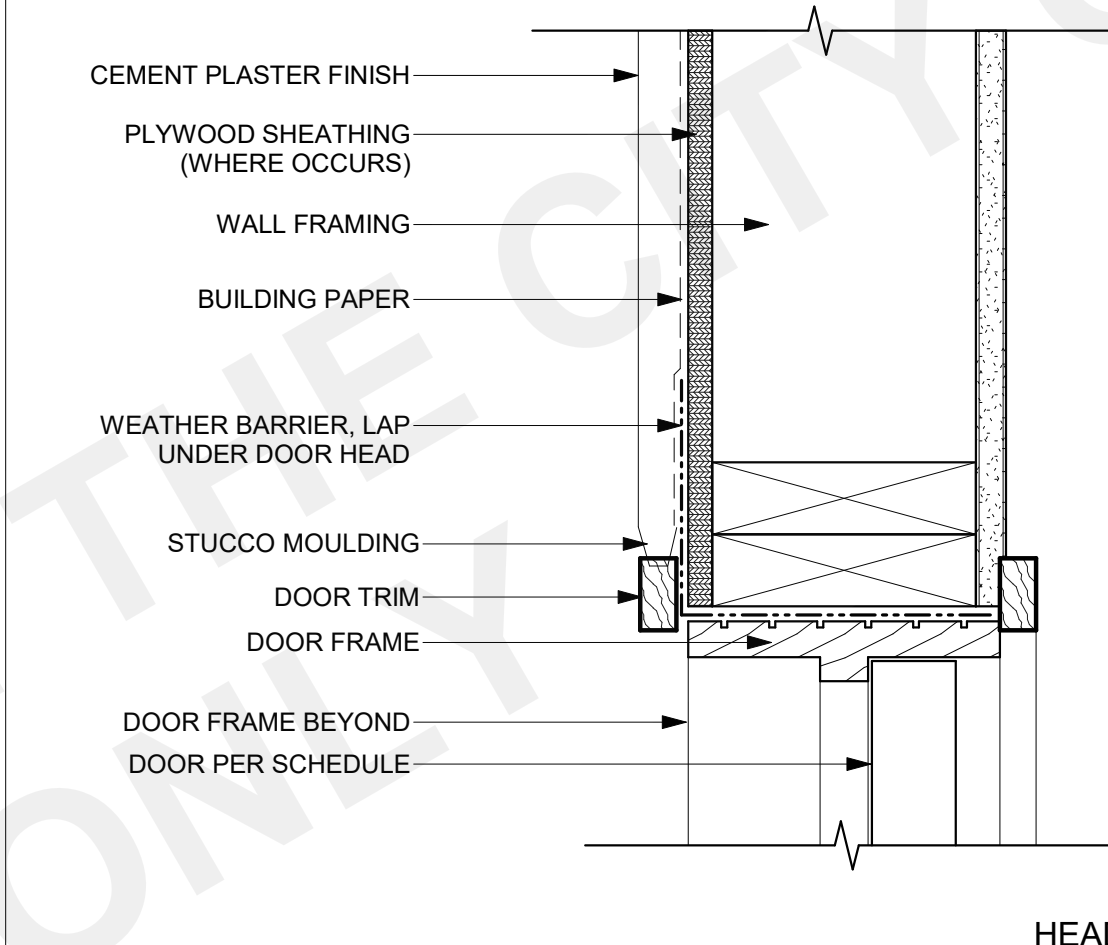


22 DOOR HEAD - MISSION

SCALE: 3" = 1'-0"

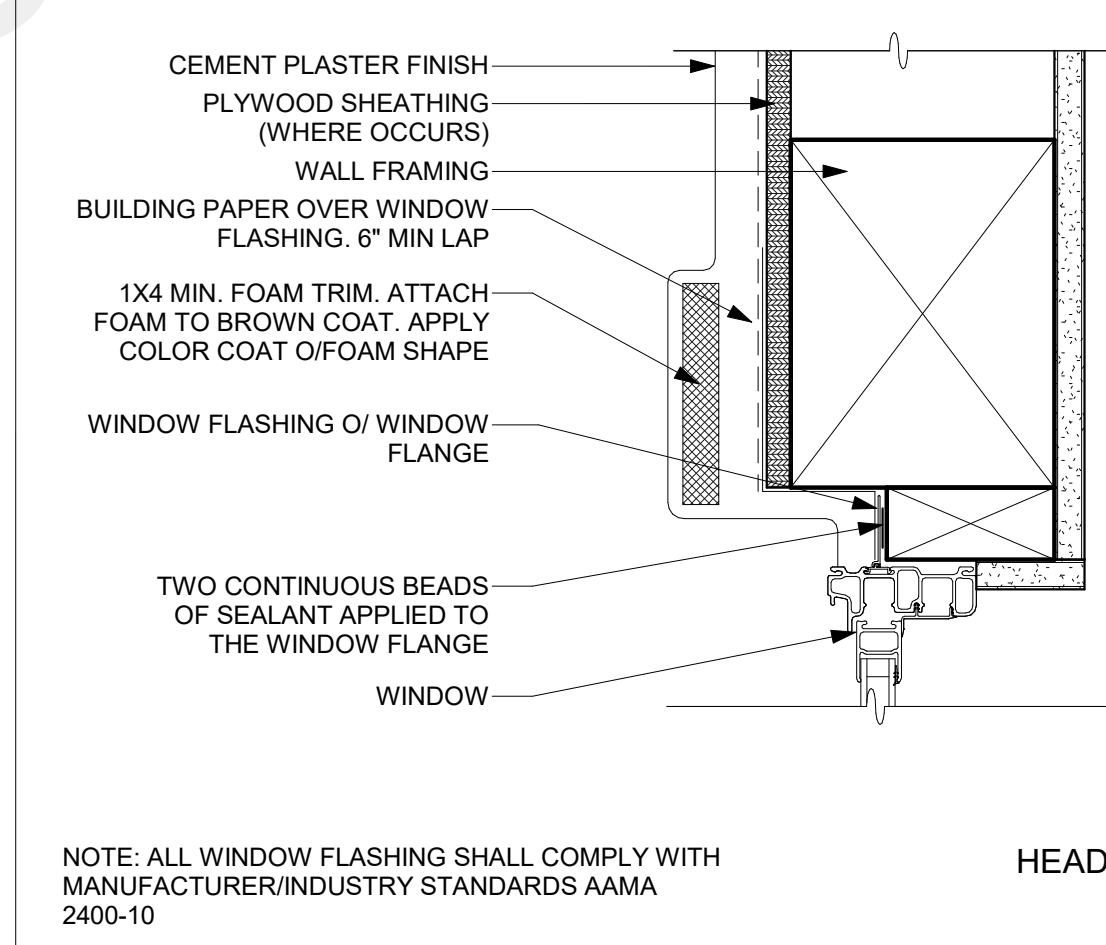


12 TYP. WINDOW HEAD

SCALE: 3" = 1'-0"

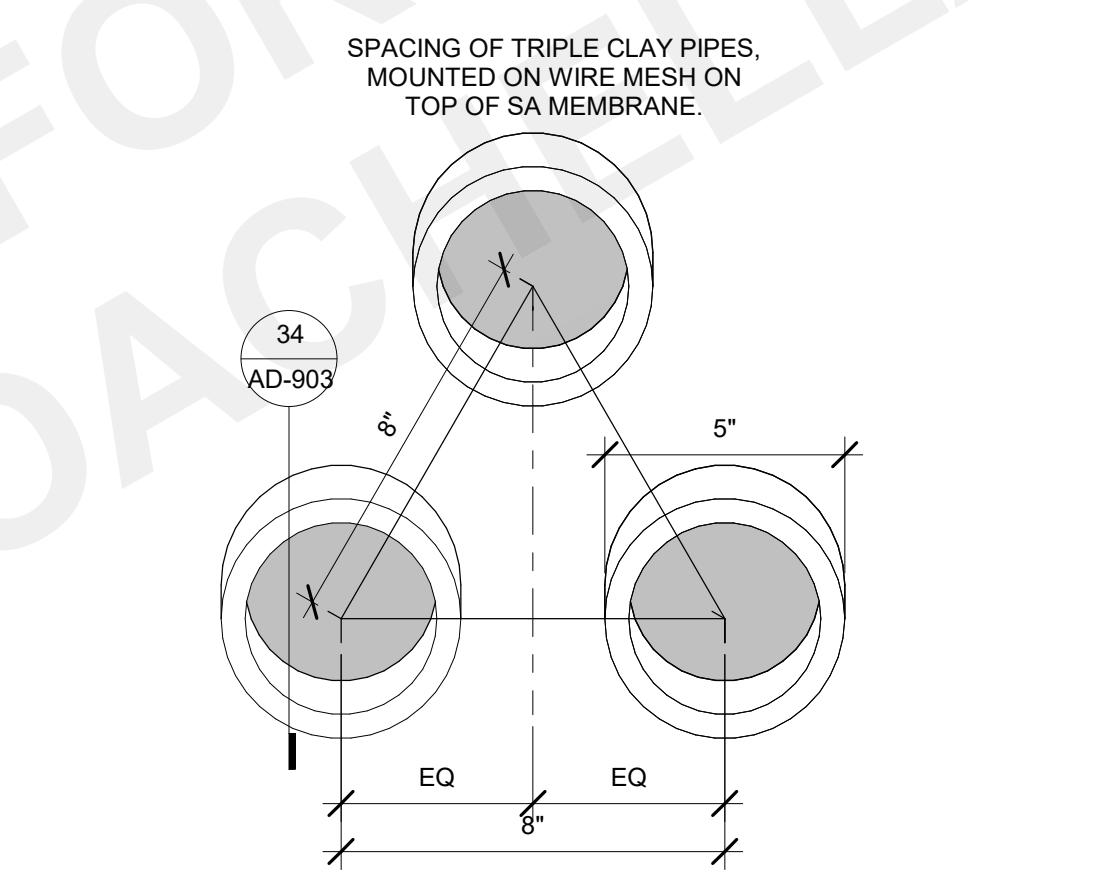


33 DECORATIVE VENT SPACING

SCALE: 3" = 1'-0"

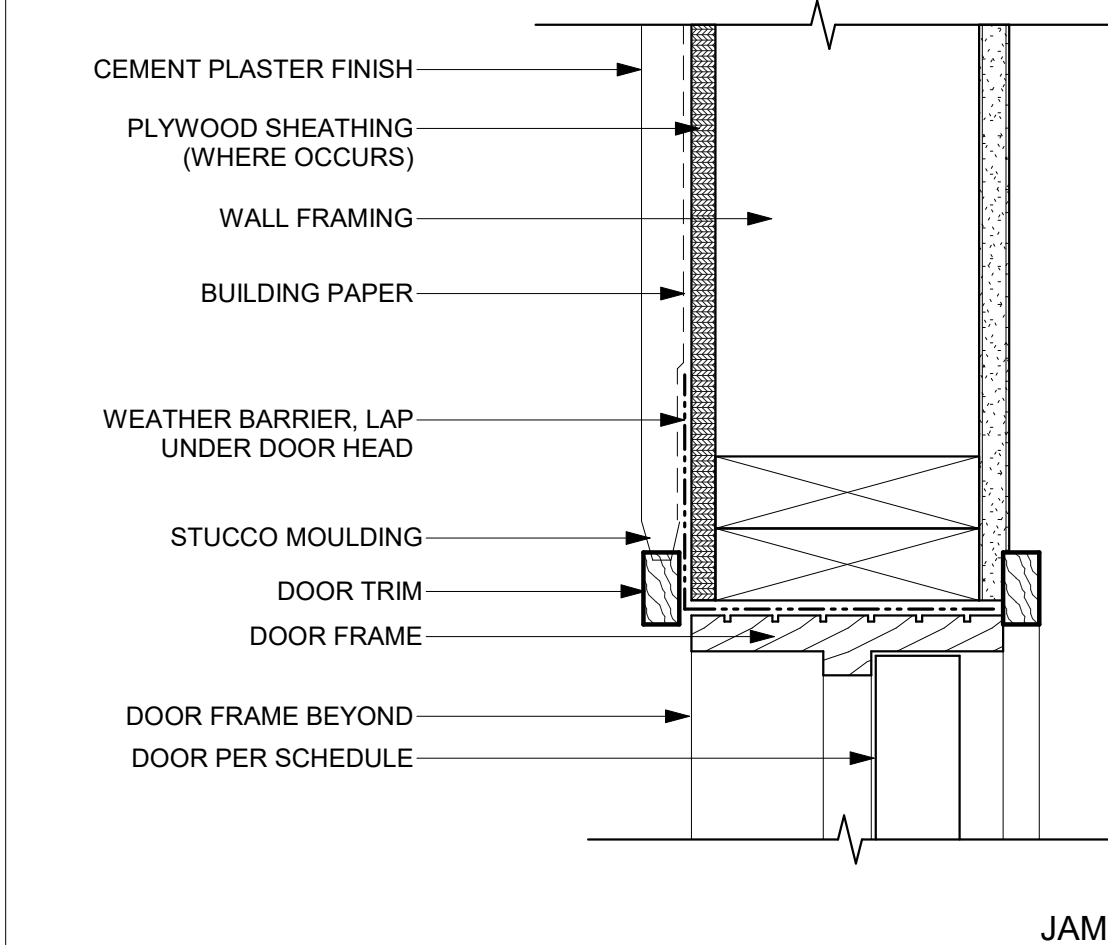


23 DOOR JAMB - MISSION

SCALE: 3" = 1'-0"

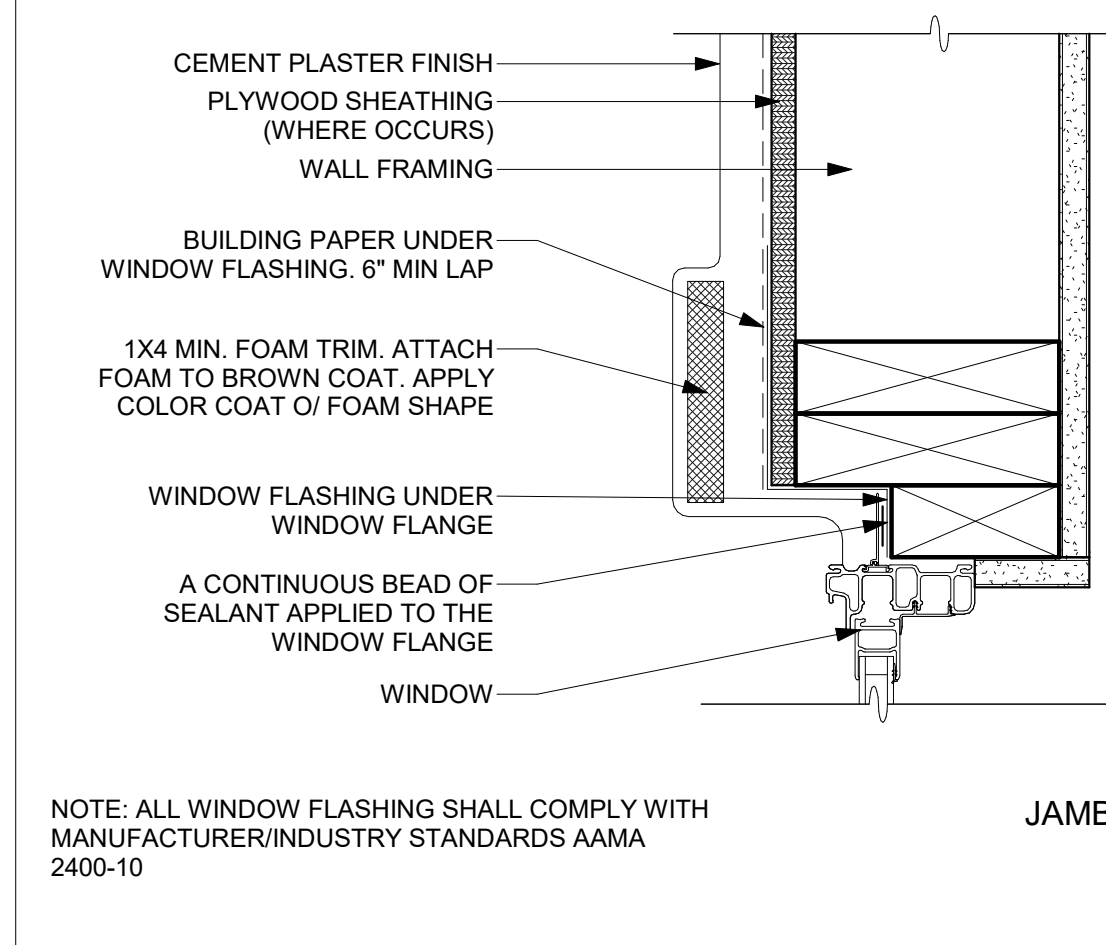


13 TYP. WINDOW JAMB

SCALE: 3" = 1'-0"

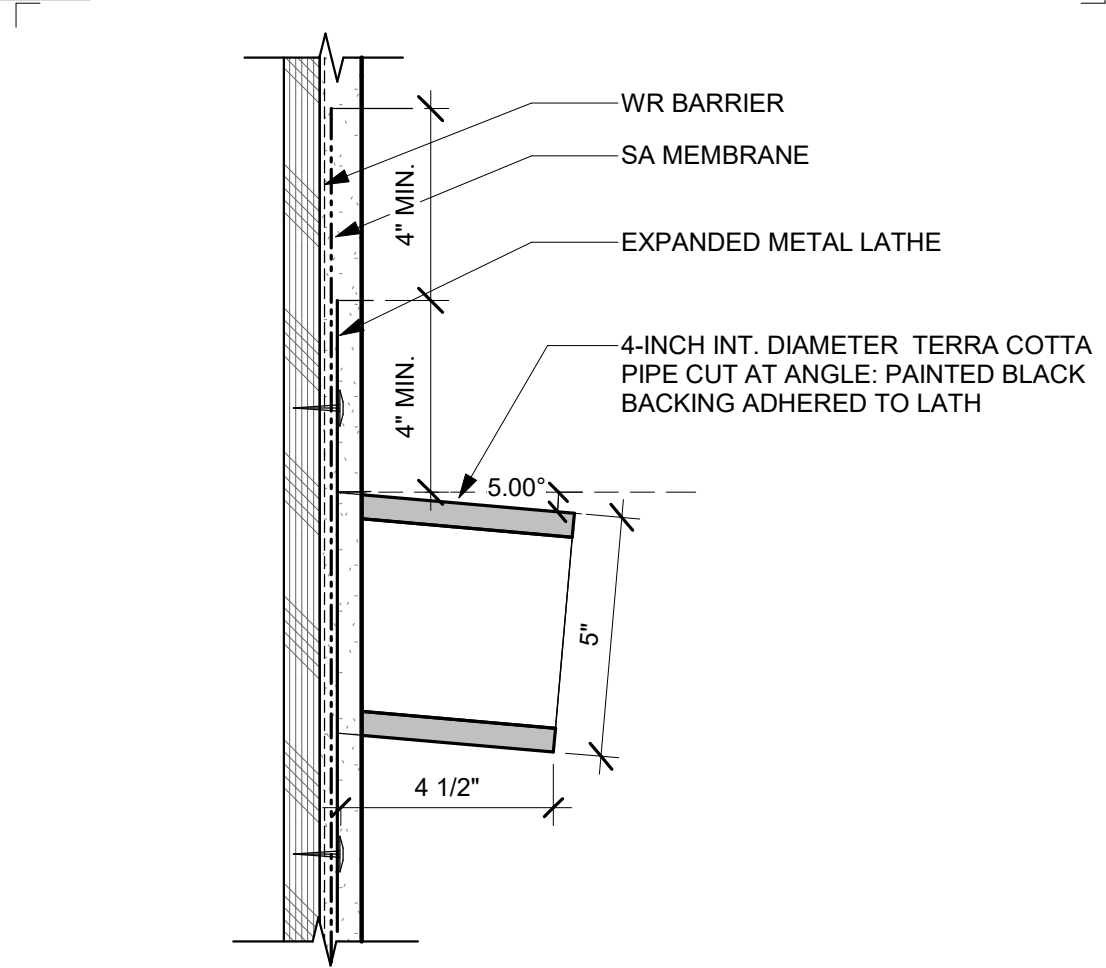

34 DECORATIVE VENT ATTACHMENT

SCALE: 3" = 1'-0"

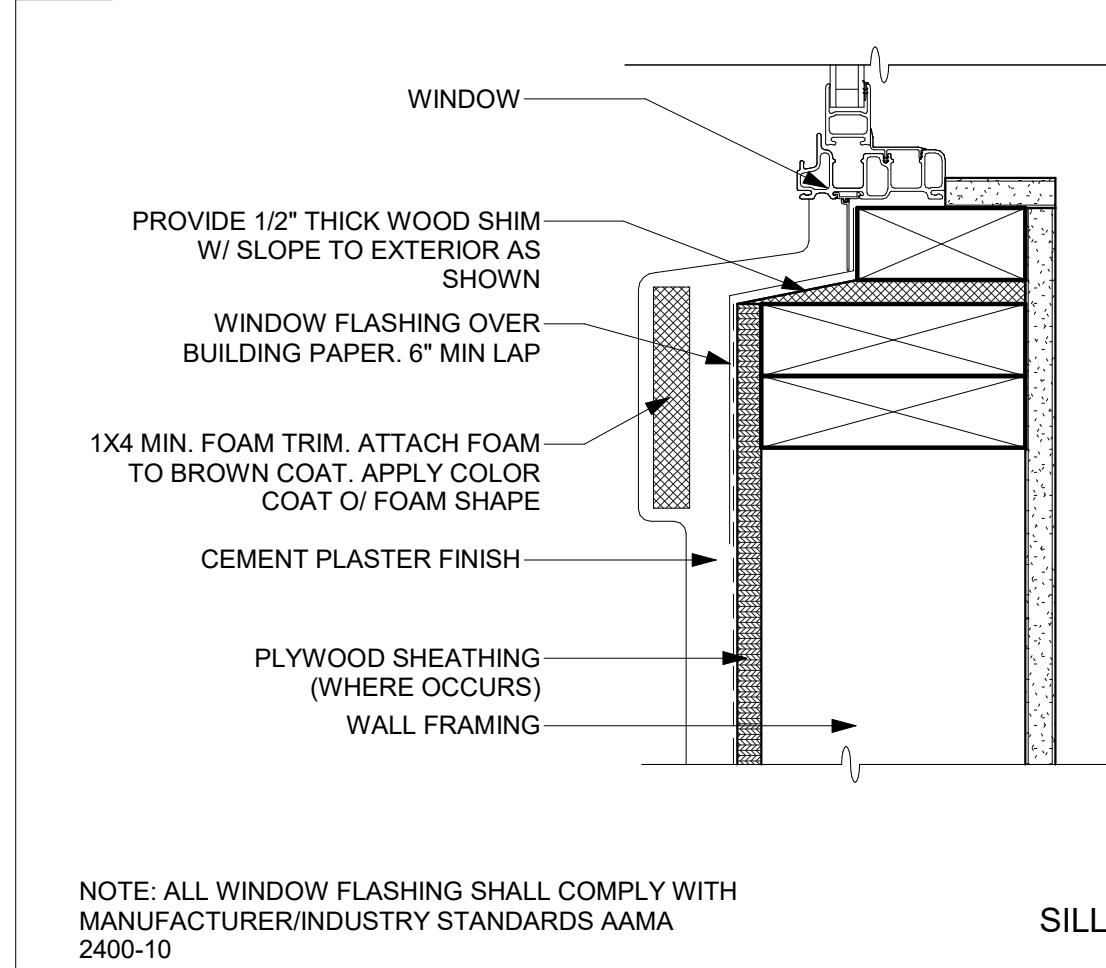

14 TYP. WINDOW SILL

SCALE: 3" = 1'-0"

PUBLIC SET

PROTOTYPE ADU
2 CAR GARAGE CONVERSION
COACHELLA, CA


ARCHITECTURAL DETAILS -
MISSION REVIVAL

DATE
01/11/24
SHEET

AD-903




THESE PLANS ARE PROVIDED BY THE CITY OF AGOURA HILLS AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRACT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

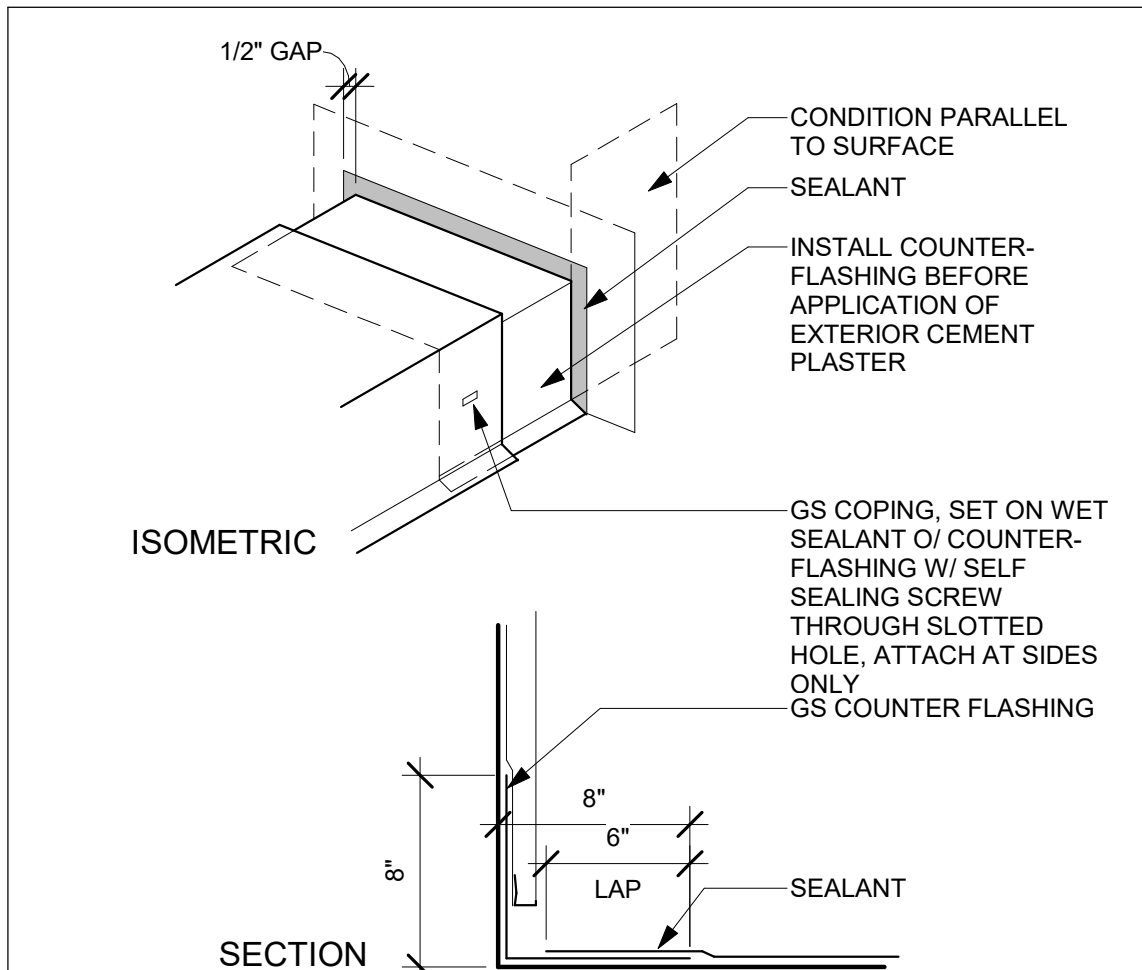


51 PARAPET COPING FLASHING

SCALE: 1 1/2" = 1'-0"

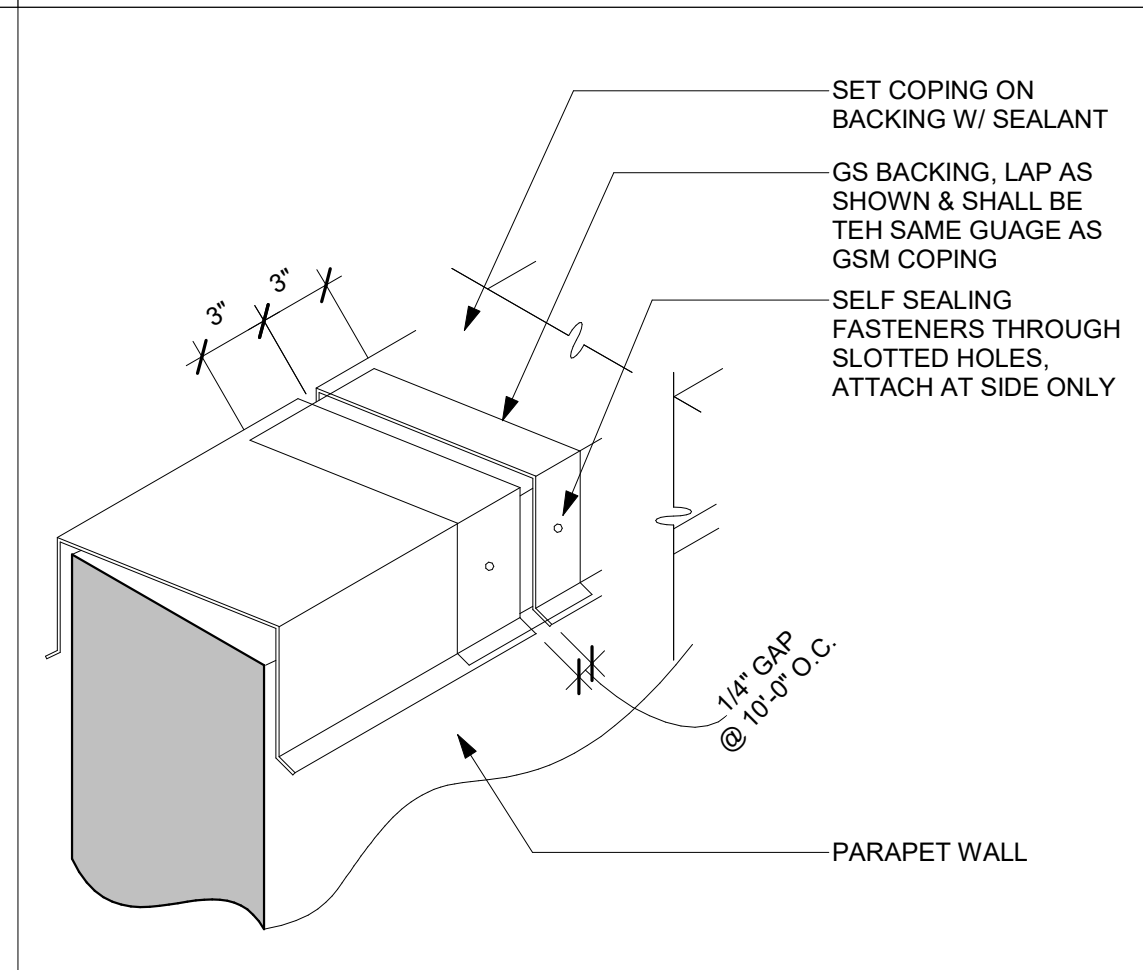


41 PARAPET FLASHING DETAIL

SCALE: 1 1/2" = 1'-0"

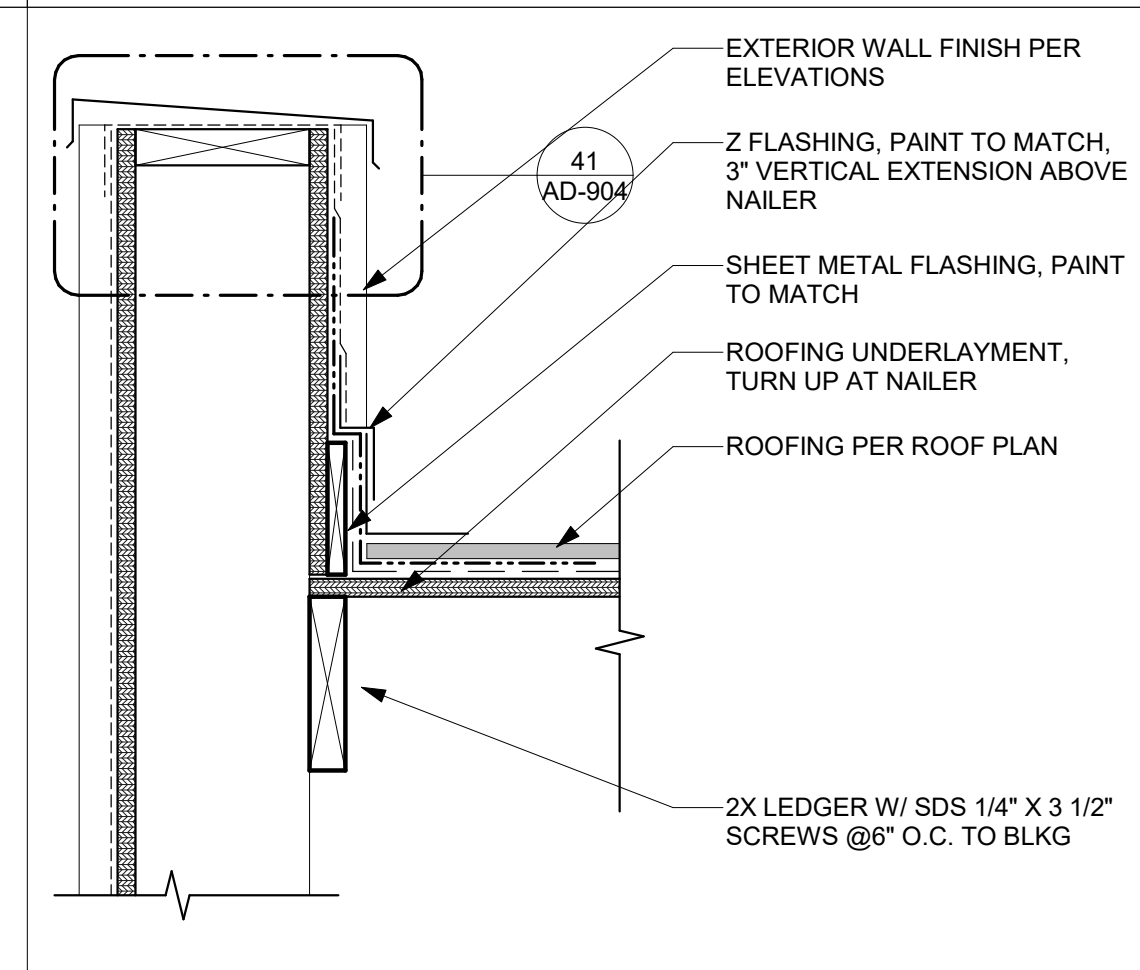


31 COUNTERFLASHING AT PARAPET

SCALE: 1 1/2" = 1'-0"

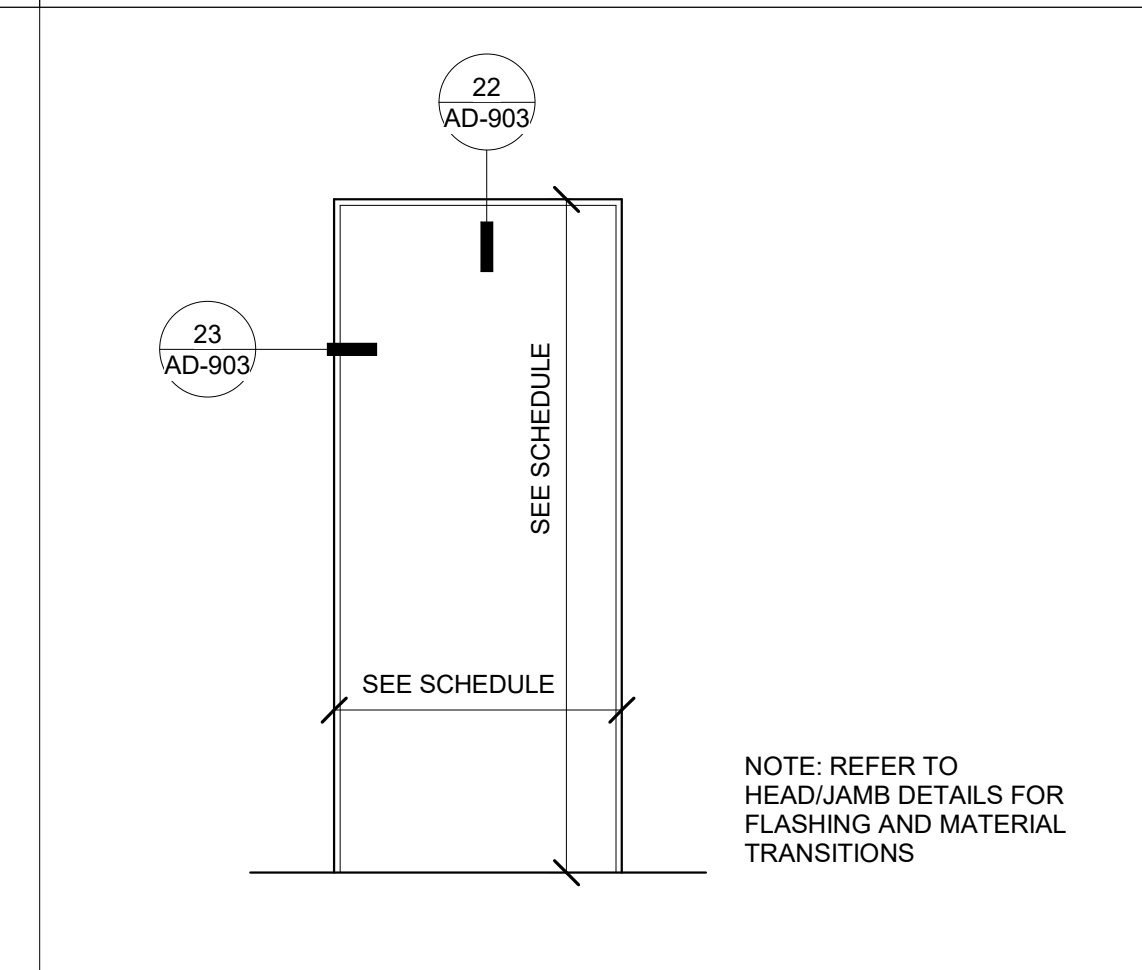


21 DOOR TRIM - DESERT MODERN

SCALE: 3/4" = 1'-0"

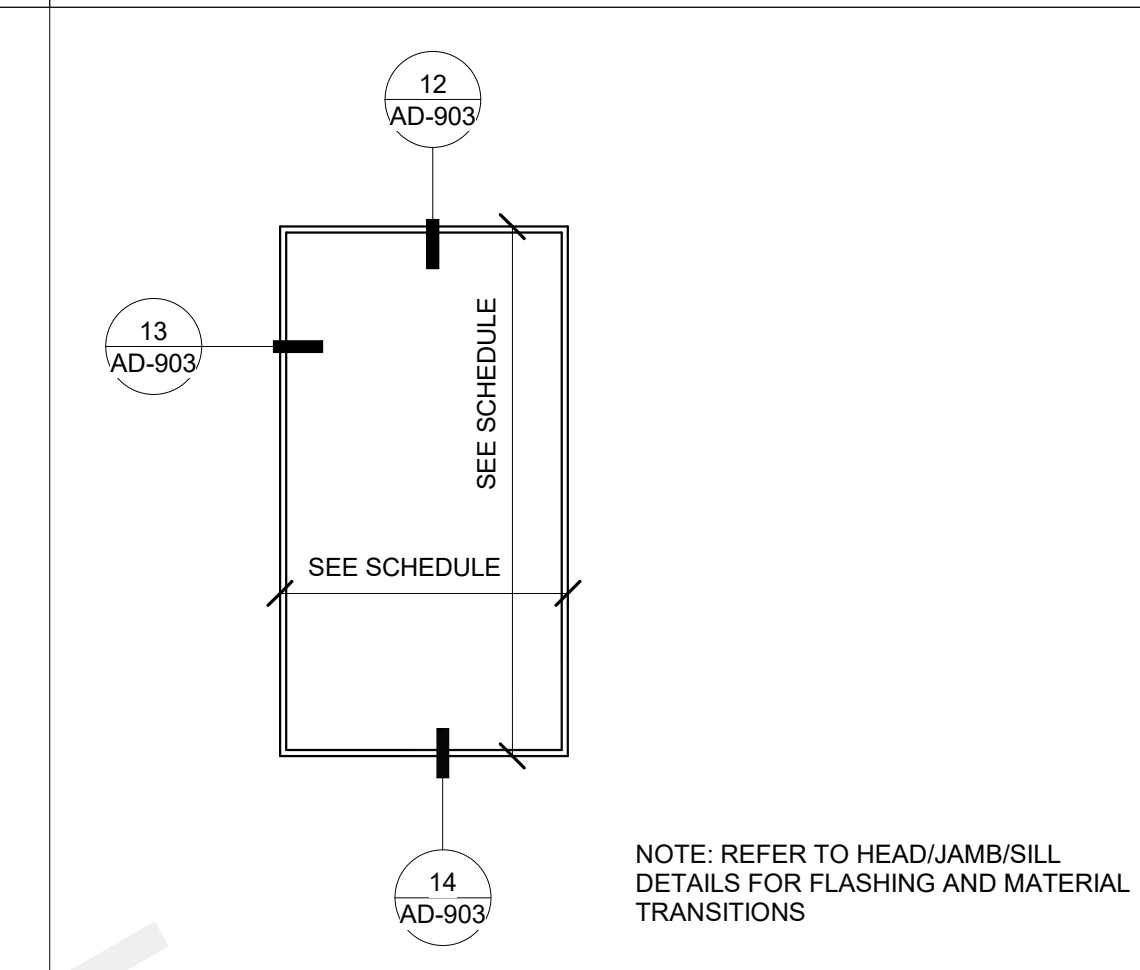


11 WINDOW TRIM - DESERT MODERN

SCALE: 3/4" = 1'-0"

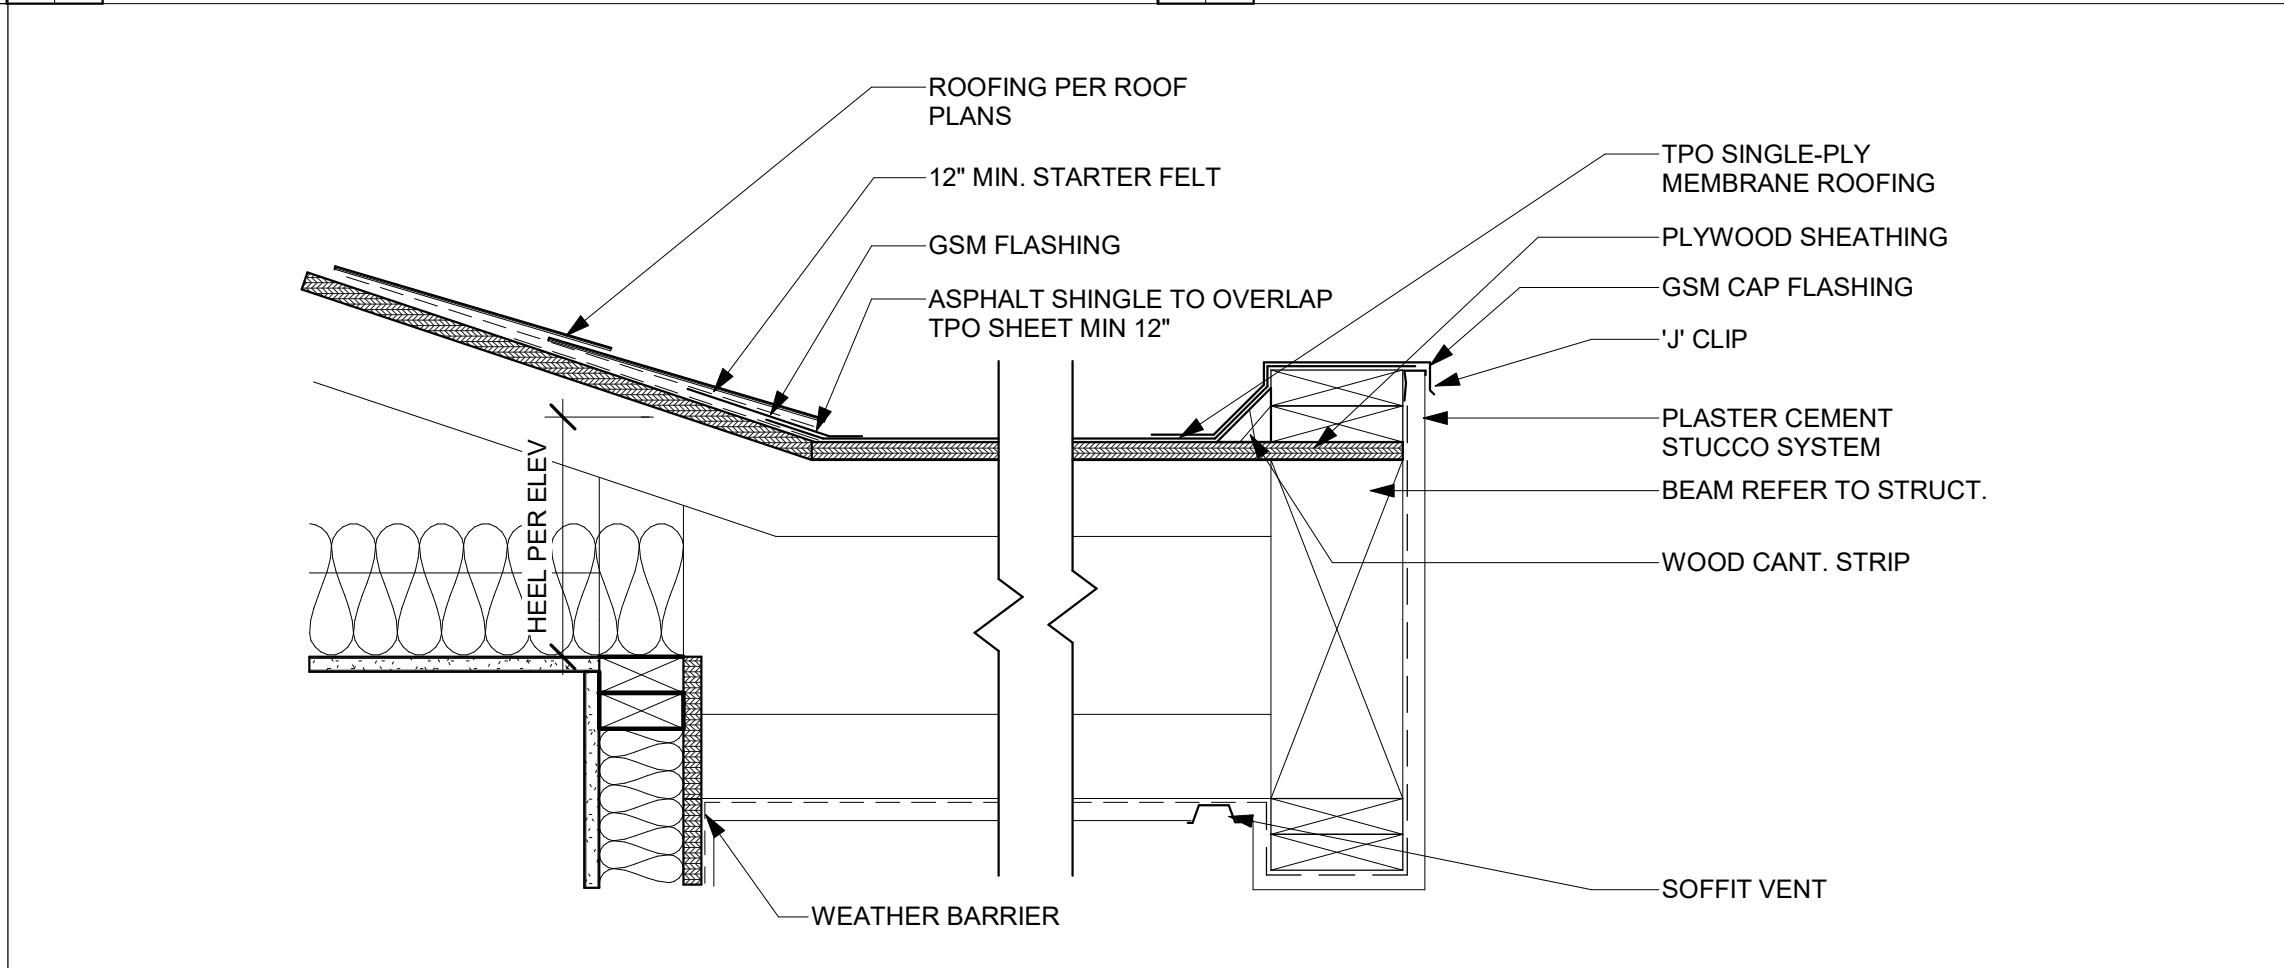


52 ROOF TO PORCH - DESERT MODERN

SCALE: 1 1/2" = 1'-0"

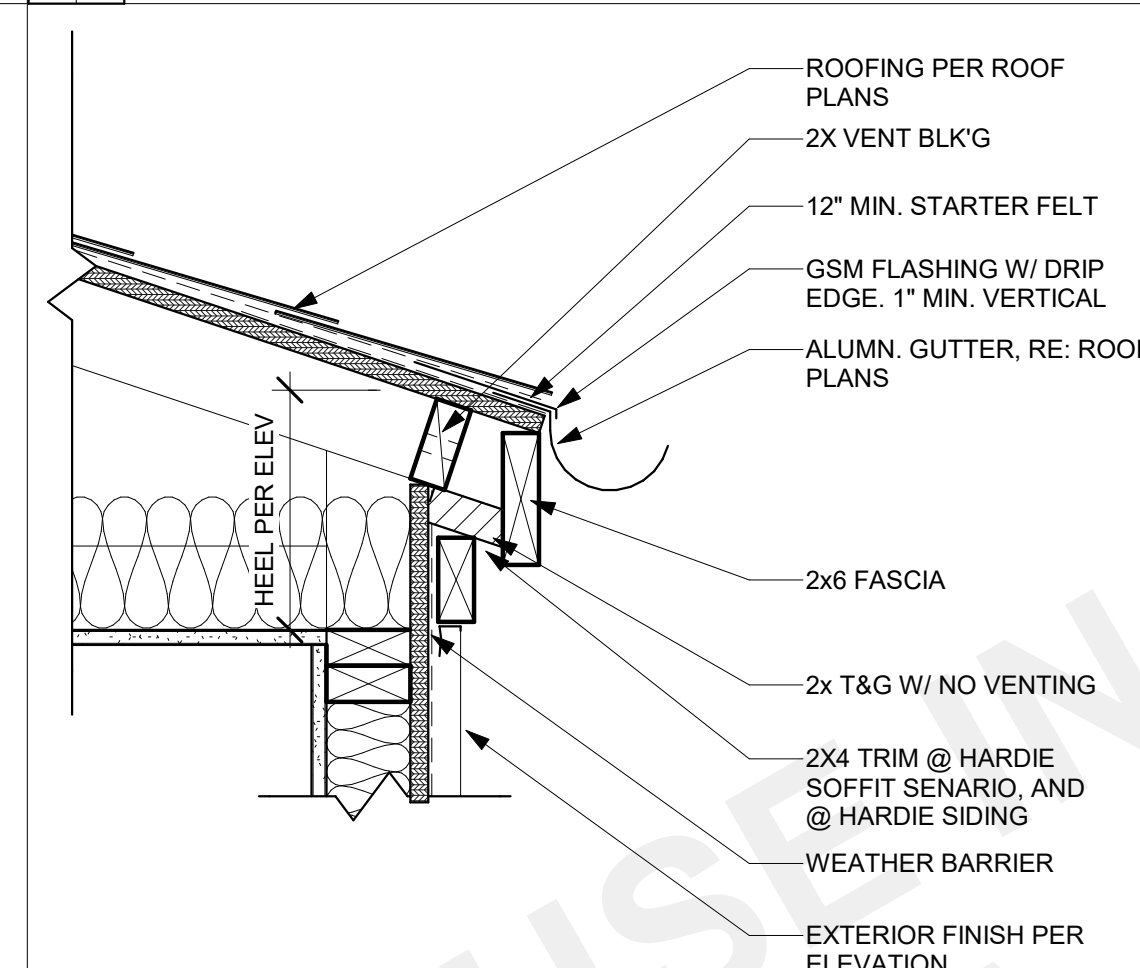


32 EAVE @ PLASTER - MODERN

SCALE: 1 1/2" = 1'-0"

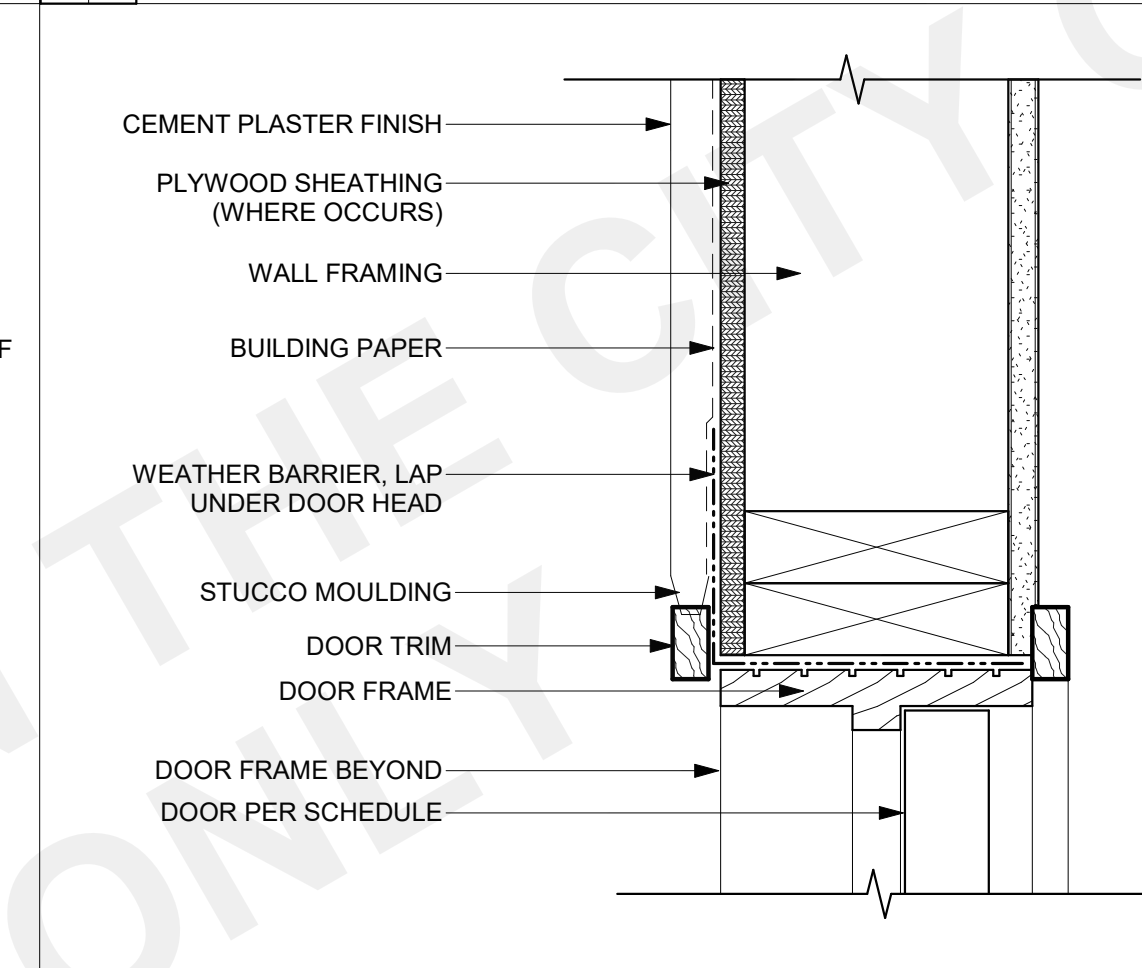


22 DOOR HEAD - MODERN

SCALE: 3" = 1'-0"

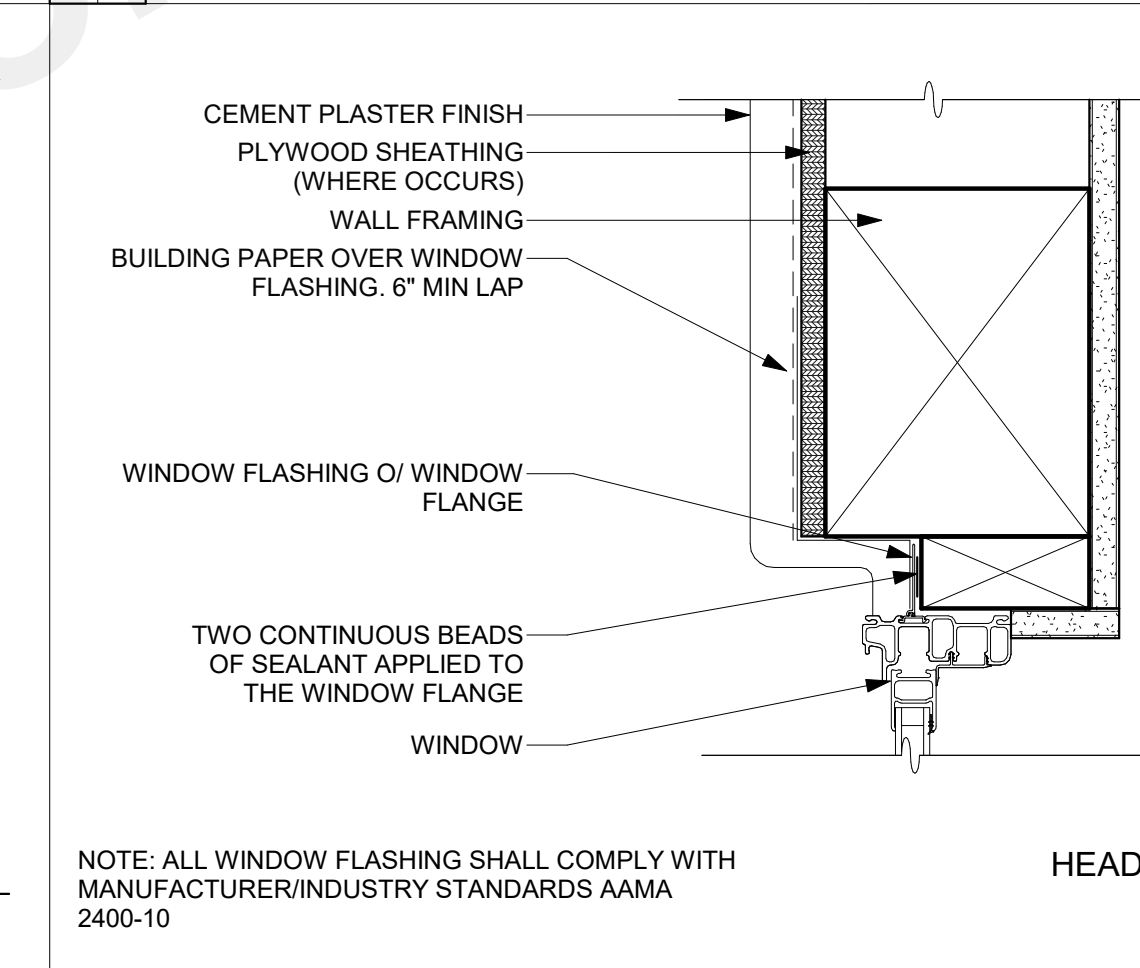


12 TYP. WINDOW HEAD

SCALE: 3" = 1'-0"

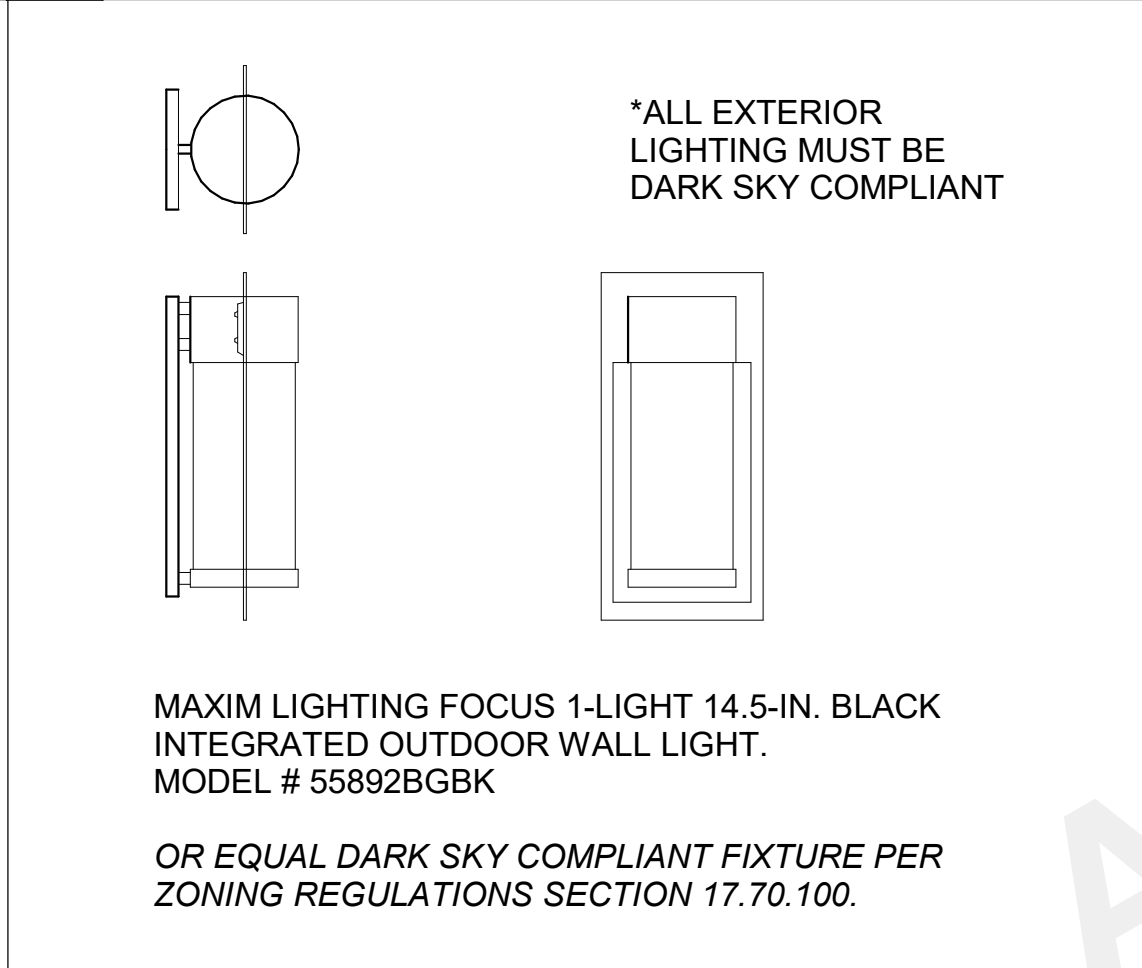


53 LIGHT FIXTURE - DESERT MODERN

SCALE: 1 1/2" = 1'-0"

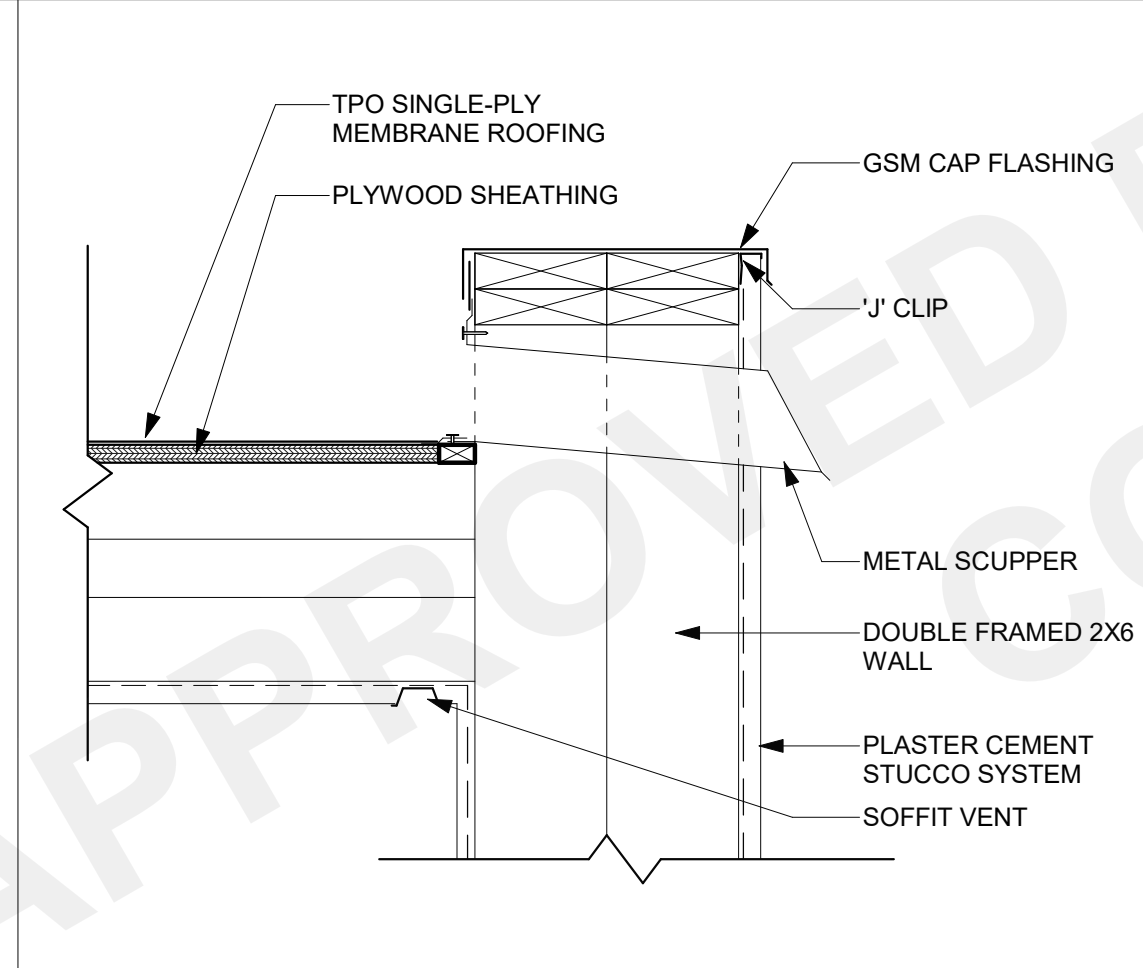


43 ROOF SCUPPER - DESERT MODERN

SCALE: 1 1/2" = 1'-0"

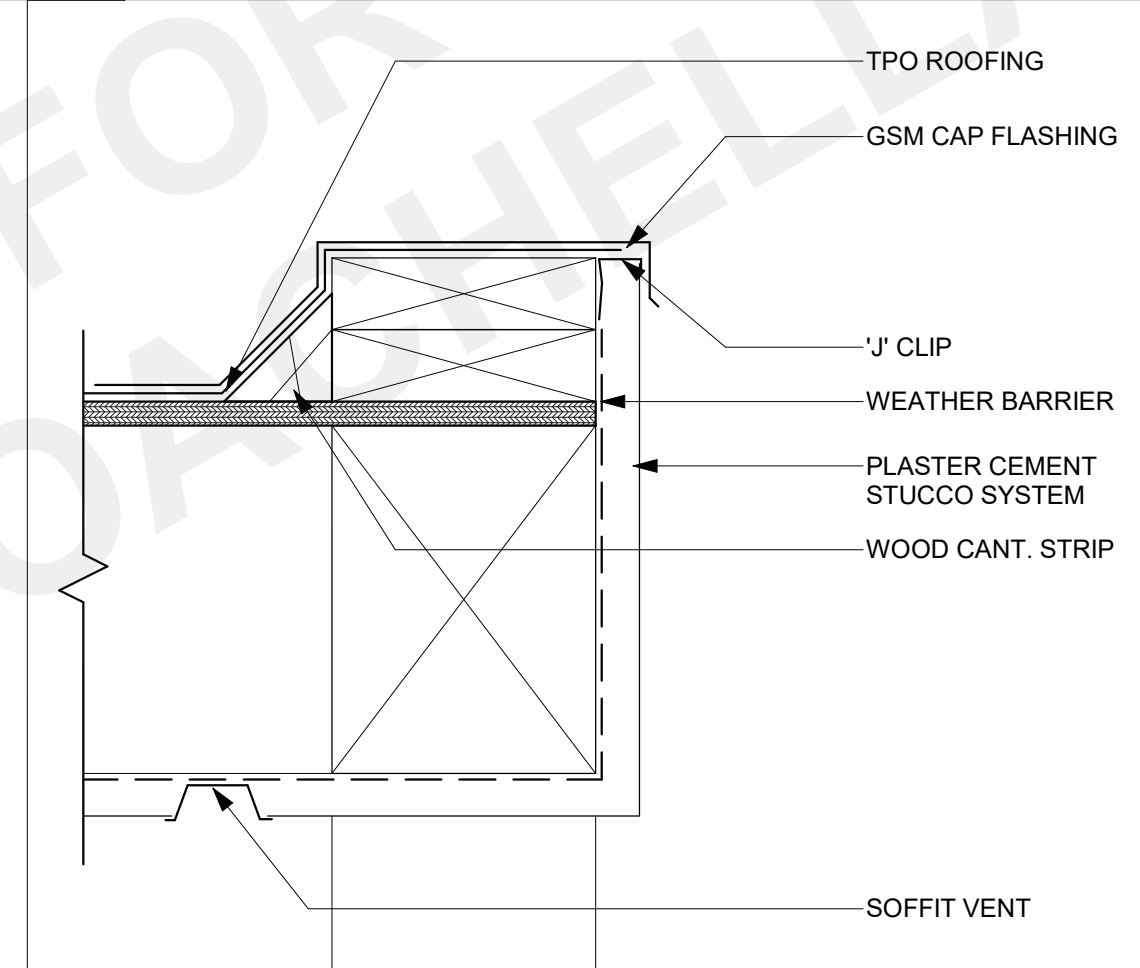


33 POST CAP AND BASE - MODERN

SCALE: 3" = 1'-0"

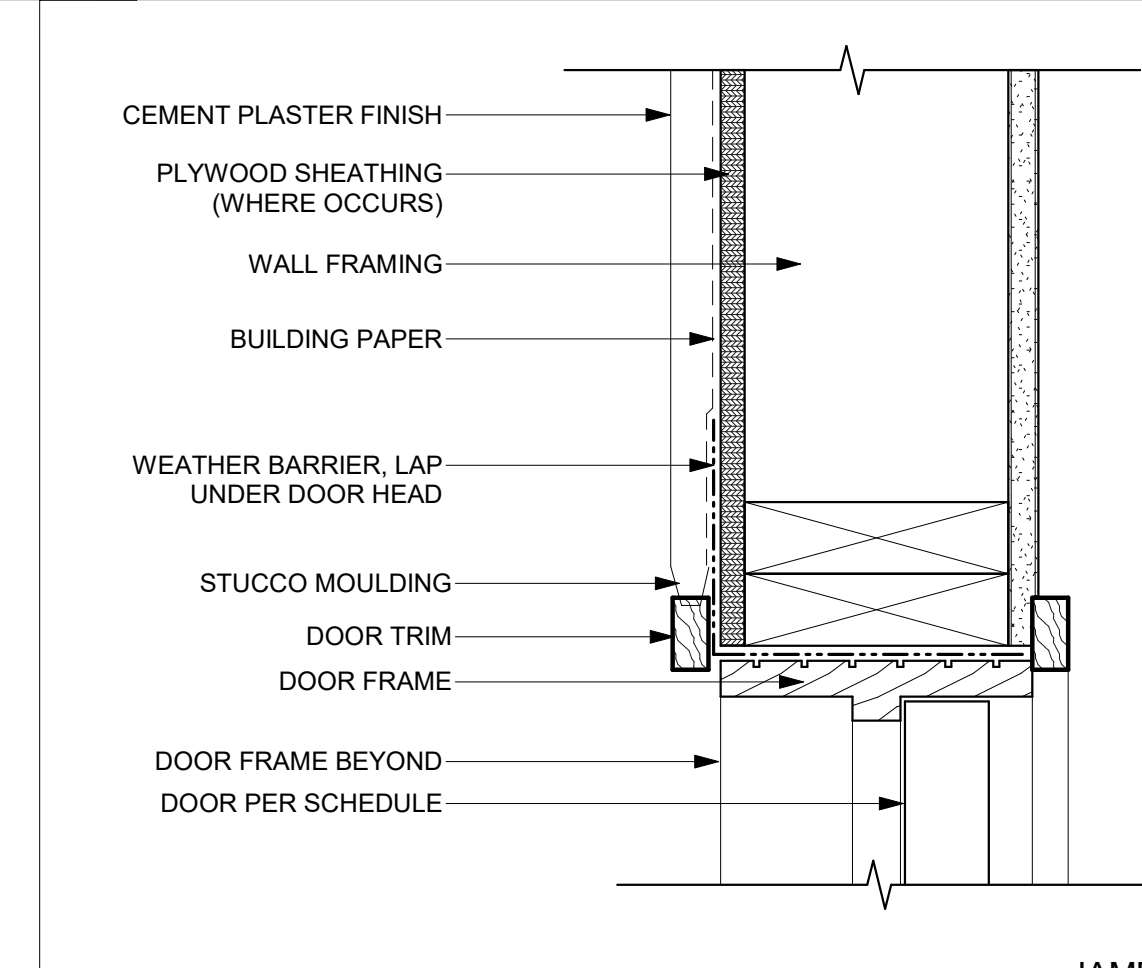


23 DOOR JAMB - MODERN

SCALE: 3" = 1'-0"

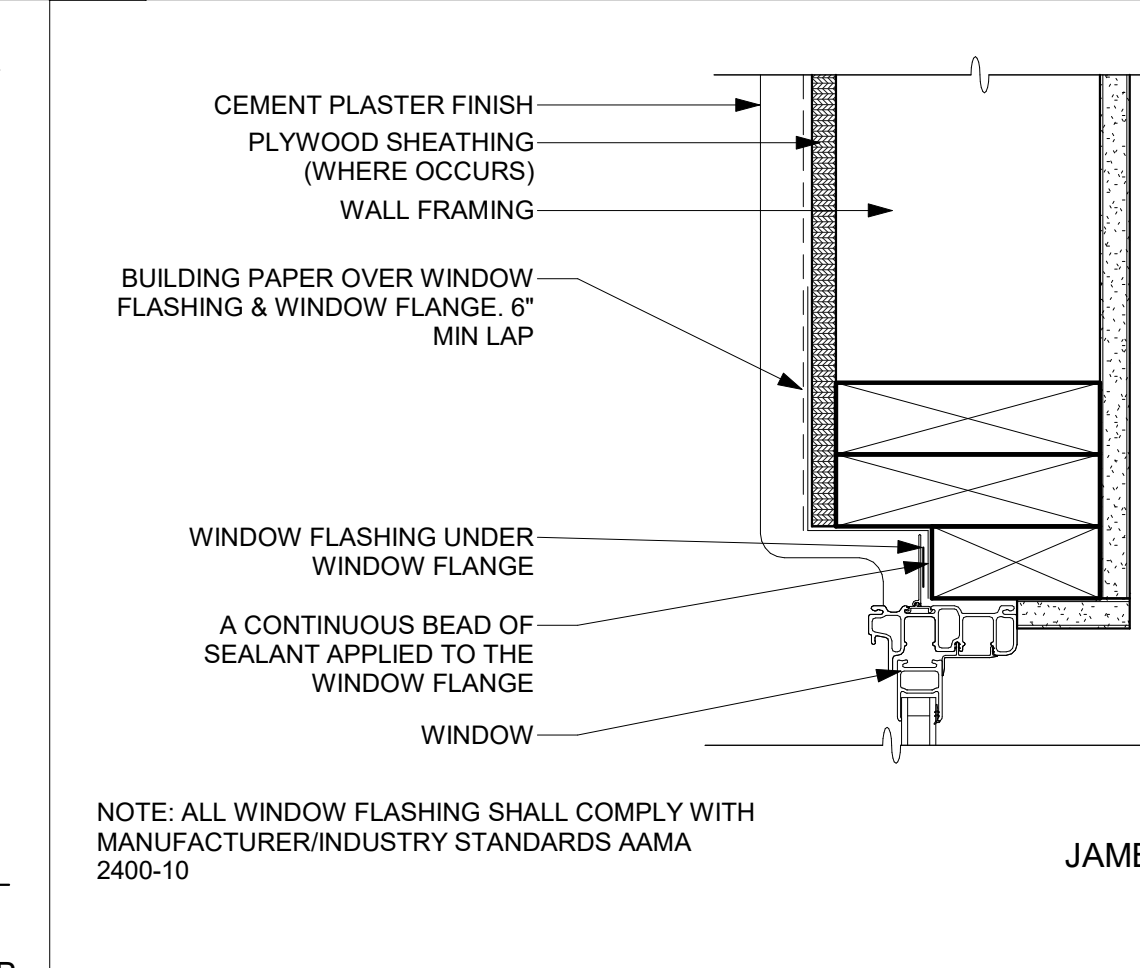


13 TYP. WINDOW JAMB

SCALE: 3" = 1'-0"

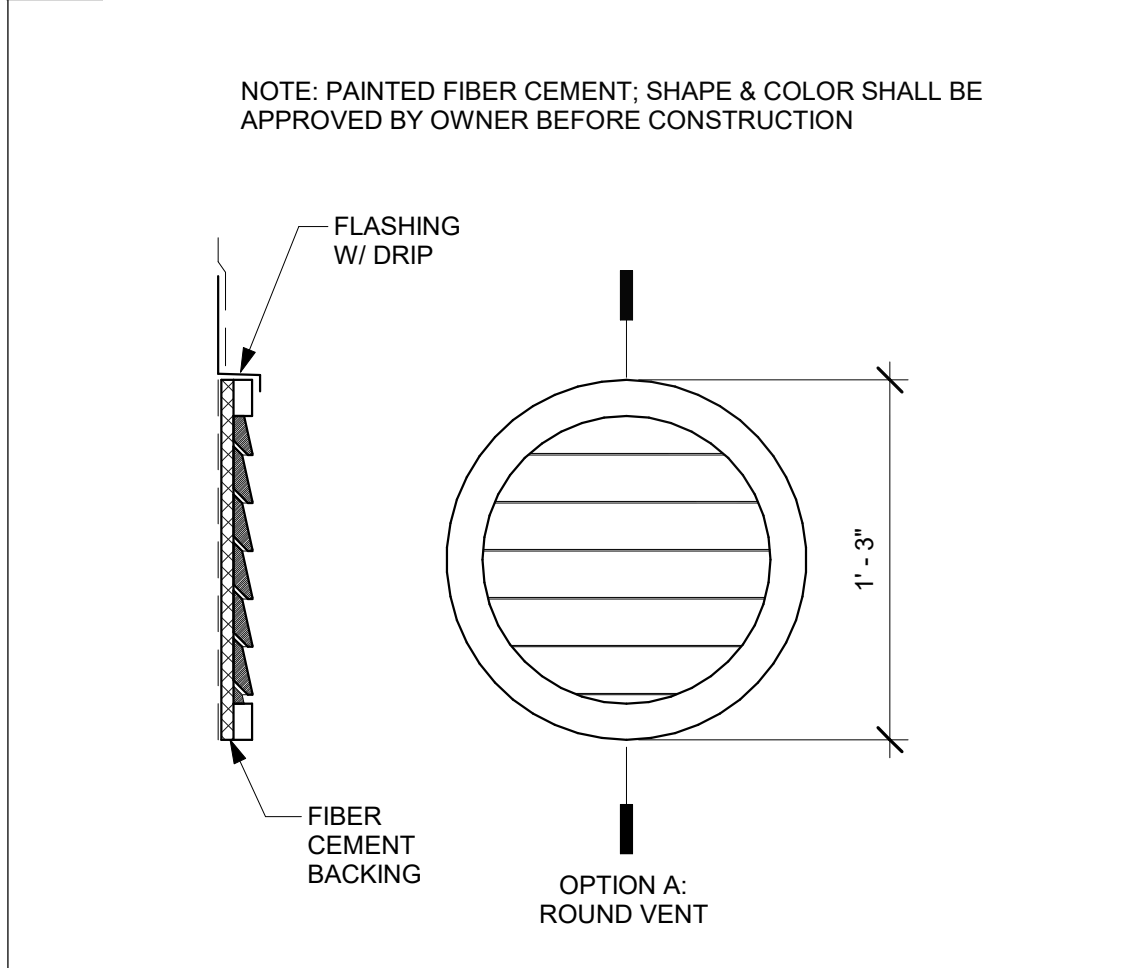


54 CIRCLE VENT

SCALE: 1 1/2" = 1'-0"

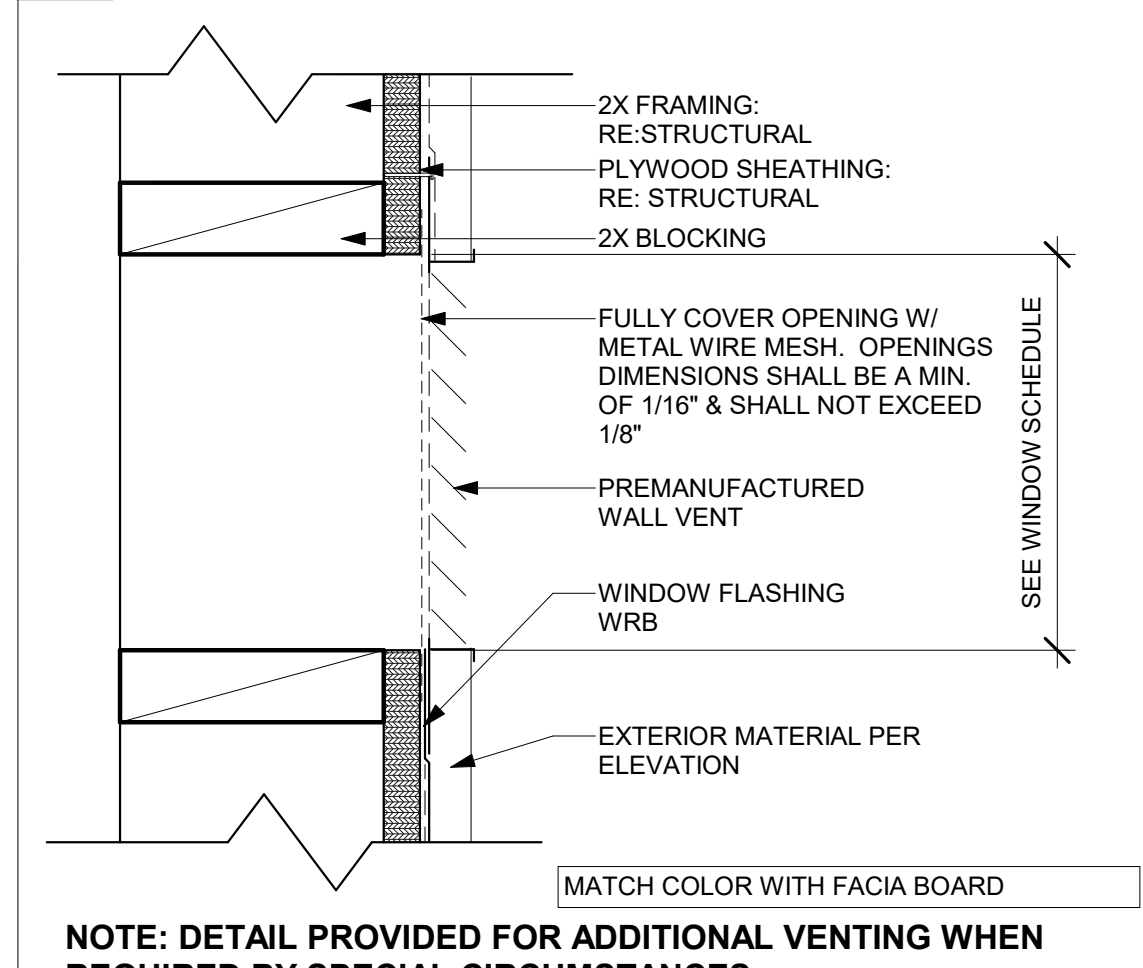


44 WALL VENT

SCALE: 3" = 1'-0"

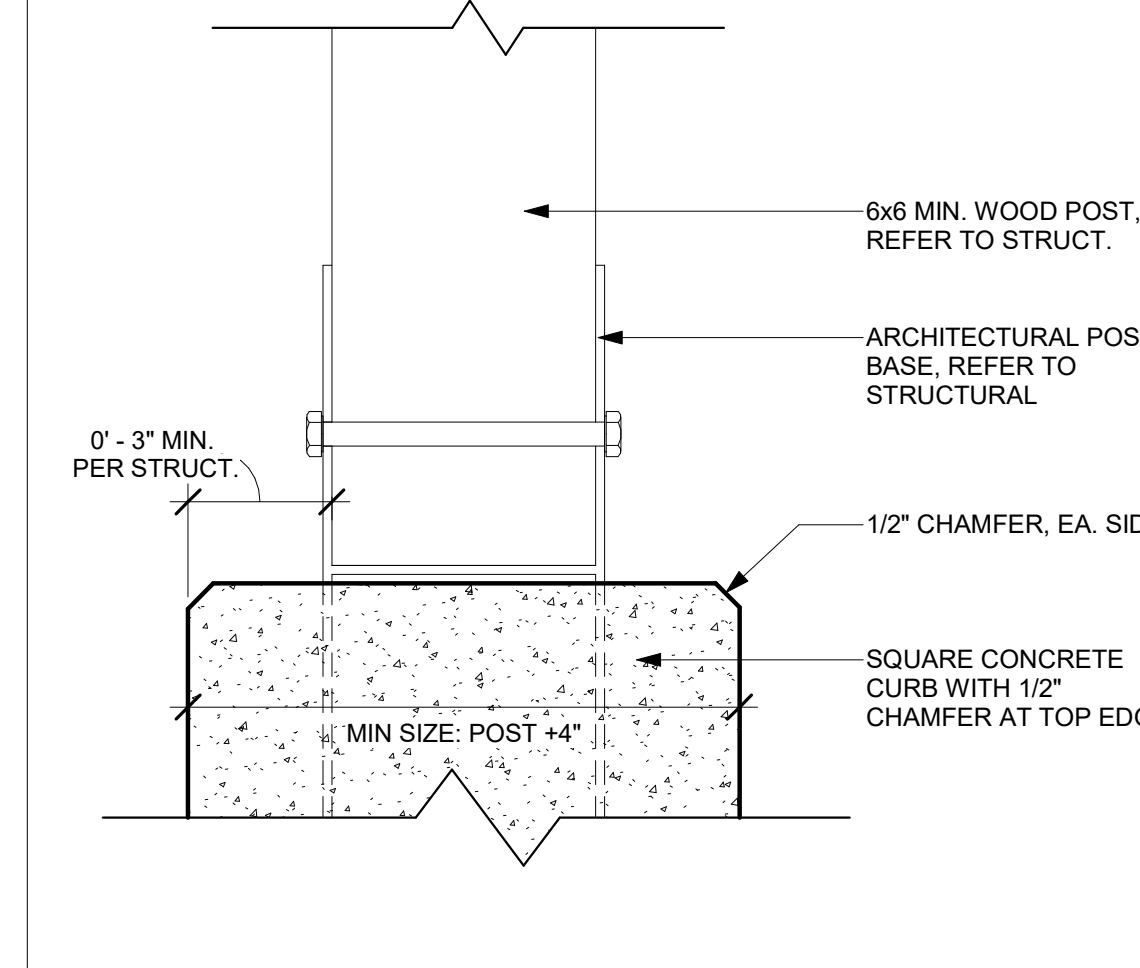


34 POST CAP AND BASE - MODERN

SCALE: 3" = 1'-0"

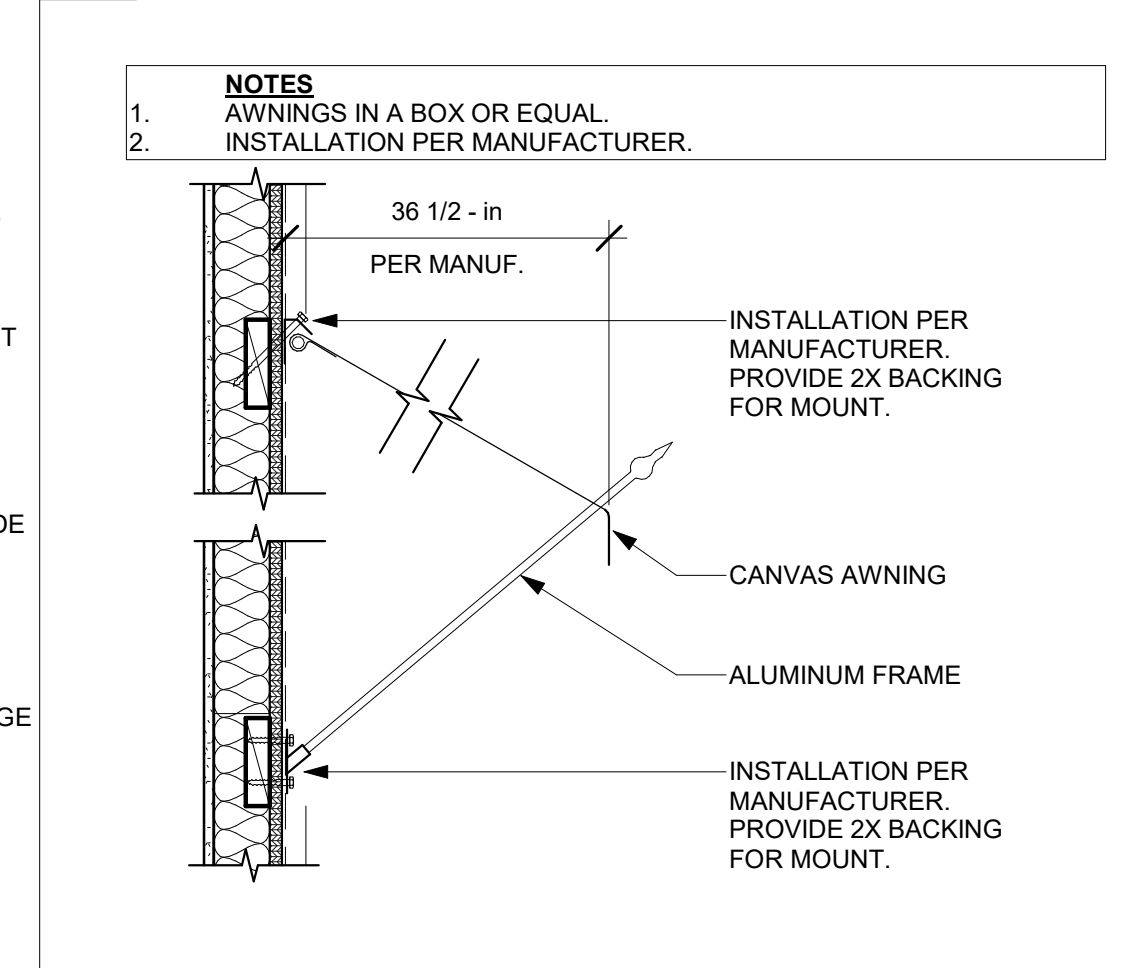

24 AWNING - MODERN

SCALE: 1" = 1'-0"

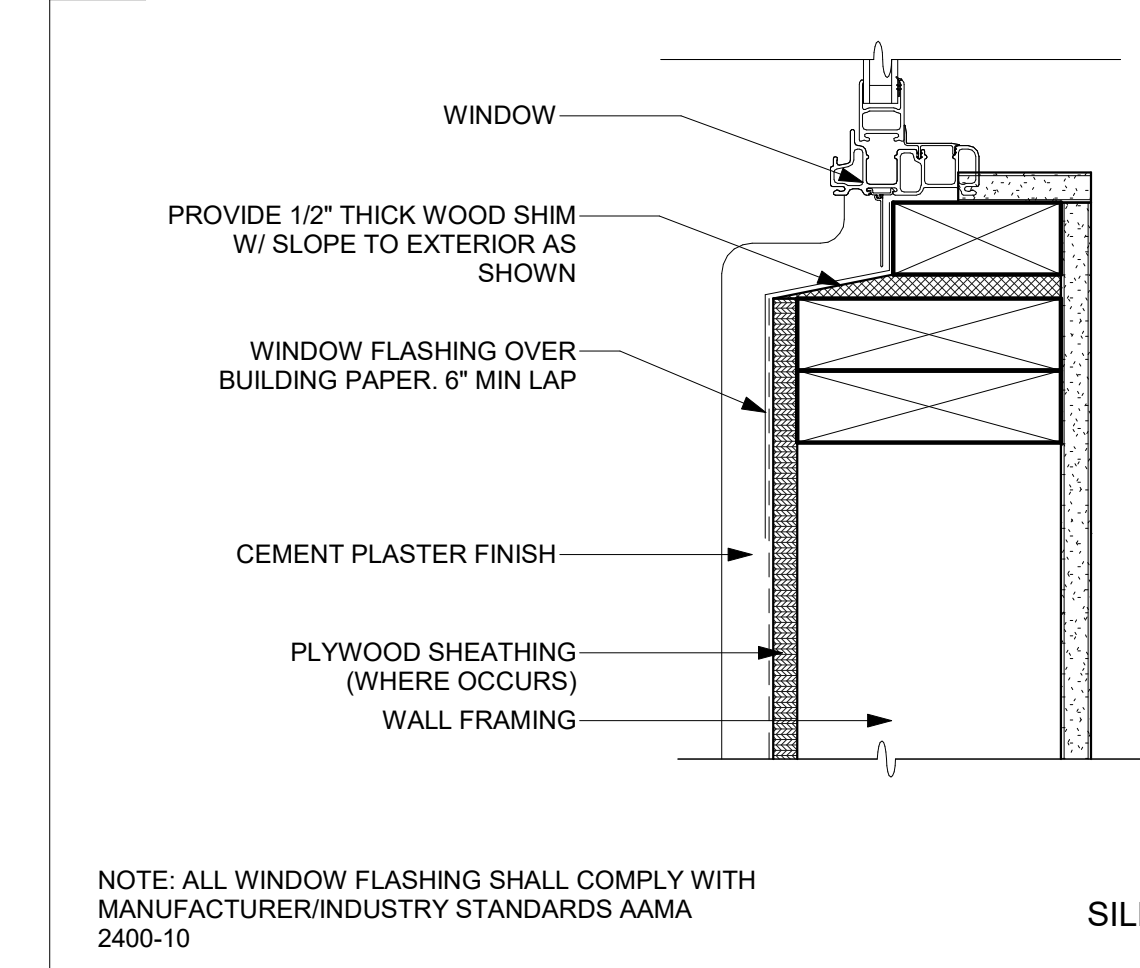

14 TYP. WINDOW SILL

















SCALE: 3" = 1'-0"

PROTOTYPE ADU
2 CAR GARAGE CONVERSION
COACHELLA, CA
ARCHITECTURAL DETAILS - DESERT
MODERN

PUBLIC SET
DATE
01/11/24
SHEET
AD-904

1/19/2024 8:55:08 AM Autodesk Docs/12393_Coachella ADU/2939-01_Coachella ADUs_Garage Unit.rvt

1/19/2024 8:55:07 AM
Autodesk Docs/72393_Coachella ADU/2939-01_Coachella ADUs_Garage Unit.rvt

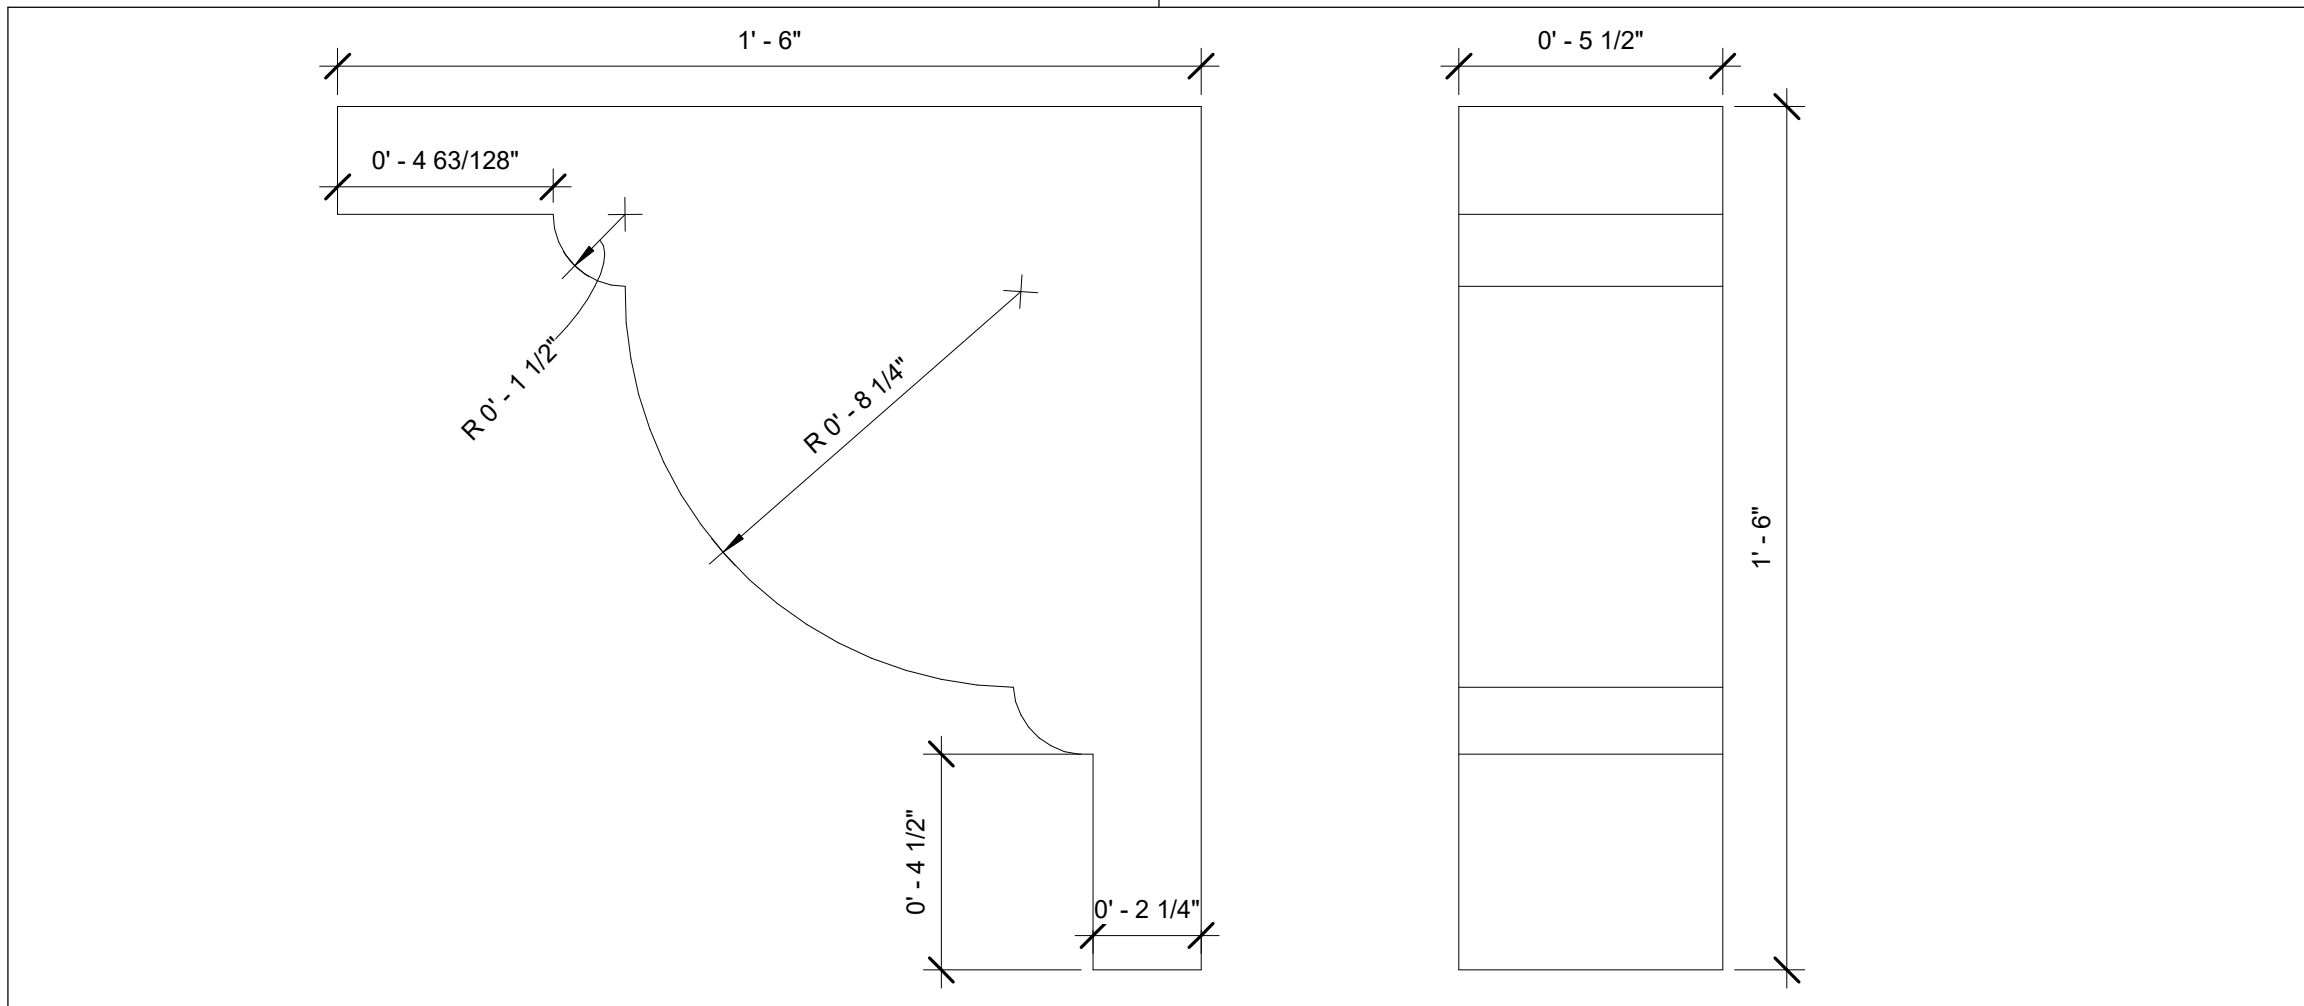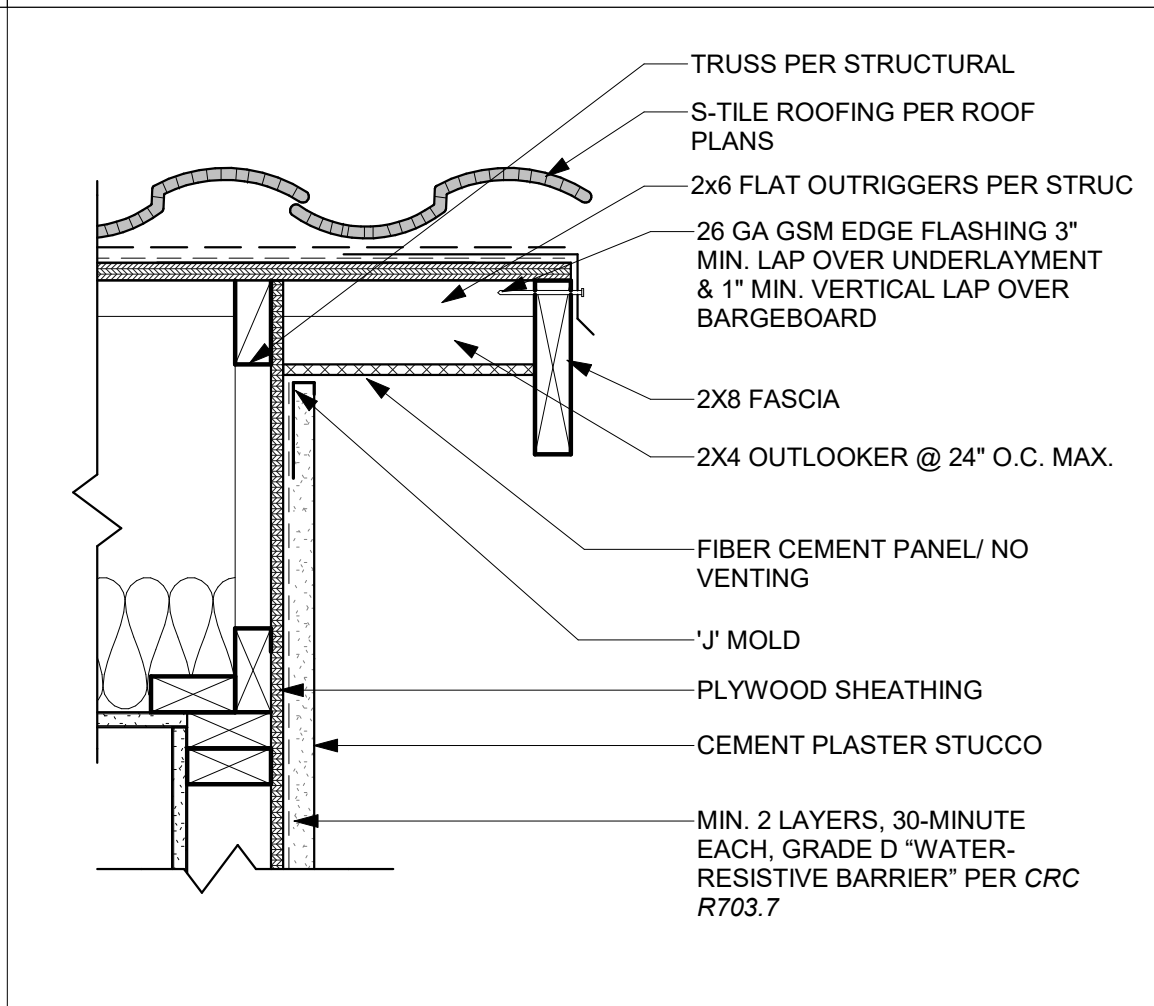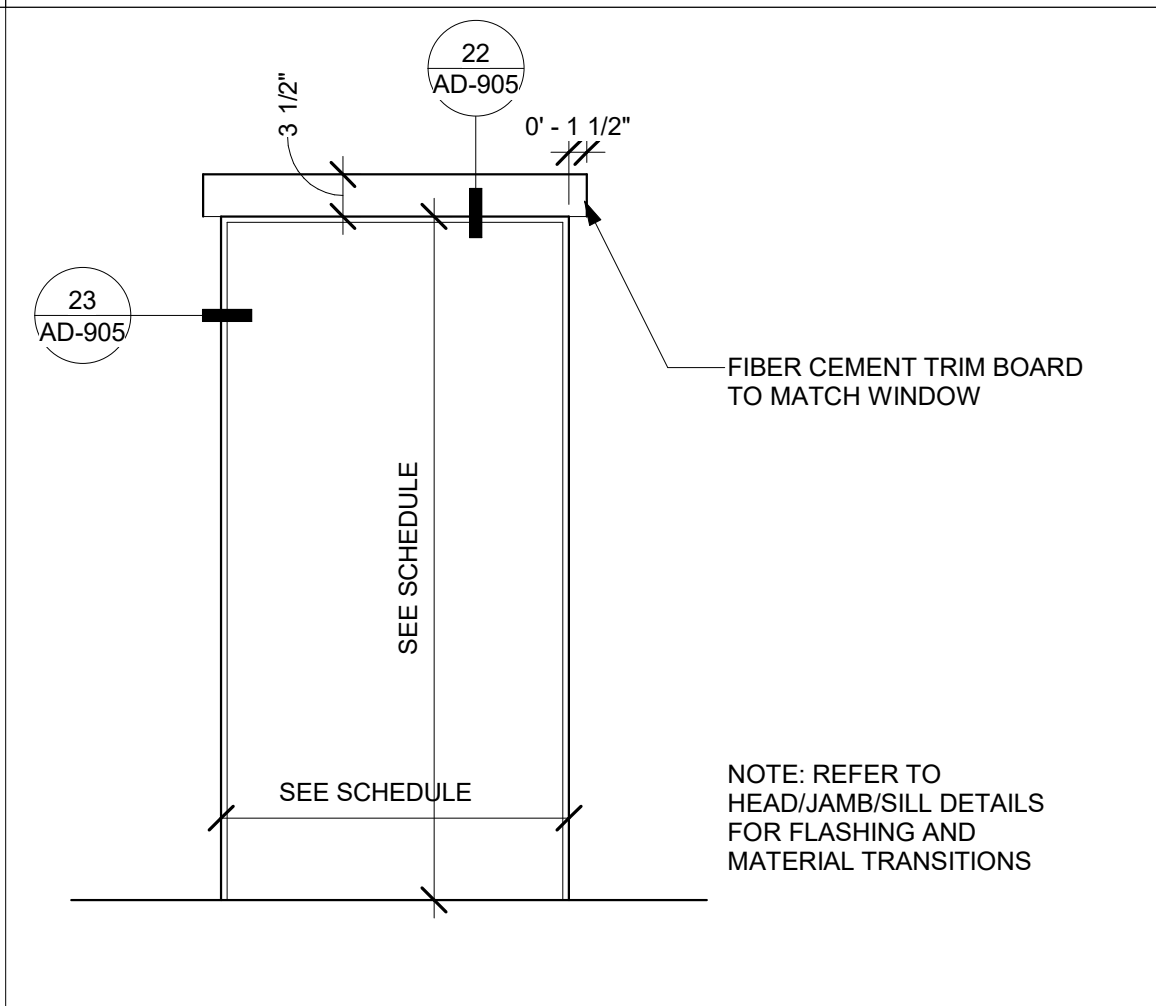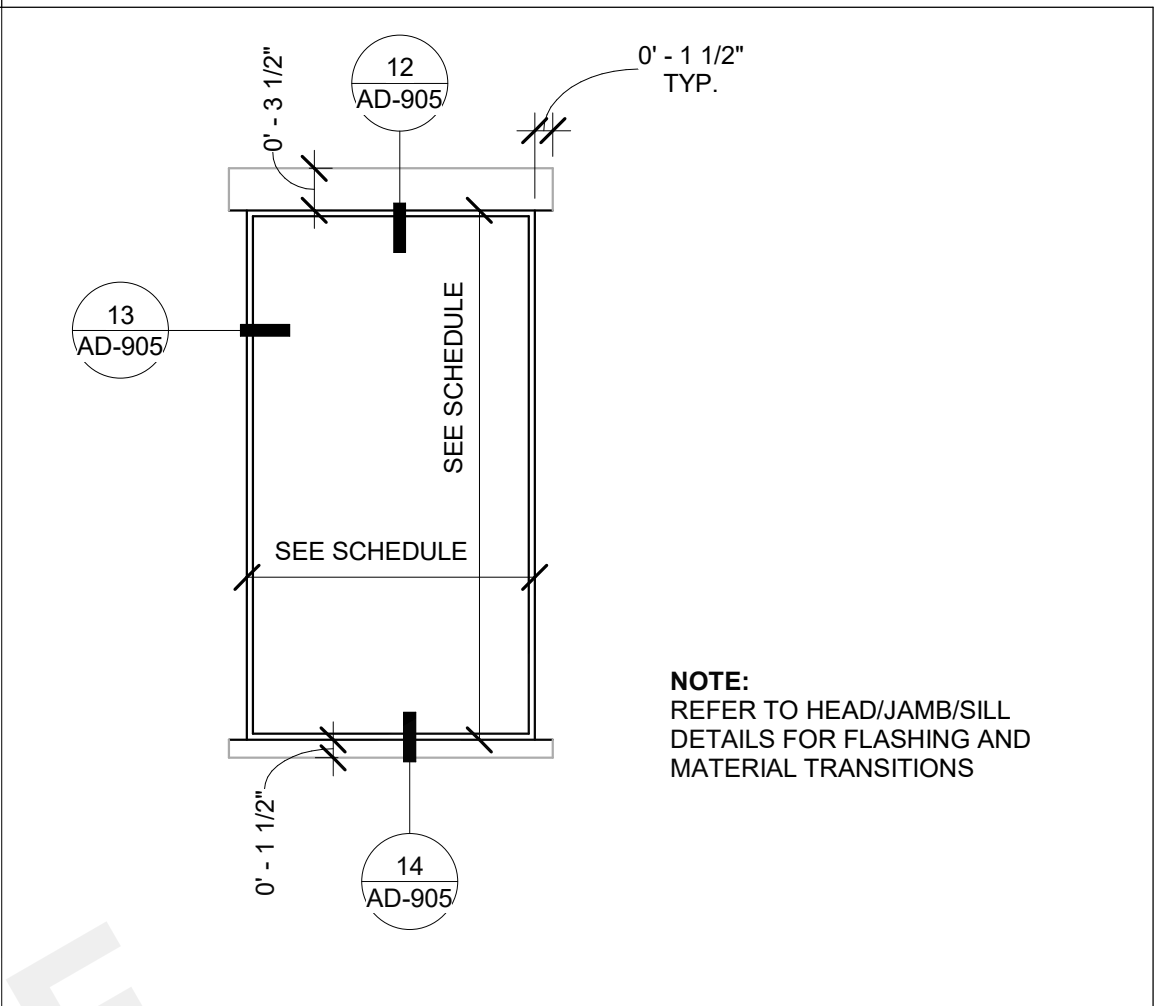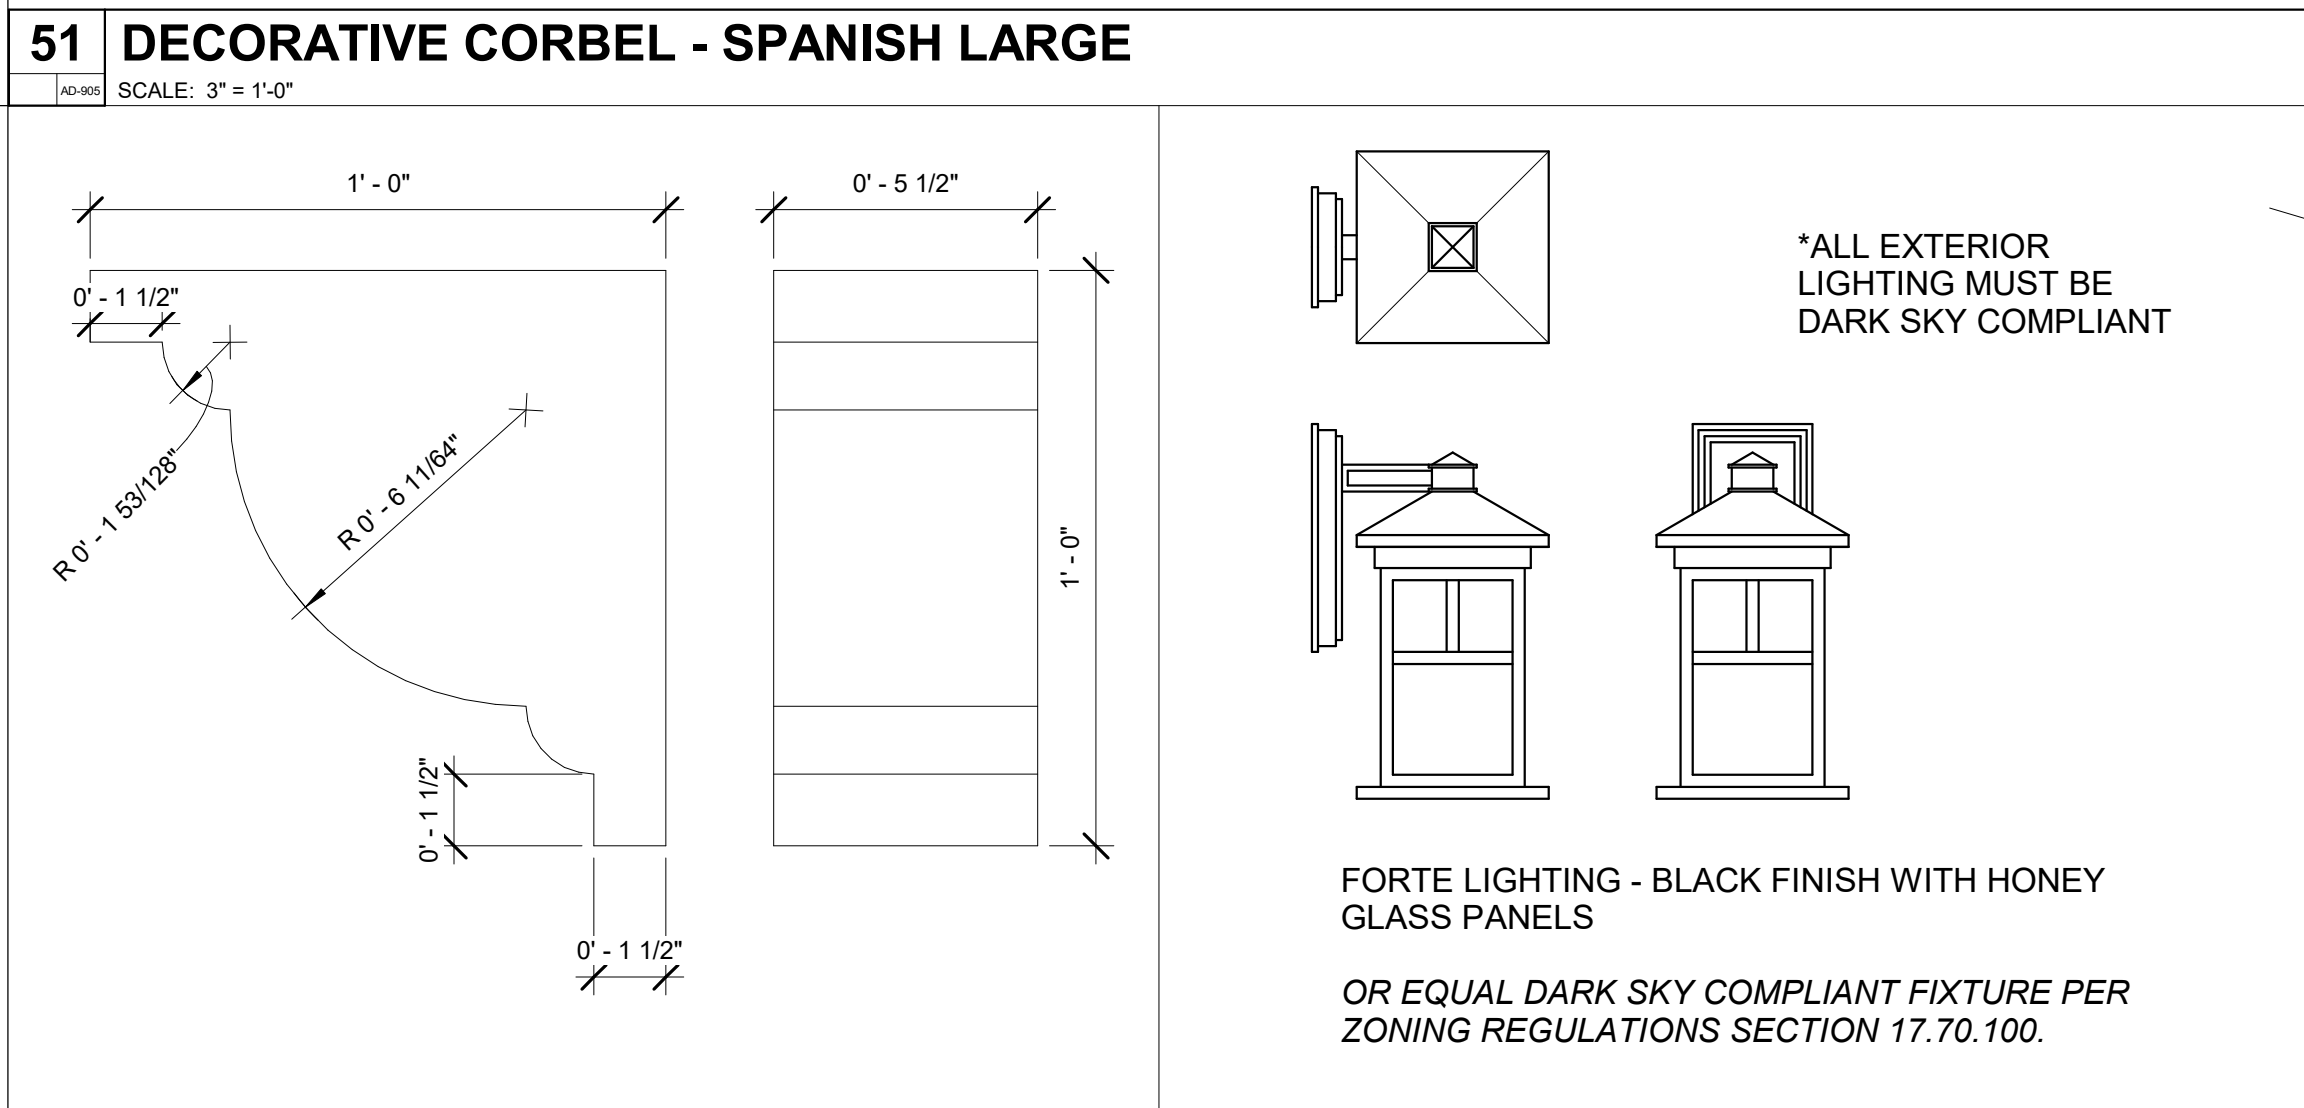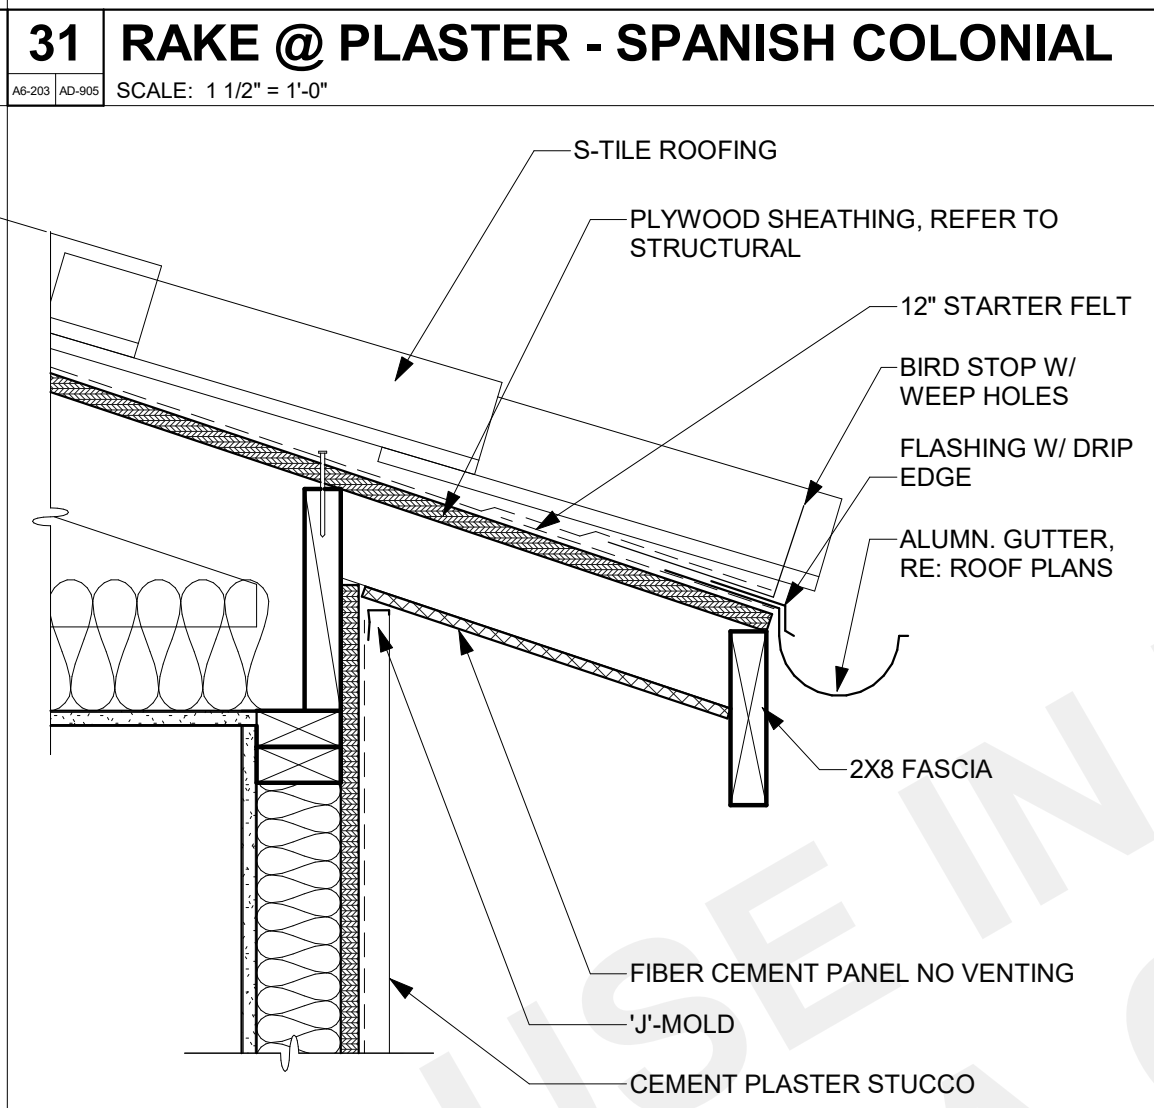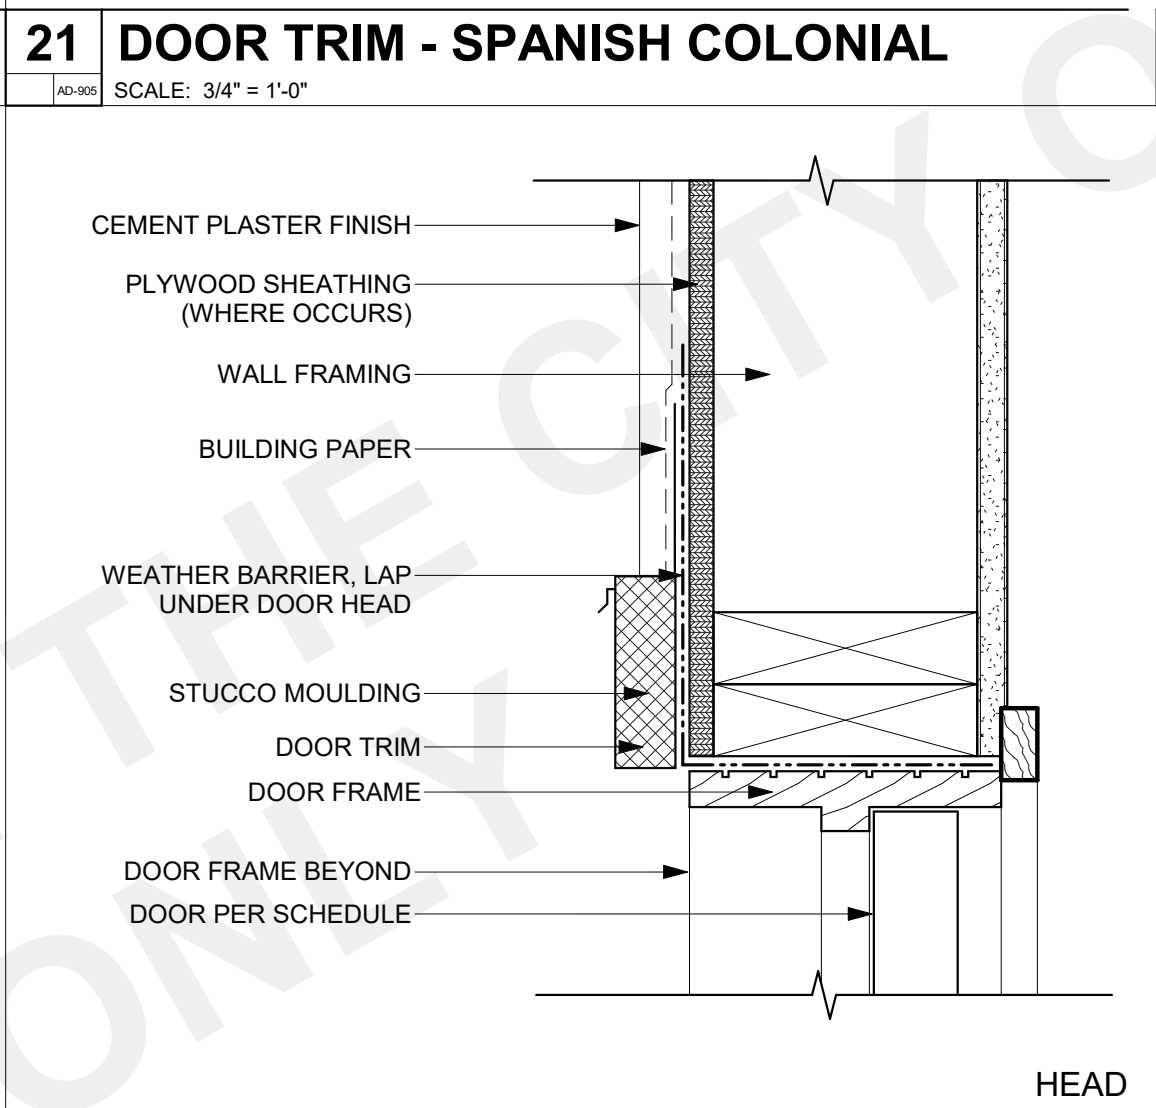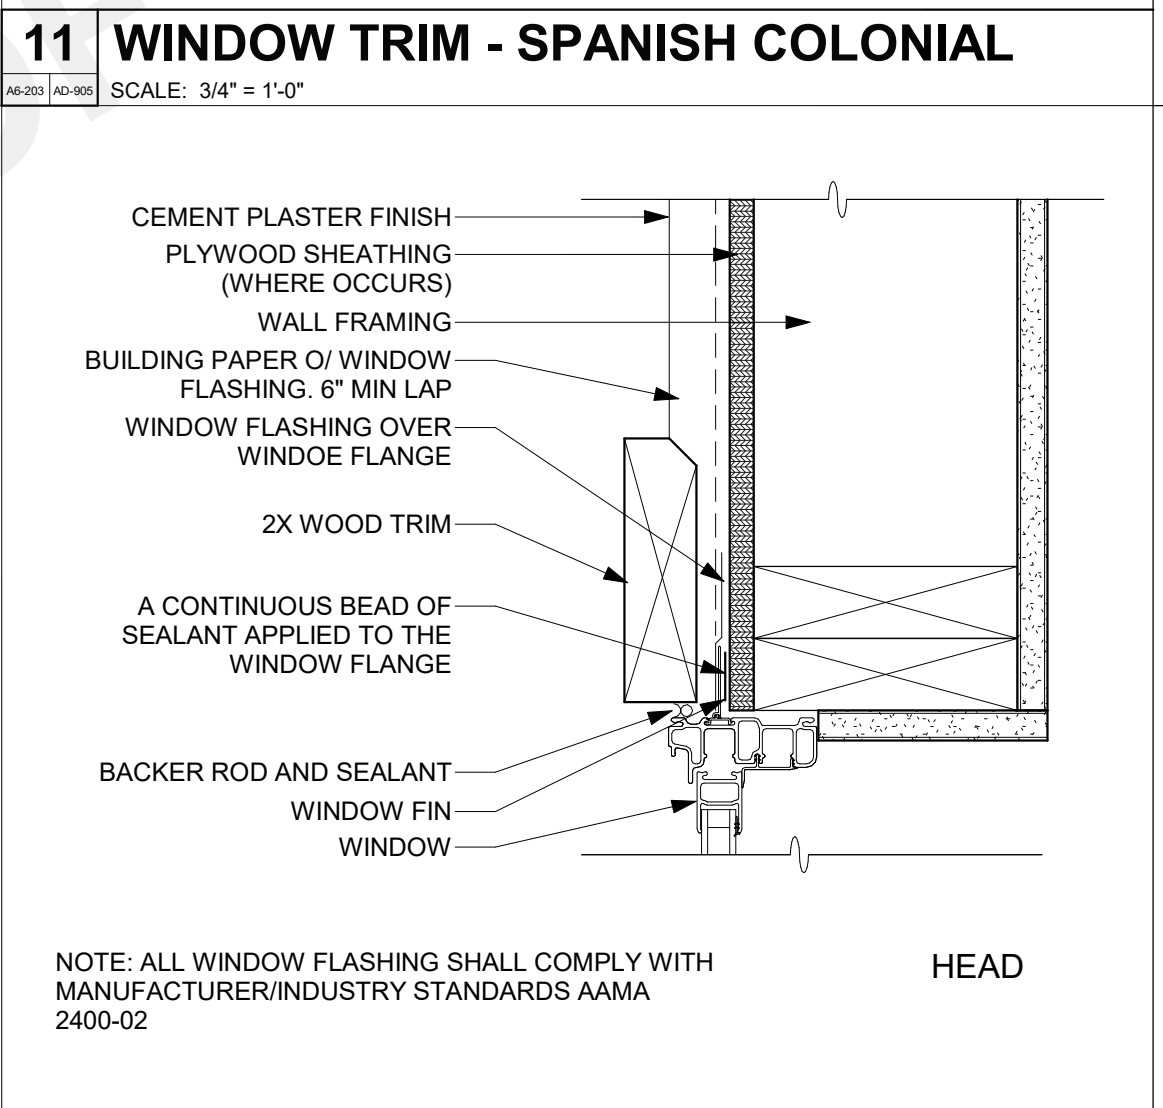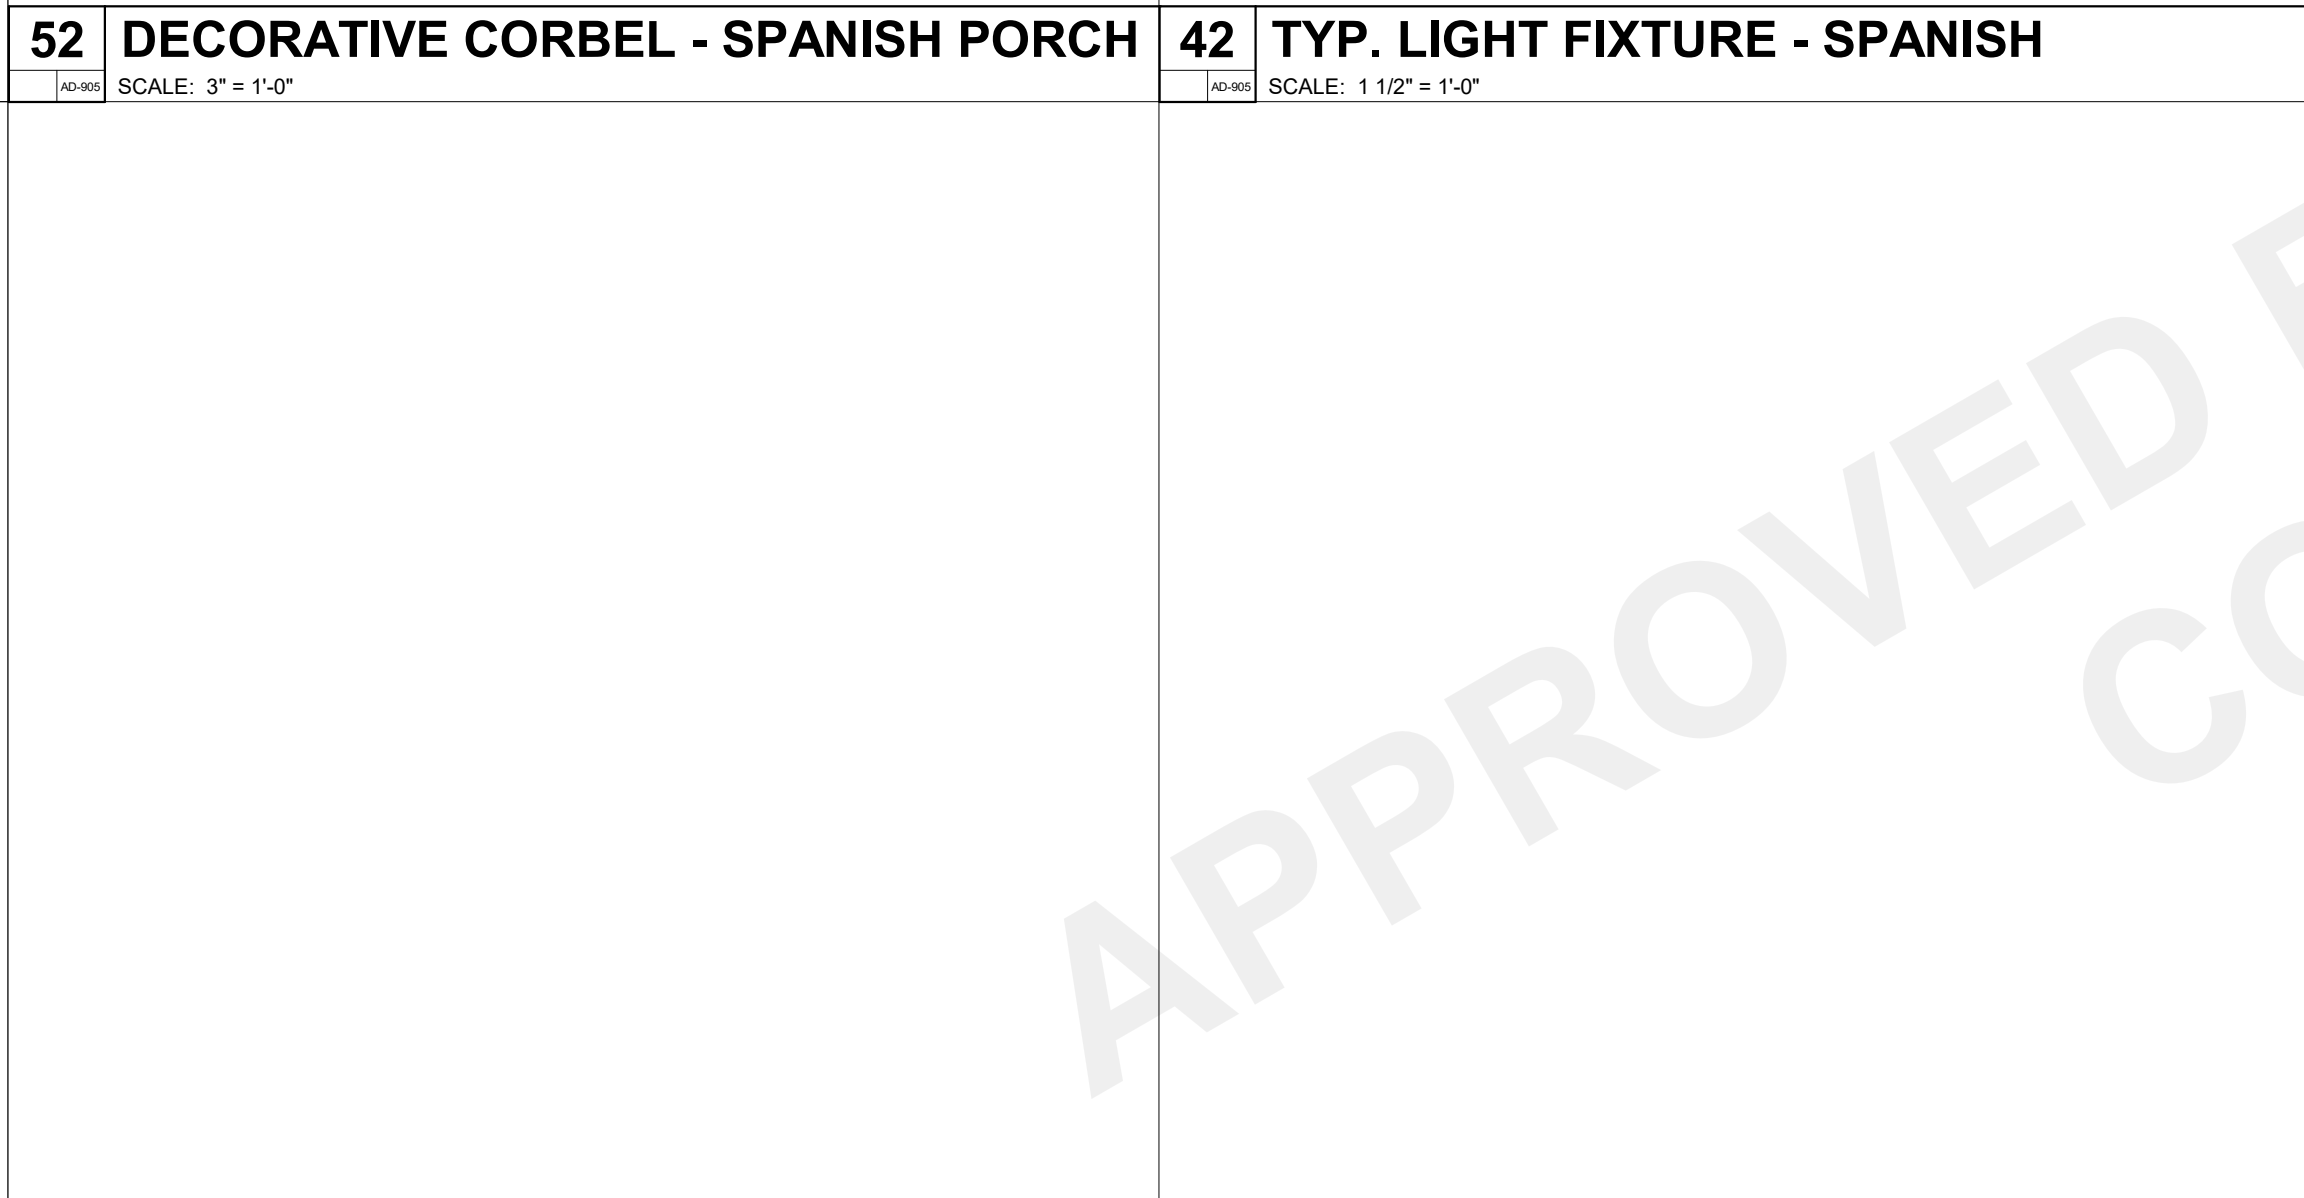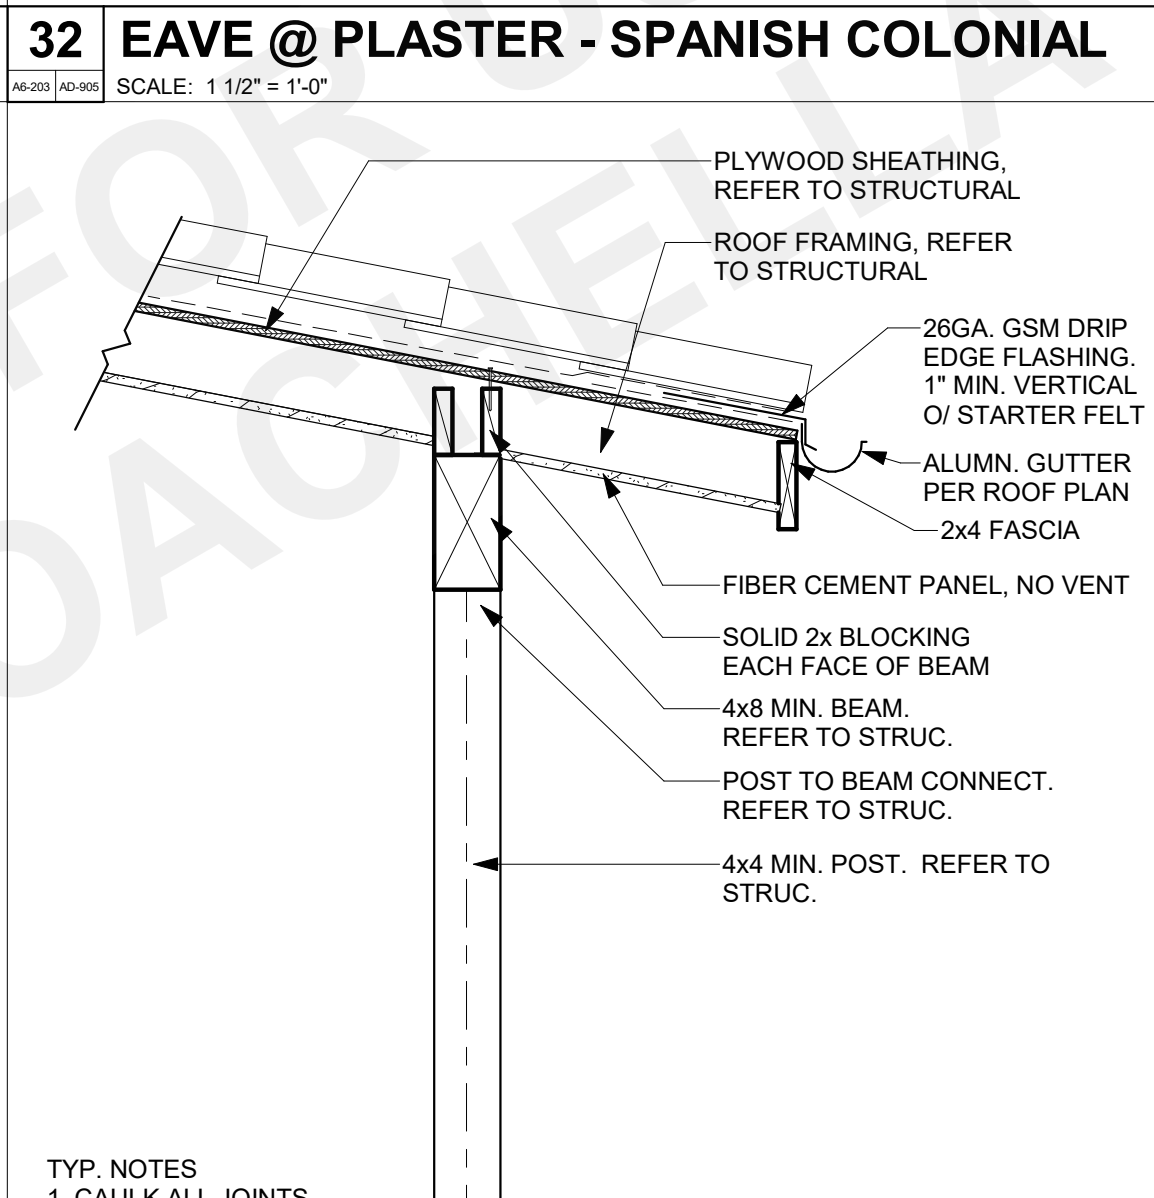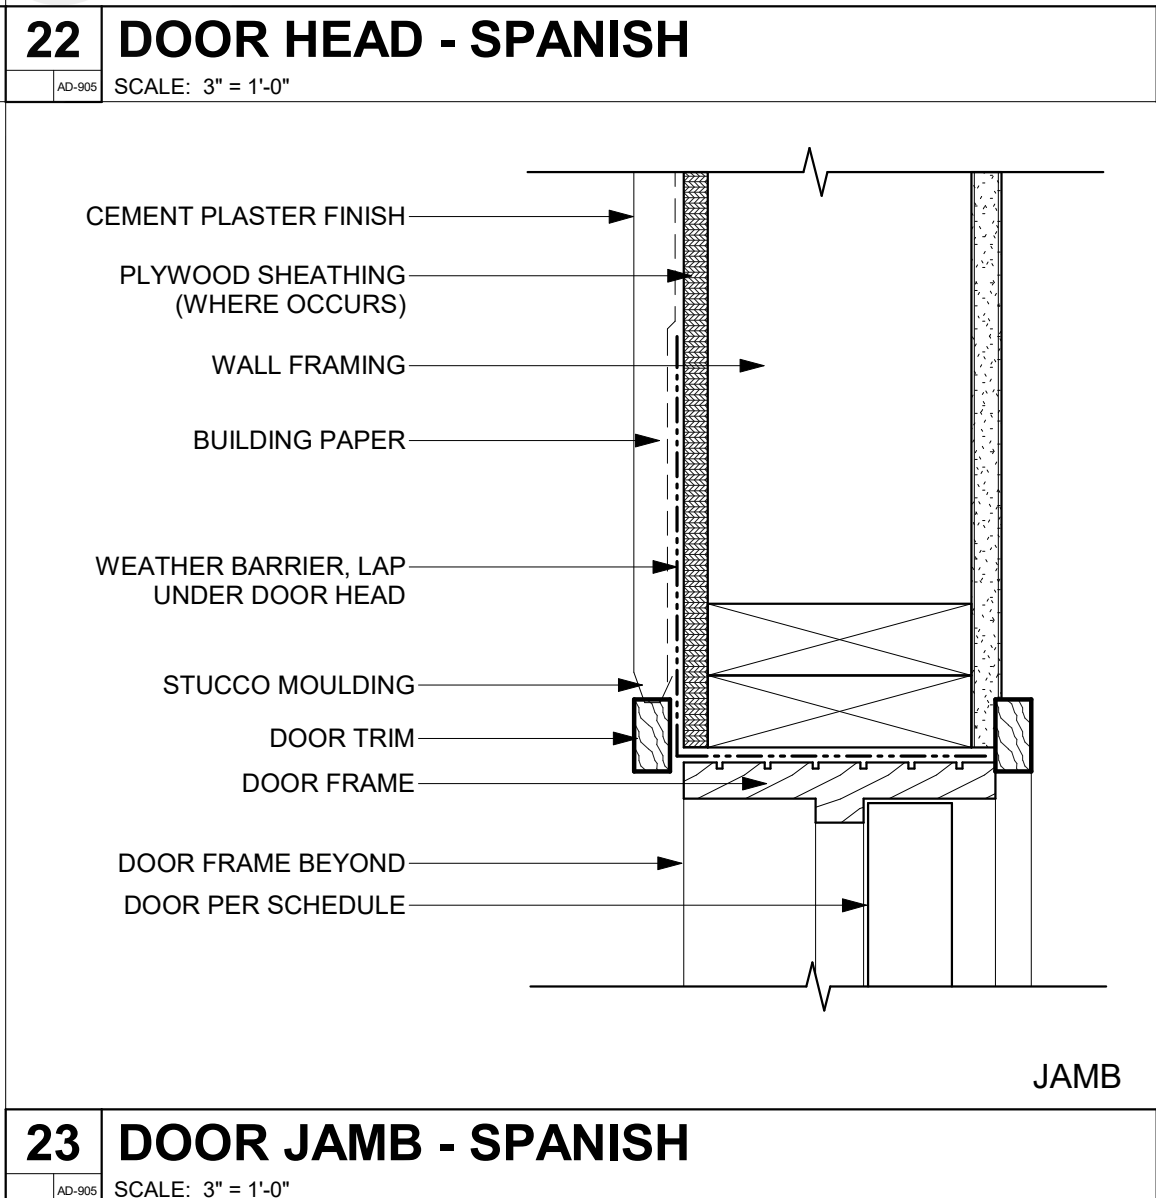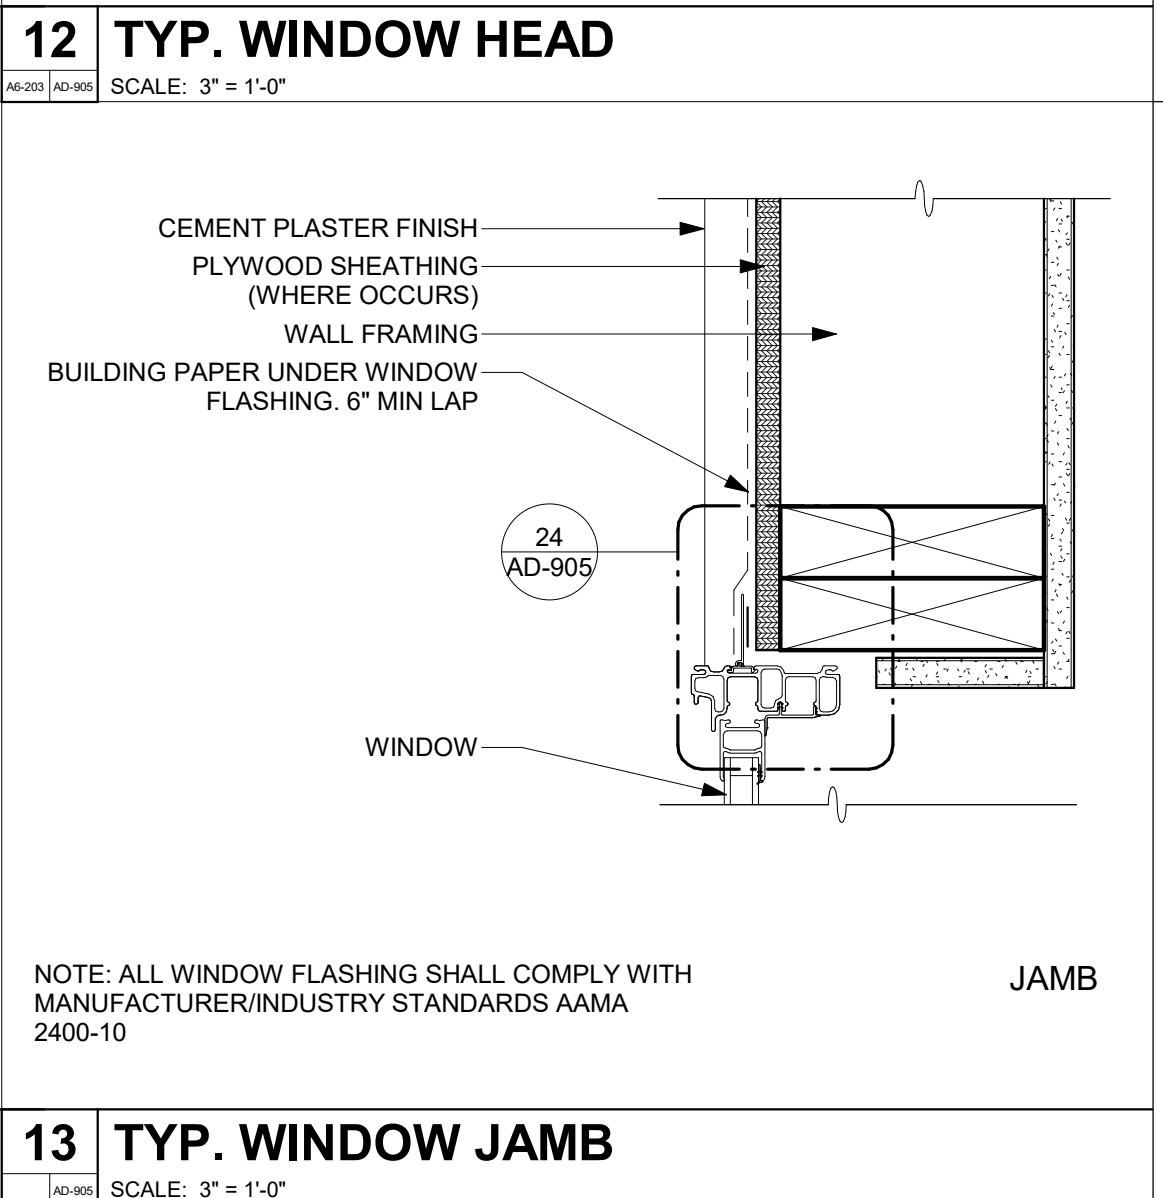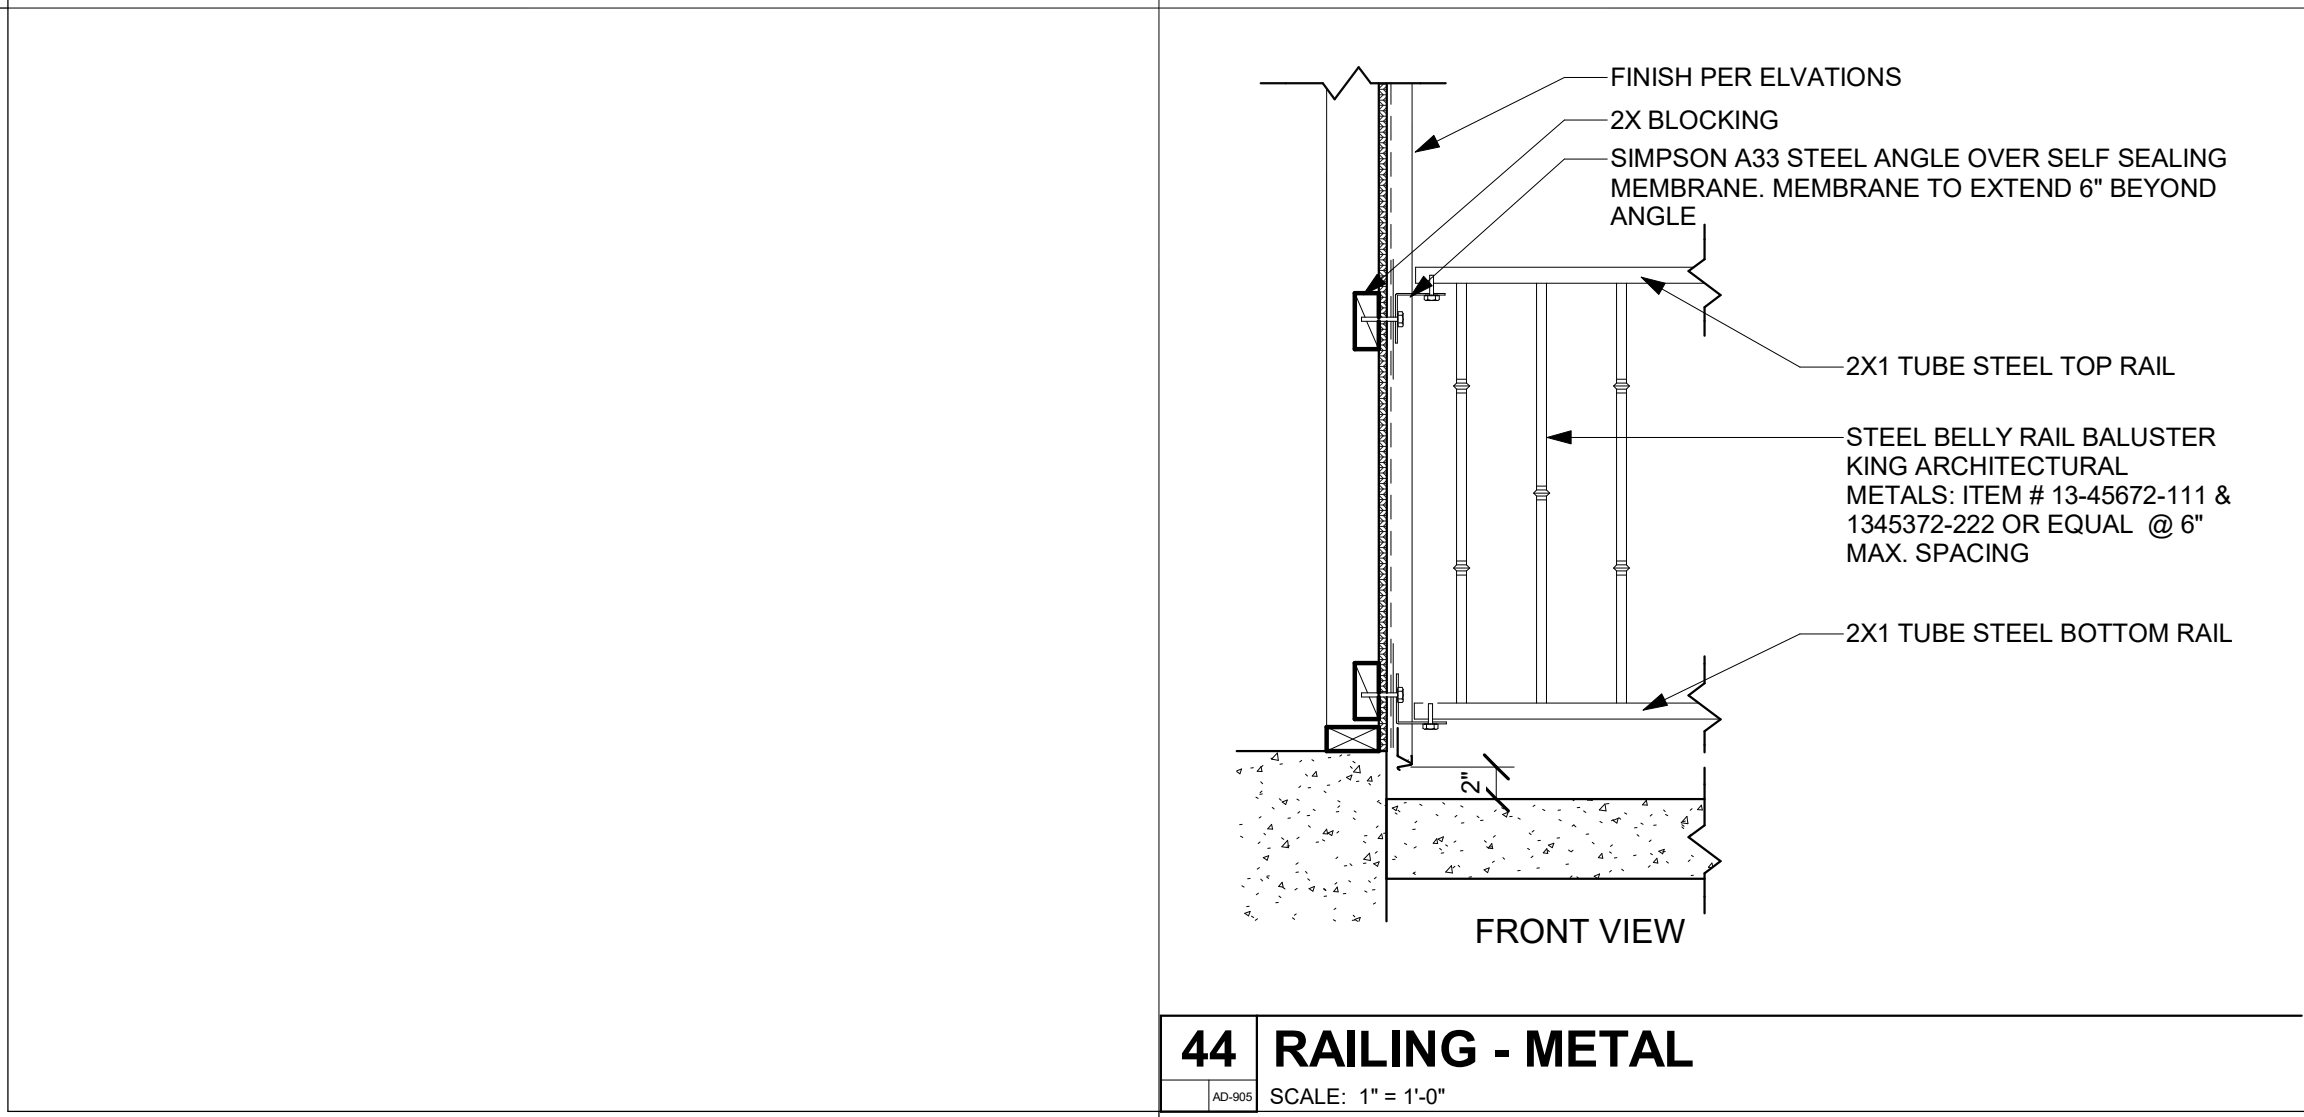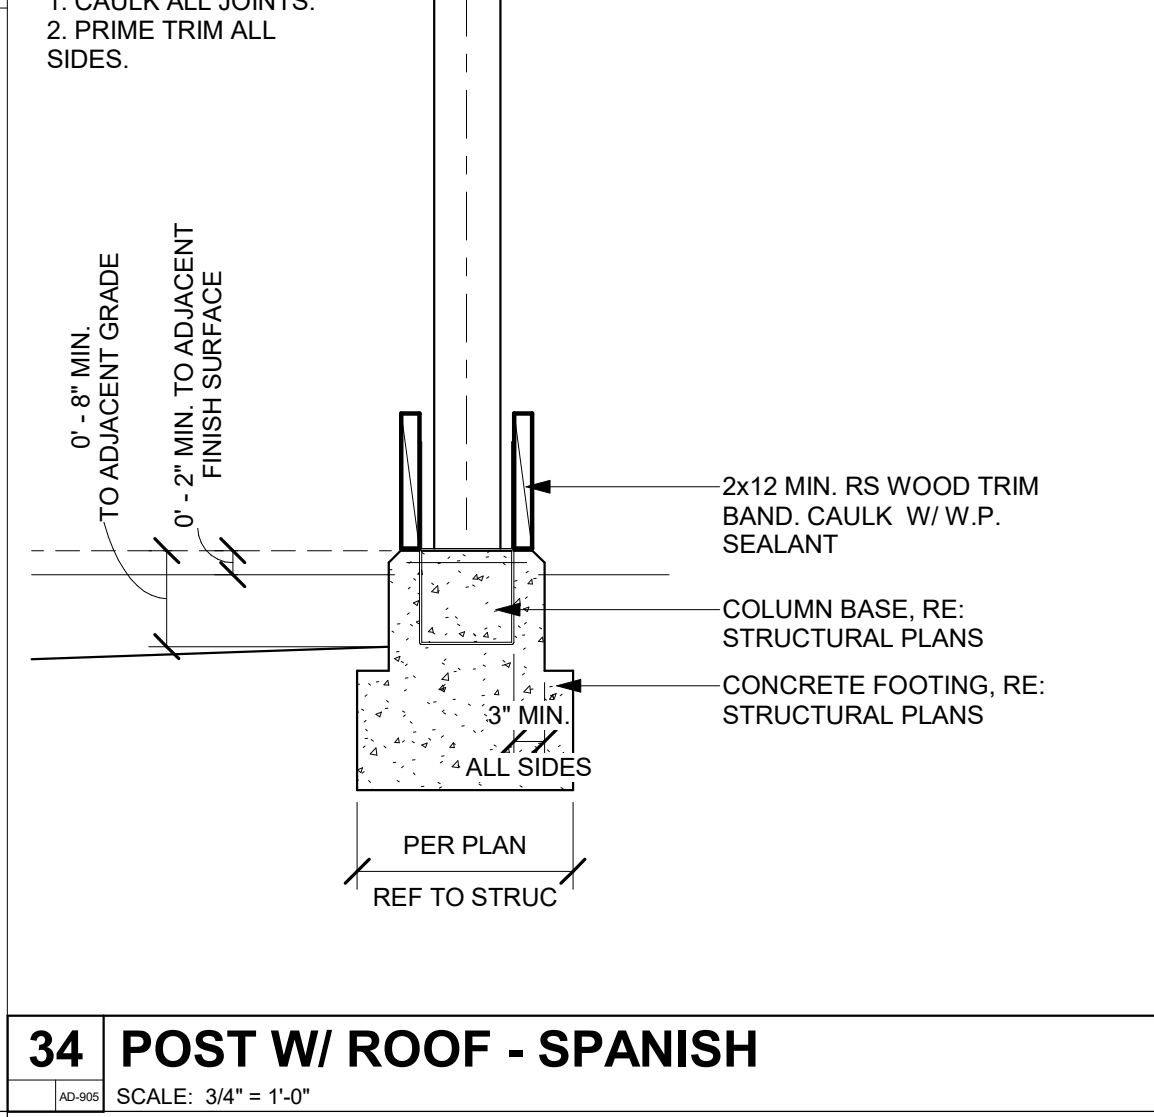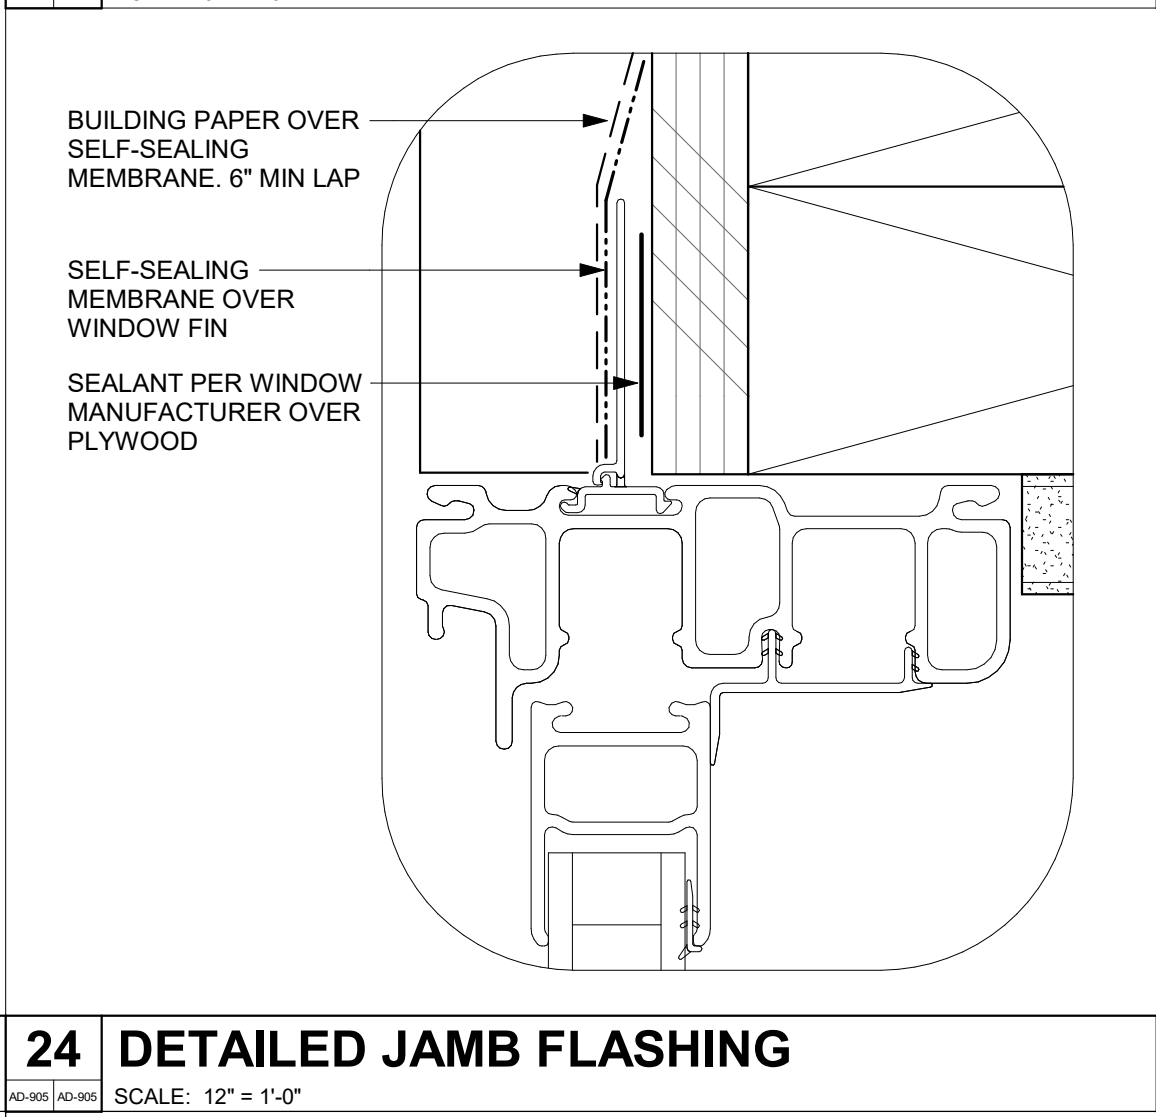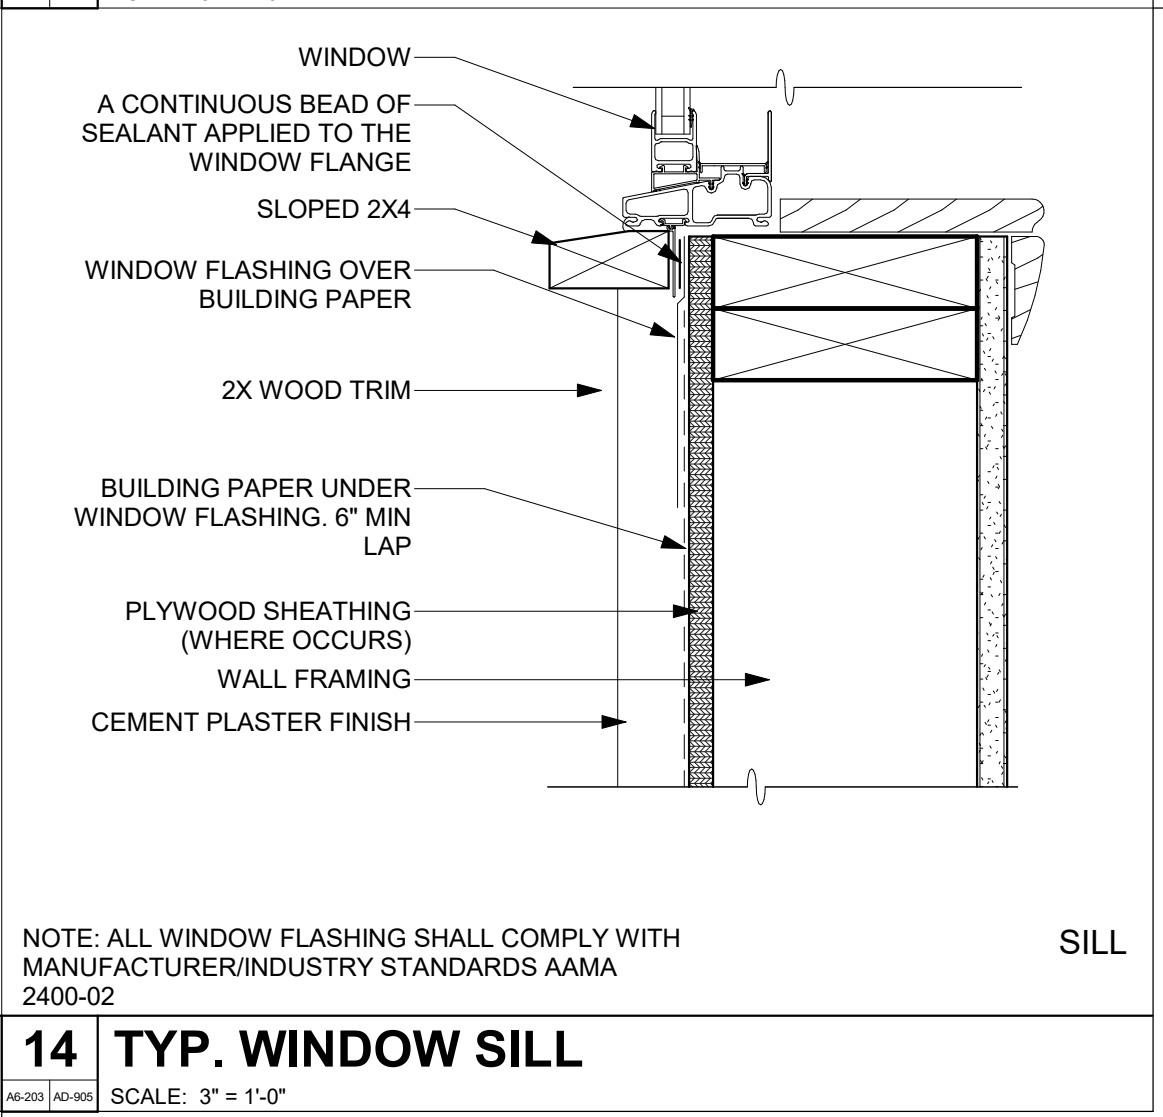 51 DECORATIVE CORBEL - SPANISH LARGE SCALE: 3" = 1'-0"	 31 RAKE @ PLASTER - SPANISH COLONIAL SCALE: 1 1/2" = 1'-0"	 21 DOOR TRIM - SPANISH COLONIAL SCALE: 3/4" = 1'-0"	 11 WINDOW TRIM - SPANISH COLONIAL SCALE: 3/4" = 1'-0"
 52 DECORATIVE CORBEL - SPANISH PORCH SCALE: 3" = 1'-0"	 42 TYP. LIGHT FIXTURE - SPANISH SCALE: 1 1/2" = 1'-0"	 32 EAVE @ PLASTER - SPANISH COLONIAL SCALE: 1 1/2" = 1'-0"	 22 DOOR HEAD - SPANISH SCALE: 3" = 1'-0"
 44 RAILING - METAL SCALE: 1" = 1'-0"	 34 POST W/ ROOF - SPANISH SCALE: 3/4" = 1'-0"	 23 DOOR JAMB - SPANISH SCALE: 3" = 1'-0"	 12 TYP. WINDOW HEAD SCALE: 3" = 1'-0"
 44 RAILING - METAL SCALE: 1" = 1'-0"	 34 POST W/ ROOF - SPANISH SCALE: 3/4" = 1'-0"	 24 DETAILED JAMB FLASHING SCALE: 12" = 1'-0"	 13 TYP. WINDOW JAMB SCALE: 3" = 1'-0"

City of

COACHELLA

1946

THESE PLANS ARE PROVIDED BY THE CITY OF AGOURA HILLS AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRACT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

PROTOTYPE ADU

2 CAR GARAGE CONVERSION

COACHELLA, CA

ARCHITECTURAL DETAILS -

SPANISH COLONIAL

PUBLIC SET

DATE


01/11/24

SHEET

AD-905



THESE PLANS ARE PROVIDED BY THE CITY OF AGOURA HILLS AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRACT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

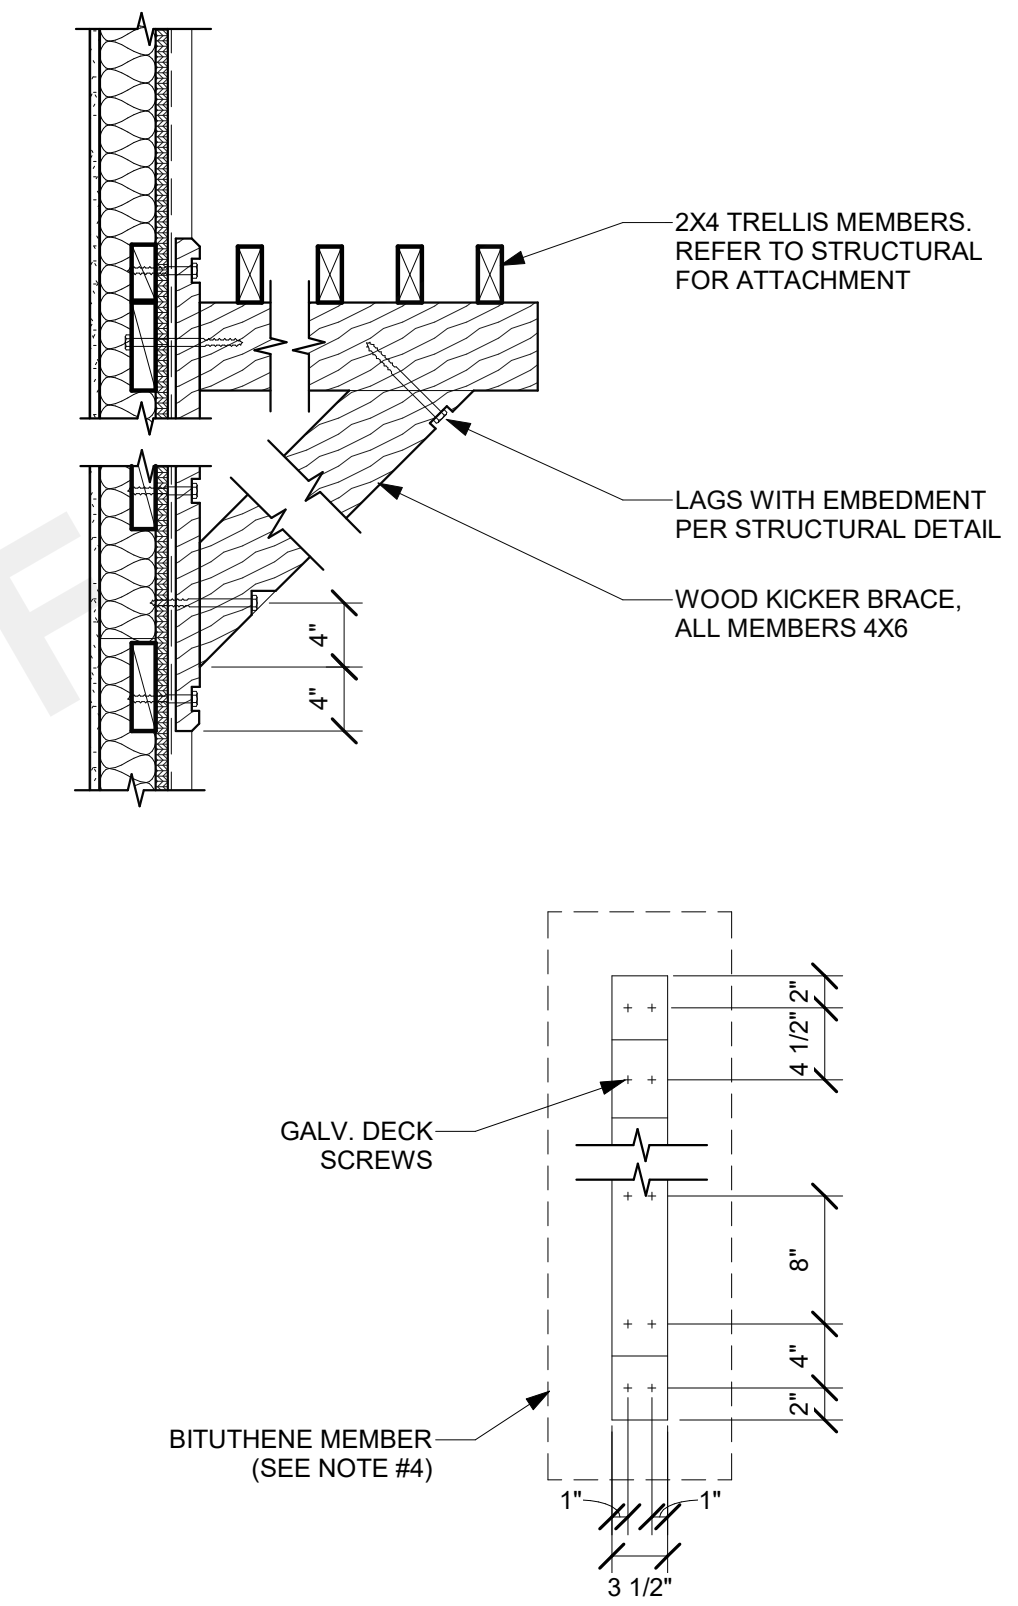

12	BRACE W/ KICKER - TRELLIS
----	---------------------------

AD-906 SCALE: 1" = 1'-0"

**PROTOTYPE ADU
2 CAR GARAGE CONVERSION
COACHELLA, CA**

ARCHITECTURAL DETAILS - SPANISH COLONIAL

PUBLIC SET

DATE
01/11/24
SHEET

SHEET

AD-906